



Modbus Register Mapping

Our energy working for you.™



Control

PCC 1301
PowerCommand 1.1
PowerCommand 1.2
PowerCommand 2.2
PowerCommand 2.3
PowerCommand 3.3
DMC 1000
DMC 1500
MCM3320

Table of Contents

SECTION	TITLE	PAGE
	SAFETY PRECAUTIONS	II
1.	PCC 1301/POWERCOMMAND 1.X MODBUS REGISTER MAP	1
	Multi-Drop Network Mode Pins	1
2.	POWERCOMMAND 2.X/3.X MODBUS REGISTER MAP	9
3.	POWERCOMMAND 2.X/3.X MODBUS FAULT STATUS BITMAPS	267
4.	NFPA 110 & EXTENDED ANNUNCIATION BITMAP	323
5.	DMC 1000 MODBUS PARAMETRIC DATA	325
6	DMC 10000 MODBUS ENUMERATED DATA	355
7	DMC 10000 MODBUS BITMAP DATA	375
8.	DMC 1500 COMMUNICATION SERVER 1	379
	Modbus Address: 2 (Slave)	379
	Generator Set Bus Data	381
	Utility Bus Data	383
	ATS 1–5 DATA	384
	Word Data (Reference Tables ATS 1-5 and 6-10)	385
	ATS 6–10 DATA	386
9.	DMC 1500 COMMUNICATION SERVER 2	389
	Modbus Address: 1 (Slave)	389
	Generator Raw Data Gen 1-5	392
10.	MCM3320 MODBUS REGISTER MAP	397
	Modbus Communications	397
	Reference Documents	397
	Serial Port Configuration	397
	Device Addresses	397
	Power-Up Time	397
	Response Time	397
	Data Formatting	397
	Modbus Activity LED	397
	Supported Functions	397
	Holding Register Function	398
	Preset Single/Preset Multiple Registers Function	398
	Diagnostic Counters	398
	Register Maps	398
	Application Layer	398
	Read Hold Registers	398
	Set Single Register	398
	Modbus Loopback	398
	Set Multiple Registers	399
	Modbus Register Table	399
11.	MCM3320 MODBUS FAULT STATUS BITMAPS	481
12.	MCM3320 MODBUS ADDRESS 42506, 42507	485

Safety Precautions

SAVE THESE INSTRUCTIONS – This manual contains important instructions that should be followed during installation and maintenance of the generator set and batteries.

Before operating the generator set (genset), read the Operator's Manual and become familiar with it and the equipment. **Safe and efficient operation can be achieved only if the equipment is properly operated and maintained.** Many accidents are caused by failure to follow fundamental rules and precautions.

The following symbols, found throughout this manual, alert you to potentially dangerous conditions to the operator, service personnel, or the equipment.

⚠ DANGER *This symbol warns of immediate hazards which will result in severe personal injury or death.*

⚠ WARNING *This symbol refers to a hazard or unsafe practice which can result in severe personal injury or death.*

⚠ CAUTION *This symbol refers to a hazard or unsafe practice which can result in personal injury or product or property damage.*

FUEL AND FUMES ARE FLAMMABLE

Fire, explosion, and personal injury or death can result from improper practices.

- DO NOT fill fuel tanks while engine is running, unless tanks are outside the engine compartment. Fuel contact with hot engine or exhaust is a potential fire hazard.
- DO NOT permit any flame, cigarette, pilot light, spark, arcing equipment, or other ignition source near the generator set or fuel tank.
- Fuel lines must be adequately secured and free of leaks. Fuel connection at the engine should be made with an approved flexible line. Do not use zinc coated or copper fuel lines with diesel fuel.
- Natural gas is lighter than air, and will tend to gather under hoods. Propane is heavier than air, and will tend to gather in sumps or low areas. NFPA code requires all persons handling propane to be trained and qualified.
- Be sure all fuel supplies have a positive shutoff valve.
- Be sure battery area has been well-ventilated prior to servicing near it. Lead-acid batteries emit a highly explosive hydrogen gas that can be ignited by arcing, sparking, smoking, etc.

EXHAUST GASES ARE DEADLY

- Provide an adequate exhaust system to properly expel discharged gases away from enclosed or sheltered areas and areas where individuals are likely to congregate. Visually and audibly inspect the exhaust for leaks daily or per the maintenance schedule. Make sure that exhaust manifolds are secured and not warped. Do not use exhaust gases to heat a compartment.
- The exhaust vent should be high enough to help clear gases, avoid accumulation of snow, and in accordance with local mechanical codes.
- Be sure the unit is well ventilated.
- Engine exhaust and some of its constituents are known to the state of California to cause cancer, birth defects, and other reproductive harm.

MOVING PARTS CAN CAUSE SEVERE PERSONAL INJURY OR DEATH

- Keep your hands, clothing, and jewelry away from moving parts.

- Before starting work on the generator set, disconnect battery charger from its AC source, then disconnect starting batteries, negative (–) cable first. In lean-burn natural gas (LBNG) gensets, also make sure the starter's air supply line is disconnected or completely vented until the generator set is ready to start. This will prevent accidental starting.
- Make sure that fasteners on the generator set are secure. Tighten supports and clamps, keep guards in position over fans, drive belts, etc.
- Do not wear loose clothing or jewelry in the vicinity of moving parts, or while working on electrical equipment. Loose clothing and jewelry can become caught in moving parts.
- If adjustment must be made while the unit is running, use extreme caution around hot manifolds, moving parts, etc.

DO NOT OPERATE IN FLAMMABLE AND EXPLOSIVE ENVIRONMENTS

Flammable vapor can cause an engine to overspeed and become difficult to stop, resulting in possible fire, explosion, severe personal injury and death. Do not operate a genset where a flammable vapor environment can be created by fuel spill, leak, etc., unless the genset is equipped with an automatic safety device to block the air intake and stop the engine. The owners and operators of the genset are solely responsible for operating the genset safely. Contact your authorized Cummins Power Generation distributor for more information.

ELECTRICAL SHOCK CAN CAUSE SEVERE PERSONAL INJURY OR DEATH

- Remove electric power before removing protective shields or touching electrical equipment. Use rubber insulative mats placed on dry wood platforms over floors that are metal or concrete when around electrical equipment. Do not wear damp clothing (particularly wet shoes) or allow skin surface to be damp when handling electrical equipment. Do not wear jewelry. Jewelry can short out electrical contacts and cause shock or burning.
- Use extreme caution when working on electrical components. High voltages can cause injury or death. DO NOT tamper with interlocks.
- Follow all applicable state and local electrical codes. Have all electrical installations performed by a qualified licensed electrician. Tag and lock open switches to avoid accidental closure.
- DO NOT CONNECT GENERATOR SET DIRECTLY TO ANY BUILDING ELECTRICAL SYSTEM. Hazardous voltages can flow from the generator set into the utility line. This creates a potential for electrocution or property damage. Connect only through an approved isolation switch or an approved paralleling device.

MEDIUM VOLTAGE GENERATOR SETS (601V to 15kV)

- Medium voltage acts differently than low voltage. Special equipment and training is required to work on or around medium voltage equipment. Operation and maintenance must be done only by persons trained and qualified to work on such devices. Improper use or procedures will result in severe personal injury or death.
- Do not work on energized equipment. Unauthorized personnel must not be permitted near energized equipment. Due to the nature of medium voltage electrical equipment, induced voltage remains even after the equipment is disconnected from the power source. Plan the time for maintenance with authorized personnel so that the equipment can be de-energized and safely grounded.

GENERAL SAFETY PRECAUTIONS

- Coolants under pressure have a higher boiling point than water. DO NOT open a radiator or heat exchanger pressure cap while the engine is running. To prevent severe scalding, let engine cool down before removing coolant pressure cap. Turn cap slowly, and do not open it fully until the pressure has been relieved.
- Used engine oils have been identified by some state or federal agencies as causing cancer or reproductive toxicity. When checking or changing engine oil, take care not to ingest, breathe the fumes, or contact used oil.

- Keep multi-class ABC fire extinguishers handy. Class A fires involve ordinary combustible materials such as wood and cloth; Class B fires, combustible and flammable liquid fuels and gaseous fuels; Class C fires, live electrical equipment. (ref. NFPA No. 10).
- Make sure that rags or combustible material are not left on or near the generator set.
- Make sure generator set is mounted in a manner to prevent combustible materials from accumulating under or near the unit.
- Remove all unnecessary grease and oil from the unit. Accumulated grease and oil can cause overheating and engine damage which present a potential fire hazard.
- Keep the generator set and the surrounding area clean and free from obstructions. Remove any debris from the set and keep the floor clean and dry.
- Do not work on this equipment when mentally or physically fatigued, or after consuming any alcohol or drug that makes the operation of equipment unsafe.
- Substances in exhaust gases have been identified by some state or federal agencies as causing cancer or reproductive toxicity. Take care not to breath or ingest or come into contact with exhaust gases.
- Do not store any flammable liquids, such as fuel, cleaners, oil, etc., near the generator set. A fire or explosion could result.
- Wear hearing protection when near an operating generator set.
- To prevent serious burns, avoid contact with hot metal parts such as radiator system, turbo charger system and exhaust system.

DISPOSE OF THIS UNIT PROPERLY





THIS PAGE LEFT INTENTIONALLY BLANK



1. PCC 1301/PowerCommand 1.x Modbus Register Map

The controller contains data that can be read by a remote device communicating via Modbus RTU protocol on a two-wire RS485 master/slave multi-drop bus. In this arrangement the remote device is the master and the controller is the slave.

bus Serial Line Implementation Guide v1.0, both available at www.modbus.org.

For more information about the Modbus protocol, refer to *Modbus Application Protocol v1.1a and Mod-*

Multi-Drop Network Mode Pins

- Hi (+) TB2-3
- Lo (-) TB2-4
- Shield TB2-1

Note: Earlier versions of software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

Note: If an address or bit is not listed in this table it is not used.

Note: The external device can read 1–40 contiguous registers, write 1–40 contiguous registers, or read diagnostic counters.

Addr.	Description	Read / Write	Scale	Units	Type	Notes
40004	Save adjustments	Read and Write	–	–	Unsigned integer	0=No action 1=Save adjustments Save adjustments saves to non volatile memory all the write parameters listed in this table
40010	Genset control run/off/auto switch position	Read	–	Switch position	Unsigned integer	0=off 1=Run/Manual 2=Auto
40011	Genset operating state	Read	–	Operating state	Unsigned integer	0=Stopped 1=Start Pending 2=Warm-up at Idle 3=Running 4=Cool down at Rated 5=Cool down at Idle
40012	Fault Code	Read	–	Event code	Unsigned integer	This register contains the fault code number of currently active fault. See service manual for list of supported fault codes.
40013	Fault Type	Read	–	Fault type	Unsigned integer	This register contains the fault type of currently active fault 0=Normal 1=Warning 2=Derate 3=Shutdown with cool down 4=Shutdown
40016	NFPA 110 fault register	Read	–		bitmap	See Section 4 Table 4-1 page 323.
40017	Extended Annunciation fault register	Read	–		bitmap	See Section 4 Table 4-2 page 323.

Addr.	Description	Read / Write	Scale	Units	Type	Notes
40018	Alternator output voltage line to neutral (a phase)	Read	1.0	AC Volts	Unsigned integer	
40019	Alternator output voltage line to neutral (b phase)	Read	1.0	AC Volts	Unsigned integer	
40020	Alternator output voltage line to neutral (c phase)	Read	1.0	AC Volts	Unsigned integer	
40022	Alternator output voltage line to line (a to b phase)	Read	1.0	AC Volts	Unsigned integer	
40023	Alternator output voltage line to line (b to c phase)	Read	1.0	AC Volts	Unsigned integer	
40024	Alternator output voltage line to line (c to a phase)	Read	1.0	AC Volts	Unsigned integer	
40025	Alternator output voltage (used for voltage regulation)	Read	1.0	AC Volts	Unsigned integer	
40026	Alternator output current (phase a)	Read	0.1	AC Amps	Unsigned integer	
40027	Alternator output current (phase b)	Read	0.1	AC Amps	Unsigned integer	
40028	Alternator output current (phase c)	Read	0.1	AC Amps	Unsigned integer	
40029	Alternator output average current	Read	0.1	AC Amps	Unsigned integer	
40040	Alternator output volt-amperes (phase a)	Read	0.1	kVA	Unsigned integer	
40041	Alternator output volt-amperes (phase b)	Read	0.1	kVA	Unsigned integer	
40042	Alternator output volt-amperes (phase c)	Read	0.1	kVA	Unsigned integer	
40043	Alternator output volt-amperes (total)	Read	0.1	kVA	Unsigned integer	
40044	Alternator frequency	Read	0.1	Hz	Unsigned integer	
40058	Alternator output current (phase a)	Read	0.1	% of nominal	Unsigned integer	
40059	Alternator output current (phase b)	Read	0.1	% of nominal	Unsigned integer	
40060	Alternator output current (phase c)	Read	0.1	% of nominal	Unsigned integer	

Addr.	Description	Read / Write	Scale	Units	Type	Notes
40061	Control battery voltage	Read	0.1	DC Volts	Unsigned integer	
40062	Engine oil pressure	Read	1.0	kPa	Unsigned integer	
40064	Engine coolant temperature	Read	0.1	Degrees Celsius	Unsigned integer	
40068	Engine speed	Read	0.1	RPM	Unsigned integer	
40069	Number of engine starts	Read	1.0	Number of starts	Unsigned integer	
40070	Engine runtime (high byte)	Read	1.0	Sec	Unsigned integer	
40071	Engine Runtime (Low byte)	Read	1.0	Sec	Unsigned integer	
40300	Genset start stop control via Modbus	Read and Write			Unsigned integer	0 – Stop 1– Start
40302	Genset E–stop switch via Modbus	Read and Write			Unsigned integer	0 – Estop not active 1 – Estop active
43000	Nominal alternator voltage setting	Read and Write	1.0	AC Volts	Unsigned integer	
43001	Nominal alternator frequency setting	Read and Write		Hz	Unsigned integer	0 = 60 1 = 50
43002	Alternator phase setting	Read and Write		# of phases	Unsigned integer	0 = 1 1 =3
43003	Alternator connection setting	Read and Write		Alternator	Unsigned integer	1=Wye
43004	Glow plug driver feature enable	Read and Write		Feature enabled	Unsigned integer	0 = No 1 = Yes
43005	Battery charging alternator fault enable	Read and Write		Feature enabled	Unsigned integer	0 = No 1 = Yes
43006	Remote start time delay	Read and Write	1.0	Sec	Unsigned integer	
43007	Remote stop time delay	Read and Write	1.0	Sec	Unsigned integer	
43008	Engine starting – cycle crank attempts setting	Read and Write	1.0	Number of attempts	Unsigned integer	
43009	Engine starting – cycle crank time setting	Read and Write	1.0	Sec	Unsigned integer	
43010	Engine starting – cycle crank rest time setting	Read and Write	1.0	Sec	Unsigned integer	
43011	Fault bypass (battle short) feature enable	Read and Write		Feature enabled	Unsigned integer	0 =Inactive 1 = Active


Addr.	Description	Read / Write	Scale	Units	Type	Notes
43012	Fault bypass (battle short) switch input assignment	Read and Write		Switch assignment	Unsigned integer	0= None 1=Customer Input 1 2=Customer Input 2 3=Operator Panel
43013	Automatic voltage regulator Enable	Read and Write		Feature enabled	Unsigned integer	0 = No 1 = Yes
43014	Automatic voltage regulator volts per hertz roll off knee setting	Read and Write	0.1	Hz	Unsigned integer	
43015	Automatic voltage regulator volts per hertz roll off slope setting	Read and Write	0.1	%V/Hz	Unsigned integer	
43016	Automatic voltage regulator gain setting	Read and Write	1.0	%	Unsigned integer	
43017	Automatic voltage regulator integral setting	Read and Write	1.0	1.0	Unsigned integer	
43018	Automatic voltage regulator derivative setting	Read and Write	1.0	1.0	Unsigned integer	
43019	Electronic governing enable	Read and Write	1.0	1.0	Unsigned integer	0 = No 1 = Yes
43020	Electronic governing initial duty cycle setting	Read and Write	0.1	1.0	Unsigned integer	
43021	Electronic governing initial duty cycle time	Read and Write	0.1	Sec	Unsigned integer	
43022	Electronic governing start ramp duty cycle setting	Read and Write	0.1	%	Unsigned integer	
43023	Electronic governing maximum duty cycle setting	Read and Write	0.1	%	Unsigned integer	
43024	Electronic governing gain setting	Read and Write	1.0	%	Unsigned integer	
43025	Electronic governing integral setting	Read and Write	1.0	%	Unsigned integer	
43026	Electronic governing derivative setting	Read and Write	1.0	%	Unsigned integer	
43027	Electronic governing crank exit fuel duty cycle setting	Read and Write	0.1	%	Unsigned integer	
43028	Electronic governing dither factor setting	Read and Write	1.0	%	Unsigned integer	

Addr.	Description	Read / Write	Scale	Units	Type	Notes
43029	Electronic governing start ramp time setting	Read and Write	0.01	Sec	Unsigned integer	
43030	Electronic governing enable engine speed	Read and Write	1.0	RPM	Unsigned integer	
43031	Electronic governing minimum duty cycle setting	Read and Write	1.0	%	Unsigned integer	
43032	Electronic governing maximum duty cycle setting	Read and Write	1.0	%	Unsigned integer	
43033	Model number character #1	Read and Write			Character	
43034	Model number character #2	Read and Write			Character	
43035	Model number character #3	Read and Write			Character	
43036	Model number character #4	Read and Write			Character	
43037	Model number character #5	Read and Write			Character	
43038	Model number character #6	Read and Write			Character	
43039	Model number character #7	Read and Write			Character	
43040	Model number character #8	Read and Write			Character	
43041	Model number character #9	Read and Write			Character	
43042	Model number character #10	Read and Write			Character	
43043	Model number character #11	Read and Write			Character	
43044	Model number character #12	Read and Write			Character	
43045	Model number character #13	Read and Write			Character	
43046	Model number character #14	Read and Write			Character	
43047	Model number character #15	Read and Write			Character	
43048	Model number character #16	Read and Write			Character	
43049	Serial number character #1	Read and Write			Character	
43050	Serial number character #2	Read and Write			Character	

Addr.	Description	Read / Write	Scale	Units	Type	Notes
43051	Serial number character #3	Read and Write			Character	
43052	Serial number character #4	Read and Write			Character	
43053	Serial number character #5	Read and Write			Character	
43054	Serial number character #6	Read and Write			Character	
43055	Serial number character #7	Read and Write			Character	
43056	Serial number character #8	Read and Write			Character	
43057	Serial number character #9	Read and Write			Character	
43058	Serial number character #10	Read and Write			Character	
43059	Serial number character #11	Read and Write			Character	
43060	Serial number character #12	Read and Write			Character	
43061	Serial number character #13	Read and Write			Character	
43062	Serial number character #14	Read and Write			Character	
43063	Serial number character #15	Read and Write			Character	
43064	Serial number character #16	Read and Write			Character	
43065	Configurable input #1 type	Read and Write		Input type	Unsigned integer	0 = Event 1 = Warning 2 = Shutdown
43066	Configurable input #2 type	Read and Write		Input type	Unsigned integer	0 = Event 1 = Warning 2 = Shutdown
43067	Configurable output #1 event code number	Read and Write	1.0	Event code	Unsigned integer	
43068	Configurable output #2 fault event number	Read and Write	1.0	Event code	Unsigned integer	
43069	60 Hz alternator output voltage adjust %	Read and Write	1.0	%	Unsigned integer	
43070	50 Hz alternator output voltage adjust %	Read and Write	0.1	%	Unsigned integer	
43071	Alternator frequency adjustment %	Read and Write	0.1	0.1	Unsigned integer	

Addr.	Description	Read / Write	Scale	Units	Type	Notes
43072	60 Hz line 1 to neutral metering voltage calibration	Read and Write	0.0001	%	Unsigned integer	
43073	60 Hz line 2 to neutral metering voltage calibration	Read and Write	0.0001	%	Unsigned integer	
43075	50 Hz line 1 to neutral metering voltage calibration	Read and Write	0.0001	%	Unsigned integer	
43076	50 Hz line 2 to neutral metering voltage calibration	Read and Write	0.0001	%	Unsigned integer	
43077	50 Hz line 3 to neutral metering voltage calibration	Read and Write	0.0001	%	Unsigned integer	
43078	60 Hz line 1 metering current calibration	Read and Write	0.001	%	Unsigned integer	
43079	60 Hz line 2 metering current calibration	Read and Write	0.001	%	Unsigned integer	
43080	60 Hz line 3 metering current calibration	Read and Write	0.001	%	Unsigned integer	
43081	50 Hz line 1 metering current calibration	Read and Write	0.001	%	Unsigned integer	
43082	50 Hz line 2 metering current calibration	Read and Write	0.001	%	Unsigned integer	
43083	50 Hz line 3 metering current calibration	Read and Write	0.001	%	Unsigned integer	
43084	Annunciator configurable input #1 type	Read and Write		Input type	Unsigned integer	0 = Event 1 = Warning 2 = Shutdown
43085	Annunciator configurable input #2 type	Read and Write		Input type	Unsigned integer	0 = Event 1 = Warning 2 = Shutdown
43086	Annunciator configurable input #3 type	Read and Write		Input type	Unsigned integer	0 = Event 1 = Warning 2 = Shutdown
43087	Annunciator configurable output #1 event code number	Read and Write	1.0	Event code	Unsigned integer	
43088	Annunciator configurable output #2 event code number	Read and Write	1.0	Event code	Unsigned integer	

Addr.	Description	Read / Write	Scale	Units	Type	Notes
43089	Annunciator configurable output #3 event code number	Read and Write	1.0	Event code	Unsigned integer	
43090	Annunciator configurable output #4 event code number	Read and Write	1.0	Event code	Unsigned integer	

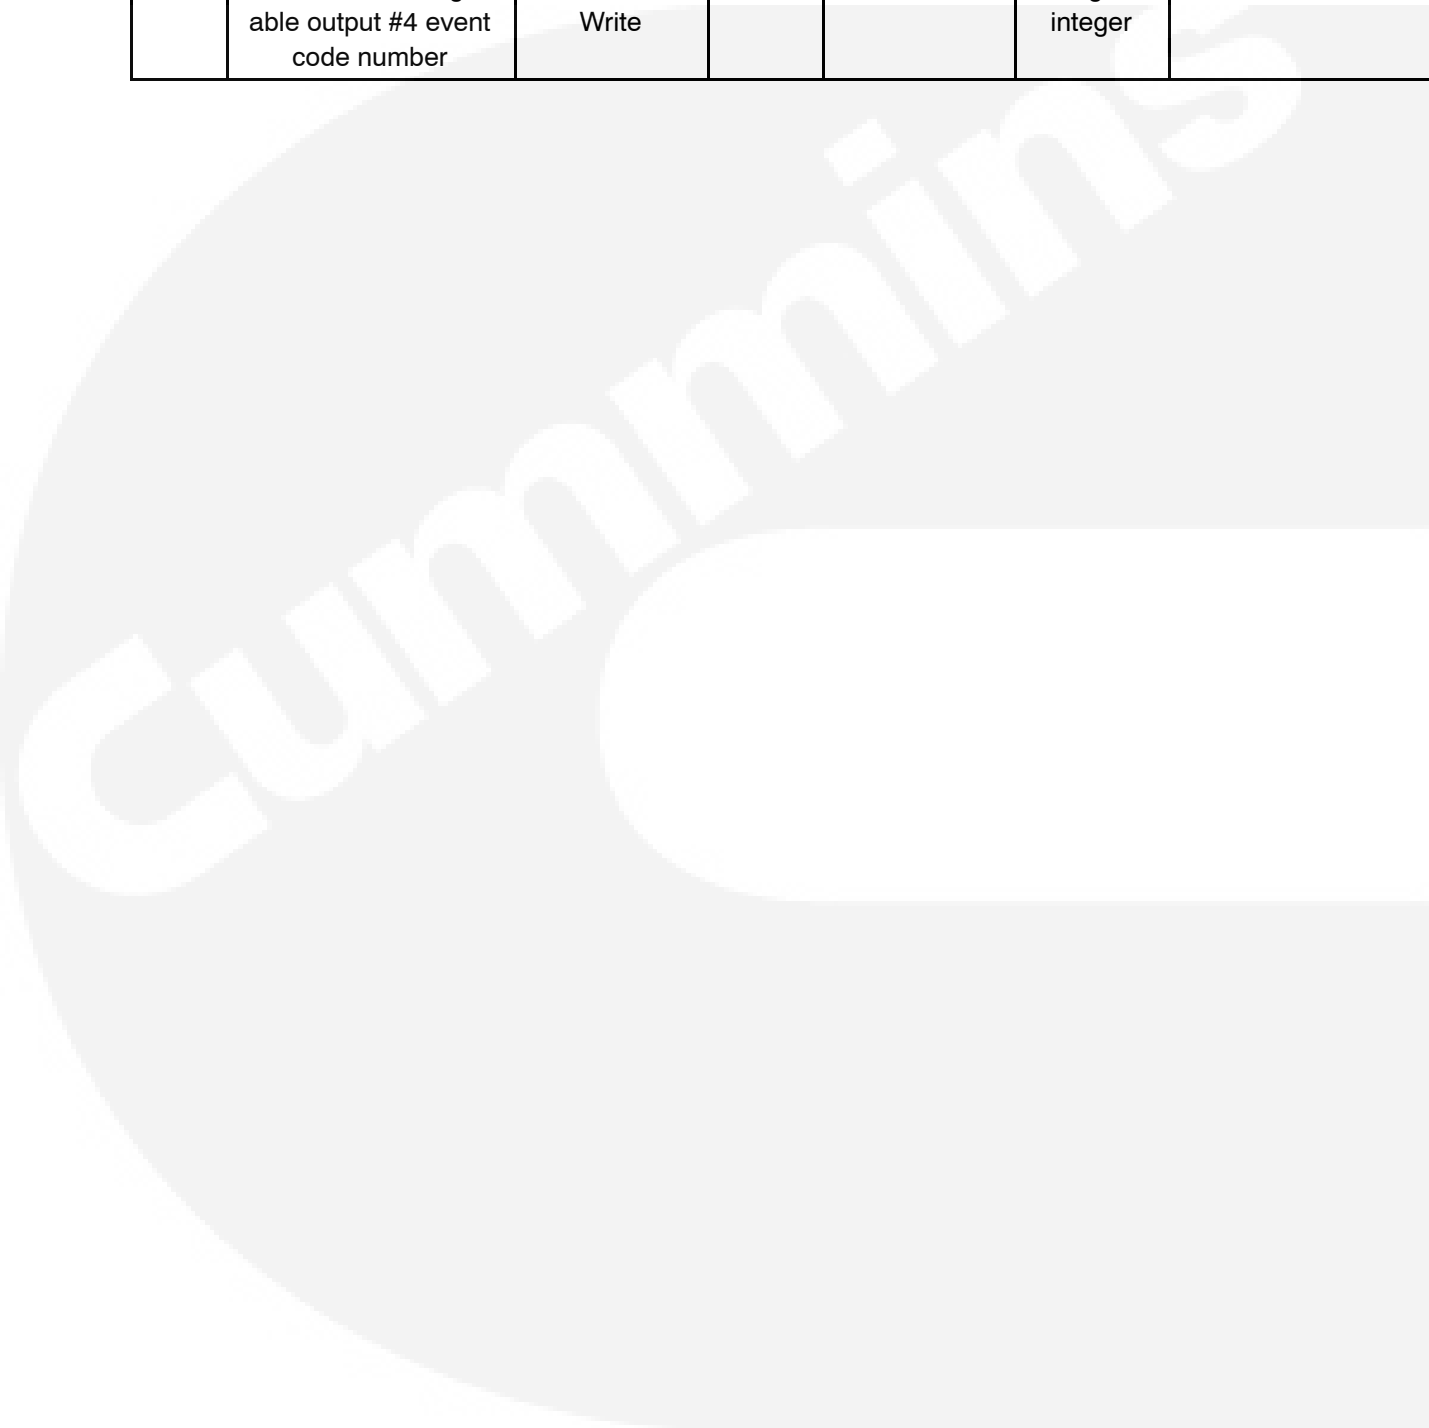

2. PowerCommand 2.x/3.x Modbus Register Map

Use the following equation to calculate the value of 32-bit parameters.

A = high register value

B = low register value

parameter = (A * 65536 * multiplier) + (B * multiplier)

Register 40070 has 322 (high register value = A).
Register 40071 has 1567 (low register value = B).

Engine Running Time = (322 * 65536 * 0.1) + (1567 * 0.1)

For example, Engine Running Time is a 32-bit parameter in registers 40070 and 40071.

The engine run-time is 2111823 seconds, or 586.6 hours.

Note: Earlier versions of software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

Note: If an address or bit is not listed in this table it is not used.

Note: The external device can read 1–40 contiguous registers, write 1–40 contiguous registers, or read diagnostic counters.

Note: The Lowest modbus register value is considered as the High Register Value and the highest modbus register value is considered as the low Register Value.

Addr.	Parameter	Access	Specifications		Description	Control
40010	Control Switch Position	Read Only	0: Off		Current position of the generator set switch panel Off-Run-Auto switch as seen by the generator set control. Modbus mapping shall be in both addresses 40580 and 40010. For 40010 Modbus Only: 0: Off 1: Auto 2: Manual	PC 2.x, PC 3.x
			1: Auto			
			2: Manual			
40012	Most Recent Fault or Warning	Read Only	Multiplier: 1	Unit: Fault Code	This Modbus Register displays most recent Fault or Warning. It is not mapped with any logical.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
40013	Modbus register 40013	Read Only	0: None		This register returns the Fault Type of the Fault Code. This is not associated with any logical.	PC 2.x, PC 3.x
			1: Warning			
			2: Shutdown			
40014	Genset % Standby Total kW	Read Only	Multiplier: 0.01	Unit: %	Monitors the total generator set standby KW percentage output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

Addr.	Parameter	Access	Specifications		Description	Control
40016	NFPA 110 Logical Status	Read Only	Multiplier: 1.0	Unit:	16-bit number to represent the status of the NFPA 110 logical. See NFPA 110 bitmap.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40017	Extended NFPA 110 Logical Status	Read Only	Multiplier: 1.0	Unit:	16-bit number to represent the status of the NFPA 110 logical. See NFPA 110 bitmap.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40018	Genset L1N Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set L1N voltage	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40019	Genset L2N Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set L2N voltage	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40020	Genset L3N Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set L3N voltage	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40022	Genset L1L2 Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set L1L2 voltage	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40023	Genset L2L3 Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set L2L3 voltage	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
40024	Genset L3L1 Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set L3L1 voltage	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40025	Genset LL Average Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Line to Line average voltage	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40026	Genset L1 Current	Read Only	Multiplier: 1	Unit: Amps	Monitors the generator set L1 current value.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40027	Genset L2 Current	Read Only	Multiplier: 1	Unit: Amps	Generator set L2 current	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40028	Genset L3 Current	Read Only	Multiplier: 1	Unit: Amps	Generator set L3 current	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40029	Genset Average Current	Read Only	Multiplier: 1	Unit: Amps	Generator set average current	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40030	Genset Neutral Current	Read Only	Multiplier: 1	Unit: Amps	Generator set neutral current	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40031	Genset L1 kW	Read Only	Multiplier: 1	Unit: kW	Generator set L1 kW	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40032	Genset L2 kW	Read Only	Multiplier: 1	Unit: kW	Generator set L2 kW	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
40033	Genset L3 kW	Read Only	Multiplier: 1	Unit: kW	Generator set L3 kW	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
40034	Genset Total kW	Read Only	Multiplier: 1	Unit: kW	Generator set total kW	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40035	Genset L1 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Generator set L1 KVAR	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40036	Genset L2 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Generator set L2 Kvar	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
40037	Genset L3 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Generator set L3 Kvar	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

Addr.	Parameter	Access	Specifications		Description	Control
40038	Genset Total kVAR	Read Only	Multiplier: 1	Unit: kVAR	Generator set total kVAR	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40039	Genset Total Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Generator set total power factor (L1+L2+L3)	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: S			
40040	Genset L1 kVA	Read Only	Multiplier: 1	Unit: kVA	Generator set L1 kVA	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40041	Genset L2 kVA	Read Only	Multiplier: 1	Unit: kVA	Generator set L2 kVA	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40042	Genset L3 kVA	Read Only	Multiplier: 1	Unit: kVA	Generator set L3 kVA	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40043	Genset Total kVA	Read Only	Multiplier: 1	Unit: kVA	Generator set total kVA	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40046	Genset Total Negative kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set total negative kWh accumulation	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40047	Genset Total Negative kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set total negative kWh accumulation	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 32	Upper Limit:		
			Sign: U			
40048	Genset Total Positive kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set total positive kWh accumulation	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967290		
			Sign: U			
40049	Genset Total Positive kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set total positive kWh accumulation	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967290		
			Sign: U			
40050	Genset Total Net kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set total net kWh accumulation	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -2147483648		
			Size (bits): 32	Upper Limit: 2147483643		
			Sign: S			
40051	Genset Total Net kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set total net kWh accumulation	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -2147483648		
			Size (bits): 32	Upper Limit: 2147483643		
			Sign: S			
40052	Genset Total Negative kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set total negative kVARh accumulation	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40053	Genset Total Negative kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set total negative kVARh accumulation	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
40054	Genset Total Positive kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set total positive kVARh accumulation	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967290		
			Sign: U			
40055	Genset Total Positive kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set total positive kVARh accumulation	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967290		
			Sign: U			
40056	Genset Total Net kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set total net kVARh accumulation	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -2147483648		
			Size (bits): 32	Upper Limit: 2147483643		
			Sign: S			
40057	Generator set Total Net kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set total net kVARh accumulation	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -2147483648		
			Size (bits): 32	Upper Limit: 2147483643		
			Sign: S			
40058	Genset % Standby L1 Current	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set standby L1 current percentage output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40059	Genset % Standby L2 Current	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set standby L2 current percentage output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40060	Genset % Standby L3 Current	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set standby L3 current percentage output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit:		
			Sign: U			
40061	Battery Voltage	Read Only	Multiplier: 0.1	Unit: Vdc	Battery voltage value. Modbus and PCCnet has different multiplier value. For Modbus use only, multiplier/units = 0.1 volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40062	Oil Pressure	Read Only	Multiplier: 1	Unit: kPa	Monitor point for the Oil Pressure. Modbus and PCCnet have different multiplier value. For Modbus use only, Multiplier/Units = 1kPa	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40063	Oil Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Oil Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40064	Coolant Temperature	Read Only	Multiplier: 0.1	Unit: degC	Monitor point for the Coolant Temperature. Modbus mapping shall be to both 46126 and 40064 addresses. For Modbus use only, Multiplier/Units = 0.1C	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40065	Intake Manifold Temperature	Read Only	Multiplier: 0.1	Unit: degF	To monitor Intake Manifold Temperature. This parameter represents "Intake Manifold Temperature 1".	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 410		
			Sign: S			
40065	Intake Manifold Temperature	Read Only	Multiplier: 0.1	Unit: degF	To monitor Intake Manifold Temperature. This parameter represents "Intake Manifold Temperature 1".	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 410		
			Sign: S			
40066	Fuel Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Fuel Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 410		
			Sign: S			
40067	Fuel Rate	Read Only	Multiplier: 0.05	Unit: gal/hr	Monitor point for the Fuel Rate	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40068	Average Engine Speed	Read Only	Multiplier: 1	Unit: RPM	Monitor point for the Average Engine Speed. Modbus and PCCnet have different multiplier value. For Modbus use only, Multiplier/Units = 1 RPM	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40070	Engine Running Time	Read Only	Multiplier: 0.1	Unit: seconds	Total engine run time. Modbus has different multiplier than PCCnet. For Modbus use only, multiplier/units = 0.1 Sec	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40071	Engine Running Time	Read Only	Multiplier: 0.1	Unit: seconds	Total engine run time. Modbus has different multiplier than PCCnet. For Modbus use only, multiplier/units = 0.1 Sec	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40072	Total Fuel Consumption	Read Only	Multiplier: 0.1	Unit: gallons	Total fuel consumption since start of engine.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 32	Upper Limit:		
			Sign: U			
40073	Total Fuel Consumption	Read Only	Multiplier: 0.1	Unit: gallons	Total fuel consumption since start of engine.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40074	Total Number of Runs	Read Only	Multiplier: 1	Unit:	Total number of generator set runs.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967295		
			Sign: U			
40075	Total Number of Runs	Read Only	Multiplier: 1	Unit:	Total number of generator set runs.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967295		
			Sign: U			
40076	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076–40092 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40077	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076–40092 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
40078	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076 – 40092 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40079	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076–40092 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40080	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076–40092 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40081	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076–40092 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40082	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076–40092 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40083	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076–40092 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40084	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076–40092 for 17 char of this string.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40085	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076–40092 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40086	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076–40092 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40087	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076–40092 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40088	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076–40092 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40089	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076–40092 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40090	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076–40092 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40091	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076–40092 for 17 char of this string.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40092	Runs Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40076–40092 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40096	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096–0112 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40097	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096–0112 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40098	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096-0112 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40099	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096-0112 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40100	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096-0112 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40101	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096-0112 for 17 char of this string.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40102	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096-0112 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40103	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096-0112 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40104	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096-0112 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40105	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096-0112 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40106	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096-0112 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40107	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096-0112 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40108	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096-0112 for 17 char of this string.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40109	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096-0112 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40110	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096-0112 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40111	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096-0112 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40112	Start Attempts Reset Time	Read Only	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for Modbus. Modbus implementation or the Real time stamp will use 40096-0112 for 17 char of this string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40118	Utility L1N Voltage	Read Only	Multiplier: 1	Unit: Vac	Utility L1N voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40119	Utility L2N Voltage	Read Only	Multiplier: 1	Unit: Vac	Utility L2N voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40120	Utility L3N Voltage	Read Only	Multiplier: 1	Unit: Vac	Utility L3N voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40122	Utility L1L2 Voltage	Read Only	Multiplier: 1	Unit: Vac	Utility L1L2 voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40123	Utility L2L3 Voltage	Read Only	Multiplier: 1	Unit: Vac	Utility L2L3 voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40124	Utility L3L1 Voltage	Read Only	Multiplier: 1	Unit: Vac	Utility L3L1 voltage	PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40125	Utility LL Average Voltage	Read Only	Multiplier: 1	Unit: Vac	Utility Line to Line average voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40126	Utility L1 Current	Read Only	Multiplier: 1	Unit: Amps	Utility L1 current	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40127	Utility L2 Current	Read Only	Multiplier: 1	Unit: Amps	Utility L2 current	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40128	Utility L3 Current	Read Only	Multiplier: 1	Unit: Amps	Utility L3 current	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40131	Utility L1 kW	Read Only	Multiplier: 1	Unit: kW	Utility L1 kW	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40132	Utility L2 kW	Read Only	Multiplier: 1	Unit: kW	Utility L2 kW	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40133	Utility L3 kW	Read Only	Multiplier: 1	Unit: kW	Utility L3 kW	PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit:		
			Sign: S			
40134	Utility Total kW	Read Only	Multiplier: 1	Unit: kW	Utility total kW	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40135	Utility L1 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Utility L1 Kvar	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40136	Utility L2 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Utility L2 Kvar	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40137	Utility L3 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Utility L3 Kvar	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40138	Utility Total kVAR	Read Only	Multiplier: 1	Unit: kVAR	Utility total kVAR	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40139	Utility Total Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Utility total power factor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: S			
40140	Utility L1 kVA	Read Only	Multiplier: 1	Unit: kVA	Utility L1 kVA	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
40141	Utility L2 kVA	Read Only	Multiplier: 1	Unit: kVA	Utility L2 kVA	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40142	Utility L3 kVA	Read Only	Multiplier: 1	Unit: kVA	Utility L3 kVA	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40143	Utility Total kVA	Read Only	Multiplier: 1	Unit: kVA	Utility total kVA	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40144	Utility Frequency	Read Only	Multiplier: 0.001	Unit: Hz	Utility line frequency	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40145	Utility Frequency	Read Only	Multiplier: 0.001	Unit: Hz	Utility line frequency	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40146	Utility Total Negative kWh	Read Only	Multiplier: 1	Unit: kWh	Utility total negative kWh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40147	Utility Total Negative kWh	Read Only	Multiplier: 1	Unit: kWh	Utility total negative kWh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40148	Utility Total Positive kWh	Read Only	Multiplier: 1	Unit: kWh	Utility total positive kWh accumulation	PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40149	Utility Total Positive kWh	Read Only	Multiplier: 1	Unit: kWh	Utility total positive kWh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40150	Utility Total Net kWh	Read Only	Multiplier: 1	Unit: kWh	Utility total net kWh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: S			
40151	Utility Total Net kWh	Read Only	Multiplier: 1	Unit: kWh	Utility total net kWh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: S			
40152	Utility Total Negative kVARh	Read Only	Multiplier: 1	Unit: kVARh	Utility total negative kVARh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40153	Utility Total Negative kVARh	Read Only	Multiplier: 1	Unit: kVARh	Utility total negative kVARh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40154	Utility Total Positive kVARh	Read Only	Multiplier: 1	Unit: kVARh	Utility total positive kVARh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40155	Utility Total Positive kVARh	Read Only	Multiplier: 1	Unit: kVARh	Utility total positive kVARh accumulation	PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40156	Utility Total Net kVARh	Read Only	Multiplier: 1	Unit: kVARh	Utility total net kVARh accumula- tion	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: S			
40157	Utility Total Net kVARh	Read Only	Multiplier: 1	Unit: kVARh	Utility total net kVARh accumula- tion	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: S			
40158	Genset Bus L1N Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Bus L1N voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40159	Genset Bus L2N Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Bus L2N voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40160	Genset Bus L3N Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Bus L3N voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40162	Genset Bus L1L2 Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Bus L1L2 voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40163	Genset Bus L2L3 Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Bus L2L3 voltage	PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit:		
			Sign: U			
40164	Genset Bus L3L1 Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Bus L3L1 voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40165	Genset Bus LL Average Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Bus Line to Line average voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40166	Genset Bus L1 Current	Read Only	Multiplier: 1	Unit: Amps	Generator set Bus L1 current	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
40167	Genset Bus L2 Current	Read Only	Multiplier: 1	Unit: Amps	Generator set Bus L2 current	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40168	Genset Bus L3 Current	Read Only	Multiplier: 1	Unit: Amps	Generator set Bus L3 current	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40171	Genset Bus L1 kW	Read Only	Multiplier: 1	Unit: kW	Generator set Bus L1 kW	PC 3.x
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
40172	Genset Bus L2 kW	Read Only	Multiplier: 1	Unit: kW	Generator set Bus L2 kW	PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
40173	Genset Bus L3 kW	Read Only	Multiplier: 1	Unit: kW	Generator set Bus L3 kW	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40174	Genset Bus Total kW	Read Only	Multiplier: 1	Unit: kW	Generator set Bus total kW	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40175	Genset Bus L1 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Generator set bus L1 Kvar	PC 3.x
			Offset: 0	Lower Limit: -32678		
			Size (bits): 16	Upper Limit: 32672		
			Sign: S			
40176	Genset Bus L2 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Generator set bus L2 Kvar	PC 3.x
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
40177	Genset Bus L3 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Generator set bus L3 Kvar	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40178	Genset Bus Total kVAR	Read Only	Multiplier: 1	Unit: kVAR	Generator set bus total kVAR	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

Addr.	Parameter	Access	Specifications		Description	Control
40179	Genset Bus Total Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Generator set Bus Total power factor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: S			
40180	Genset Bus L1 kVA	Read Only	Multiplier: 1	Unit: kVA	Generator set Bus L1 kVA	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40181	Genset Bus L2 kVA	Read Only	Multiplier: 1	Unit: kVA	Generator set Bus L2 kVA	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40182	Genset Bus L3 kVA	Read Only	Multiplier: 1	Unit: kVA	Generator set Bus L3 kVA	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40183	Genset Bus Total kVA	Read Only	Multiplier: 1	Unit: kVA	Generator set bus total kVA	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40184	Genset Bus Frequency	Read Only	Multiplier: 0.001	Unit: Hz	Generator set bus line frequency	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40185	Genset Bus Frequency	Read Only	Multiplier: 0.001	Unit: Hz	Generator set bus line frequency	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
40186	Genset Bus Total Negative kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set bus total negative kWh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40187	Genset Bus Total Negative kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set bus total negative kWh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40188	Genset Bus Total Positive kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set bus total positive kWh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40189	Genset Bus Total Positive kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set bus total positive kWh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40190	Genset Bus Total Net kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set bus total net kWh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: S			
40191	Genset Bus Total Net kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set bus total net kWh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: S			
40192	Genset Bus Total Negative kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set bus total negative kVARh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: U			
40193	Genset Bus Total Negative kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set bus total negative kVARh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40194	Genset Bus Total Positive kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set bus total positive kVARh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40195	Genset Bus Total Positive kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set bus total positive kVARh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40196	Genset Bus Total Net kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set Bus total net kVARh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: S			
40197	Genset Bus Total Net kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set Bus total net kVARh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: S			
40198	Ground Current	Read Only	Multiplier: 0.1	Unit: amps	Ground current	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40199	Genset Negative Sequence Current %	Read Only	Multiplier: 0.01	Unit: %	Generator set Negative Sequence Current as Percent of Standby Current Rating	PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit:		
			Sign: U			
40201	Coolant Temperature Sensor Type	Read Only	0: PGBU		Either PGBU(Onan) or EBU(Cummins) sensor. MOD-BUS Access: Read Only	PC 2.x, PC 3.x
			1: EBU			
40207	Battery Charger Alternator Flash Voltage	Read Only	Multiplier: 0.001	Unit: Vdc	The Battery Charger Alternator Flash Voltage after all scaling and validity checks.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 35		
			Sign: U			
40210	External Speed Bias Input	Read Only	Multiplier: 0.01	Unit: %	Monitor point for the external speed bias input.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -100		
			Size (bits): 16	Upper Limit: 100		
			Sign: S			
40211	External Voltage Bias Input	Read Only	Multiplier: 0.01	Unit: %	Monitor point for the external voltage bias input.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -100		
			Size (bits): 16	Upper Limit: 100		
			Sign: S			
40226	Speed Bias Output / Configurable Analog output #1 Output Predictor	Read Only	Multiplier: 0.01	Unit: Vdc	Configurable analog output voltage output value (predicted)	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40227	Voltage Bias Output / Configurable Analog output #2 Output Predictor	Read Only	Multiplier: 0.01	Unit: Vdc	Configurable analog output voltage output value (predicted)	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

Addr.	Parameter	Access	Specifications	Description	Control	
40228	Amber Warning Lamp Status	Read Only	0: Inactive	Engine Control System indicates a warning condition.	PC 2.x, PC 3.x	
			1: Active			
40229	Barometric Absolute Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Barometric Absolute Pressure. Displayed as "Ambient Pressure" in the HMI.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40230	Boost Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Boost Absolute Pressure	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40231	CAN Datalink Status	Read Only	0: Inactive	Indicates the status of the CAN datalink	PC 2.x, PC 3.x	
			1: Active			
			2: Failed			
40232	Crankcase Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Crankcase Pressure.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -35.67		
			Size (bits): 16	Upper Limit: 38		
			Sign: S			
40235	ECM Derate Request	Read Only	0: No Derate Request	Request made by the ECS for a reduction in load	PC 2.x, PC 3.x	
			1: Derate Request			
			2: Error			
			3: Don't Care			
40236	Engine Application Type	Read Only	0: ECM	Monitor point for the output of the Engine application type. Either ECM (CAN) or Hydro-Mechanical.	PC 2.x, PC 3.x	
			1: Hydro-Mechanical			
40242	Aftercooler Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Aftercooler Temperature.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 410		
			Sign: S			

Addr.	Parameter	Access	Specifications		Description	Control
40254	Fuel Supply Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Fuel Supply Pressure. Displayed as "Fuel Supply Pressure" in the HMI.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 145		
			Sign: U			
40258	Fuel Outlet Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Fuel Outlet Pressure Pressure. Displayed as "Fuel Rail Pressure" in the HMI.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 36404		
			Sign: U			
40259	Fuel Outlet Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Fuel Outlet Pressure Pressure. Displayed as "Fuel Rail Pressure" in the HMI.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 36404		
			Sign: U			
40260	Intake Manifold 2 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Intake Manifold 2 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 410		
			Sign: S			
40261	Intake Manifold 3 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Intake Manifold 3 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 410		
			Sign: S			
40264	Percent Engine Torque/Duty Cycle	Read Only	Multiplier: 1	Unit: %	Monitor point for the percent engine torque output and the governor percent duty cycle output when used with the HM ECM	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40276	Post-Filter Oil Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Post-Filter Oil Pressure	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit: 145		
			Sign: U			
40277	Pre-Filter Oil Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Pre-Filter Oil Pressure	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 145		
			Sign: U			
40278	Configurable Input #14 Switch	Read Only	0: Inactive		Configurable Input #14 input software state status. Gives software Inactive/Active state	PC 2.x, PC 3.x
			1: Active			
40279	Turbocharger 1 Speed	Read Only	Multiplier: 1	Unit: RPM	Monitor point for the Turbocharger 1 Speed	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 257000		
			Sign: U			
40280	Turbocharger 1 Speed	Read Only	Multiplier: 1	Unit: RPM	Monitor point for the Turbocharger 1 Speed	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 257000		
			Sign: U			
40281	Turbocharger 2 Boost Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Turbocharger 2 Boost Pressure	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40282	Water in Fuel Indicator	Read Only	0: No		Water in Fuel Indication	PC 2.x, PC 3.x
			1: Yes			
40283	Controller Mode	Read Only	0: Off		The controller mode	PC 2.x, PC 3.x
			1: Ready			
			2: Setup			
			3: Starting			
			4: Idle			
			5: Rated			
			6: Stop Normal			
			7: Stop Emergency			
			8: Factory Test			

Addr.	Parameter	Access	Specifications		Description	Control
			9: Wait to Power Down			
40285	Power Down Mode Timer	Read Only	Multiplier: 1	Unit: seconds	Timer to count down the time before the control goes to sleep	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 600		
			Sign: U			
40298	Runs Since Reset	Read Only	Multiplier: 1	Unit:	Number of runs since the last reset. Upper limit is $2^{32} - 1$.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967290		
			Sign: U			
40299	Runs Since Reset	Read Only	Multiplier: 1	Unit:	Number of runs since the last reset. Upper limit is $2^{32} - 1$.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967290		
			Sign: U			
40300	Remote Start Switch (Modbus)	Read/Write	0: Inactive		Modbus Remote Start	PC 2.x, PC 3.x
			1: Active			
40301	Fault Reset (Modbus)	Read/Write	0: Inactive		Modbus fault reset.	PC 2.x, PC 3.x
			1: Active			
40320	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40321	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40322	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 168	Upper Limit:		
			Sign: C			
40323	Start Inhibit No1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator pan- el when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40324	Start Inhibit No1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator pan- el when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40325	Start Inhibit No1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator pan- el when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40326	Start Inhibit No1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator pan- el when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40327	Start Inhibit No1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator pan- el when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40328	Start Inhibit No1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator pan- el when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40329	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40330	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40331	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40332	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40333	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40334	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40335	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40336	Start Inhibit No1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator pan- el when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40337	Start Inhibit No1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator pan- el when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40338	Start Inhibit No1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator pan- el when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40339	Start Inhibit No1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator pan- el when this fault becomes active	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40340	Start Inhibit No2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator pan- el when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40341	Start Inhibit No2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator pan- el when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
40342	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40343	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40344	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40345	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40346	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40347	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40348	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40349	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40350	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40351	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40352	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40353	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40354	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active.	PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40355	Start Inhibit No2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40356	Start Inhibit No2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40357	Start Inhibit No2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40358	Start Inhibit No2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40359	Start Inhibit No2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40360	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40361	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40362	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40363	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40364	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40365	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 168	Upper Limit:		
			Sign: C			
40366	Start Inhibit No3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40367	Start Inhibit No3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40368	Start Inhibit No3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40369	Start Inhibit No3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40370	Start Inhibit No3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40371	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40372	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40373	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40374	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40375	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40376	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications	Description	Control	
			Size (bits): 168	Upper Limit:		
			Sign: C			
40377	Start Inhibit No3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40378	Start Inhibit No3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40379	Start Inhibit No3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40500	Low Fuel Switch	Read Only	0: Inactive		Low Fuel input software state sta- tus. Gives software Inactive/Ac- tive state	PC 2.x, PC 3.x
			1: Active			
40501	Low Fuel/Confi- gurable Input #6 Switch	Read Only	0: Inactive		This is the status of the Configur- able Input #6.	PC 2.x, PC 3.x
			1: Active			
40509	PTC Mode Switch	Read Only	0: Inactive		PTC Mode Switch function output status. Gives software Inactive/ Active state	PC 3.x
			1: Active			
40510	Extended Par- allel/Configur- able Input #32 Switch	Read Only	0: Inactive		This is the status of the Configur- able Input #32.	PC 3.x
			1: Active			

Addr.	Parameter	Access	Specifications	Description	Control
40512	Remote E-stop Switch	Read Only	0: Inactive	Remote E-stop input software state status. Gives software Inactive/Active state	PC 2.x, PC 3.x
			1: Active		
40513	Remote Start Switch	Read Only	0: Inactive	Remote Start input software state status. Gives software Inactive/Active state	PC 2.x, PC 3.x
			1: Active		
40515	Retransfer Inhibit/Configurable Input #21 Switch	Read Only	0: Inactive	This is the status of the Configurable Input #21.	PC 3.x
			1: Active		
40516	Rupture Basin Switch	Read Only	0: Inactive	Rupture Basin input software state status. Gives software Inactive/Active state	PC 2.x, PC 3.x
			1: Active		
40517	Rupture Basin/Configurable Input #12 Switch	Read Only	0: Inactive	This is the status of the Configurable Input #12.	PC 2.x, PC 3.x
			1: Active		
40519	Start Type Switch	Read Only	0: Inactive	Start Type input software state status. Gives software Inactive/Active state	PC 2.x, PC 3.x
			1: Active		
40521	Sync Enable/Configurable Input #30 Switch	Read Only	0: Inactive	This is the status of the Configurable Input #30.	PC 3.x
			1: Active		
40524	Transfer Inhibit/Configurable Input #20 Switch	Read Only	0: Inactive	This is the status of the Configurable Input #20.	PC 3.x
			1: Active		
40525	Utility CB Inhibit/Configurable Input #25 Switch	Read Only	0: Inactive	This is the status of the Configurable Input #25.	PC 3.x
			1: Active		
40526	Utility CB Pos B/Configurable Input #23 Switch	Read Only	0: Inactive	This is the status of the Configurable Input #23.	PC 3.x
			1: Active		

Addr.	Parameter	Access	Specifications	Description	Control
40527	Utility CB Tripped/Configurable Input #24 Switch	Read Only	0: Inactive	This is the status of the Configurable Input #24.	PC 3.x
			1: Active		
40528	Utility Single Mode Verify/Configurable Input #29 Switch	Read Only	0: Inactive	This is the status of the Configurable Input #29.	PC 3.x
			1: Active		
40535	Configurable Output #1 Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 2.x, PC 3.x
			1: Active		
40536	Configurable Output #2 Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 2.x, PC 3.x
			1: Active		
40537	Configurable Output #20 Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 3.x
			1: Active		
40538	Configurable Output #21 Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 3.x
			1: Active		
40539	Configurable Output #22 Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 3.x
			1: Active		
40540	Configurable Output #3 Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 2.x, PC 3.x
			1: Active		
40541	Configurable Output #4 Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 2.x, PC 3.x
			1: Active		
40542	Delayed Off / Configurable Output #10 Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 2.x, PC 3.x
			1: Active		
40543	Fuel Shutoff Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 2.x, PC 3.x
			1: Active		

Addr.	Parameter	Access	Specifications	Description	Control
40547	Keyswitch Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 2.x, PC 3.x
			1: Active		
40549	Load Dump / Configurable Output #11 Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 2.x, PC 3.x
			1: Active		
40550	Local Status / Configurable Output #7 Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 2.x, PC 3.x
			1: Active		
40552	Oil Priming Pump / Configurable Output #6 Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 2.x, PC 3.x
			1: Active		
40553	Ready To Load /Configurable Output #5 Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 2.x, PC 3.x
			1: Active		
40554	Run Relay #1 Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 2.x, PC 3.x
			1: Active		
40555	Run Relay #2 Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 2.x, PC 3.x
			1: Active		
40556	Speed/Voltage Bias Relay Status	Read Only	0: Inactive	Indicates if the output's status is Inactive or Active	PC 3.x
			1: Active		
40561	Common Alarm Fault Status	Read Only	0: Inactive	The status of the Common Alarm Fault	PC 2.x, PC 3.x
			1: Active		
40562	Common Shutdown Command	Read Only	0: Inactive	The status of the common shutdown command	PC 2.x, PC 3.x
			1: Active		
40563	Common Shutdown Event Status	Read Only	0: Inactive	The status of the Common Shutdown Event	PC 2.x, PC 3.x
			1: Active		

Addr.	Parameter	Access	Specifications		Description	Control
40565	Common Warning Event Status	Read Only	0: Inactive		The status of the Common Warning Event	PC 2.x, PC 3.x
			1: Active			
40570	Fault Reset Command	Read Only	0: Inactive		One shot due to fault reset switch being active.	PC 2.x, PC 3.x
			1: Active			
40577	Base Frequency	Read Only	Multiplier: 0.001	Unit: Hz	Provides a point to monitor the base frequency	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40578	Base Frequency	Read Only	Multiplier: 0.001	Unit: Hz	Provides a point to monitor the base frequency	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40586	Excitation State	Read Only	0: Disabled		Shows the enable status of the excitation enabled = regulator on.	PC 2.x, PC 3.x
			1: Enabled			
40587	Exercise Command	Read Only	0: Inactive		The output of the Exercise Command OR logic	PC 2.x, PC 3.x
			1: Active			
			2: Reserved			
			3: Not Available			
40589	Exercise Time Remaining	Read Only	Multiplier: 0.1	Unit: hours	Time remaining until exercise stop sequence begins	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 25		
			Sign: U			
40592	Battle Short Command	Read Only	0: Inactive		Indicates status of battle short inputs	PC 2.x, PC 3.x
			1: Active			
40595	Final Frequency Reference	Read Only	Multiplier: 0.001	Unit: Hz	The frequency scaled version of the final speed reference	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 100		
			Sign: U			
40596	Final Frequency Reference	Read Only	Multiplier: 0.001	Unit: Hz	The frequency scaled version of the final speed reference	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 100		
			Sign: U			
40600	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40601	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40602	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40603	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40604	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40605	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40606	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40607	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40608	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40609	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40610	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 136	Upper Limit:		
			Sign: C			
40611	Configurable Input #1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40612	Configurable Input #1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40613	Configurable Input #1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40614	Configurable Input #1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40615	Configurable Input #1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40620	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40621	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40622	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40623	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40624	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40625	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 136	Upper Limit:		
			Sign: C			
40626	Configurable Input #2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40627	Configurable Input #2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40628	Configurable Input #2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40629	Configurable Input #2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40630	Configurable Input #2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40631	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40632	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40633	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40634	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40635	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40640	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 136	Upper Limit:		
			Sign: C			
40641	Configurable Input #13 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40642	Configurable Input #13 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40643	Configurable Input #13 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40644	Configurable Input #13 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40645	Configurable Input #13 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40646	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40647	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40648	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40649	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40650	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40651	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 136	Upper Limit:		
			Sign: C			
40652	Configurable Input #13 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40653	Configurable Input #13 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40654	Configurable Input #13 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40655	Configurable Input #13 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40660	Configurable Input #14 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40661	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40662	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40663	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40664	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40665	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40666	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 136	Upper Limit:		
			Sign: C			
40667	Configurable Input #14 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40668	Configurable Input #14 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40669	Configurable Input #14 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40670	Configurable Input #14 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40671	Configurable Input #14 Fault Text	Read/ Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40672	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40673	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40674	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40675	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40709	Device Type (Modlon)	Read Only	Multiplier: 1	Unit:	This Modbus register is created for Modlon register mapping. This parameter is not associated with any logical.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
40710	Control Switch Position (Modlon)	Read Only	0: Off		This Modbus register is created for Modlon register mapping.	PC 3.x
			1: Manual			
			2: Auto			

Addr.	Parameter	Access	Specifications		Description	Control
40711	Genset Run Sequence State (Modlon)	Read Only	0: Stop		This Modbus register is created for Modlon register mapping.	PC 3.x
			1: Time Delay to Start			
			2: Warmup at Idle			
			3: Rated Freq and Voltage			
			4: Cooldown / Stop Delay			
			5: Cooldown at Idle			
			6: Rated to Idle Transition Delay			
40712	Most Recent Fault or Warning (Modlon)	Read Only	Multiplier: 1	Unit: Fault Code	This Modbus register is created for Modlon register mapping. This Modbus register is not associated with any logical Address	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40713	Fault Type (Modlon)	Read Only	0: None		This Modbus register is created for modlon register mapping. This Modbus register is not associated with any logical address.	PC 3.x
			1: Warning			
			2: Derate			
			3: Shutdown with cooldown			
			4: Shutdown			
40714	Genset % Standby Total kW (Modlon)	Read Only	Multiplier: 0.5	Unit: %	This Modbus register is created for modlon register mapping. Monitors the total generator set standby KW percentage output. Modbus has different multiplier than PCCnet. For Modlon use only, use multiplier 0.5 %	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40715	Genset Total kW (Modlon GenStatus)	Read Only	Multiplier: 1	Unit: kW	This Modbus register is created for modlon register mapping. Generator set total kW.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

Addr.	Parameter	Access	Specifications		Description	Control
40716	NFPA 110 Logical Status (Modlon)	Read Only	Multiplier: 1	Unit:	This Modbus register is created for modlon register mapping. 32-bit number to represent the status of the NFPA 110 logical. See NFPA110 bitmap. (See Section 4 Table 4-1 page 323).	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40717	NFPA 110 Logical Status (Modlon)	Read Only	Multiplier: 1	Unit:	This Modbus register is created for modlon register mapping. 32-bit number to represent the status of the NFPA 110 logical. (See Section 4 Table 4-1 page 323).	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40718	Genset Frequency OP (Modlon)	Read Only	Multiplier: 0.1	Unit: Hz	This Modbus register is created for modlon register mapping. Generator set Frequency OP. Modbus has different multiplier than PCCnet. For Modlon use only, Multiplier/Units = 0.1 Hz	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40719	Genset Total Power Factor (Modlon)	Read Only	Multiplier: 0.00005	Unit: PF	This Modbus register is created for modlon register mapping. Generator set total power factor (L1+L2+L3). Modbus and PCCnet has different multiplier value. For Modlon, use 0.00005 PF.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40720	Genset Total kVA (Modlon)	Read Only	Multiplier: 1	Unit: kVA	This Modbus register is created for modlon register mapping. Generator set total kVA	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
40721	Genset Total kW (Modlon GenACData)	Read Only	Multiplier: 1	Unit: kW	This Modbus register is created for modlon register mapping. Generator set total kW in Gen AC Data.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40722	Genset Total kVAR (Modlon)	Read Only	Multiplier: 1	Unit: kVAR	This Modbus register is created for modlon register mapping. Generator set total kVAR	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40723	Genset L1L2 Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This Modbus register is created for modlon register mapping. Generator set L1L2 voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40724	Genset L2L3 Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This Modbus register is created for modlon register mapping. Generator set L2L3 voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40725	Genset L3L1 Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This Modbus register is created for modlon register mapping. Generator set L3L1 voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40726	Genset L1N Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This Modbus register is created for modlon register mapping. Generator set L1N voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
40727	Genset L2N Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This Modbus register is created for modlon register mapping. Generator set L2N voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40728	Genset L3N Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This Modbus register is created for modlon register mapping. Generator set L3N voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40729	Genset L1 Current (Modlon)	Read Only	Multiplier: 1	Unit: Amps	This Modbus register is created for modlon register mapping. Monitors the generator set L1 current value.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40730	Genset L2 Current (Modlon)	Read Only	Multiplier: 1	Unit: Amps	This Modbus register is created for modlon register mapping. Generator set L2 current	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40731	Genset L3 Current (Modlon)	Read Only	Multiplier: 1	Unit: Amps	This Modbus register is created for modlon register mapping. Generator set L3 current	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40732	Genset % Standby L1 Current (Modlon)	Read Only	Multiplier: 0.5	Unit: %	This Modbus register is created for modlon register mapping. Monitors the generator set standby L1 current percentage output. Modbus and PCCnet have different multiplier value. For modlon use 0.5 %	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: U			
40733	Genset % Standby L2 Current (Modlon)	Read Only	Multiplier: 0.5	Unit: %	This Modbus register is created for modlon register mapping. Monitors the generator set standby L2 current percentage output. Modbus and PCCnet has different multiplier value. For Modlon, use 0.5 %	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40734	Genset % Standby L3 Current (Modlon)	Read Only	Multiplier: 0.5	Unit: %	This Modbus register is created for modlon register mapping. Monitors the generator set standby L3 current percentage output. Modbus and PCCnet has different multiplier value. For Modlon use 0.5 %	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40735	Battery Voltage (Modlon)	Read Only	Multiplier: 0.1	Unit: Vdc	This Modbus register is created for modlon register mapping. Battery voltage value. Modbus and PCCnet has different multiplier value. For Modlon use 0.1 volts	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40736	Oil Pressure (Modlon)	Read Only	Multiplier: 0.1	Unit: kPa	This Modbus register is created for modlon register mapping. Monitor point for the Oil Pressure. Modbus and PCCnet have different multiplier value. For modlon, use 0.1 KPA	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
40737	Oil Temperature (Modlon)	Read Only	Multiplier: 0.1	Unit: degK	This Modbus register is created for modlon register mapping. Monitor point for the Oil Temperature. Modbus and PCCnet has different multiplier value. For Modlon use 0.1 deg Kelvin	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40738	Coolant Temperature (Modlon)	Read Only	Multiplier: 0.1	Unit: degK	This Modbus register is created for modlon register mapping. Monitor point for the Coolant Temperature. Modbus and PCCnet has different multiplier value. For Modlon, use 0.1deg Kelvin.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40739	Intake Manifold Temperature (Modlon)	Read Only	Multiplier: 0.1	Unit: degK	This Modbus register is created for modlon register mapping. To monitor Intake Manifold Temperature. Modbus and PCCnet has different multiplier value. For Modlon, use 0.1 deg Kelvin	PC 3.x
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 410		
			Sign: S			
40740	Fuel Temperature (Modlon)	Read Only	Multiplier: 0.1	Unit: degK	This Modbus register is created for modlon register mapping. Monitor point for the Fuel Temperature. Modbus and PCCnet has different multiplier value. For Modlon, use 0.1 deg Kelvin.	PC 3.x
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 410		
			Sign: S			
40741	Fuel Rate (Modlon)	Read Only	Multiplier: 0.01	Unit: gal/hr	This Modbus register is created for modlon register mapping. Monitor point for the Fuel Rate. Modbus and PCCnet has different multiplier value. For Modlon, use 0.01 gph	PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40742	Average Engine Speed (Modlon)	Read Only	Multiplier: 1	Unit: RPM	This Modbus register is created for modlon register mapping. Monitor point for the Average Engine Speed. Modbus and PCCnet have different multiplier value. For Modlon, use 1 RPM.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40743	Total Number of Runs (Modlon)	Read Only	Multiplier: 1	Unit:	This Modbus register is created for modlon register mapping. Total number of generator set runs.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967295		
			Sign: U			
40744	Engine Running Time (Modlon)	Read Only	Multiplier: 0.1	Unit: seconds	This Modbus register is created for modlon register mapping. Total engine run time. Modbus has different multiplier than PCCnet. For Modbus, use 0.1 sec	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40745	Engine Running Time (Modlon)	Read Only	Multiplier: 0.1	Unit: seconds	This Modbus register is created for modlon register mapping. Total engine run time. Modbus has different multiplier than PCCnet. For Modbus, use 0.1 sec	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40746	Genset Total Net kWh (Modlon)	Read Only	Multiplier: 1	Unit: kWh	This Modbus register is created for modlon register mapping. Generator set total net kWh accumulation	PC 3.x
			Offset: 0	Lower Limit: -2147483648		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 32	Upper Limit: 2147483643		
			Sign: S			
40747	Genset Total Net kWh (Modlon)	Read Only	Multiplier: 1	Unit: kWh	This Modbus register is created for modlon register mapping. Generator set total net kWh accumulation	PC 3.x
			Offset: 0	Lower Limit: -2147483648		
			Size (bits): 32	Upper Limit: 2147483643		
			Sign: S			
40748	Total Fuel Consumption (Modlon)	Read Only	Multiplier: 0.01	Unit: gallons	This Modbus register is created for modlon register mapping. Total fuel consumption since start of engine. Modbus and PCCnet has different multiplier value. For Modlon, use 0.01 Gallons	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40749	Total Fuel Consumption (Modlon)	Read Only	Multiplier: 0.01	Unit: gallons	This Modbus register is created for modlon register mapping. Total fuel consumption since start of engine. Modbus and PCCnet has different multiplier value. For Modlon, use 0.01 Gallons	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40750	Utility/Genset Bus Frequency (Modlon)	Read Only	Multiplier: 0.1	Unit: Hz	This Modbus register is created for modlon register mapping. Utility line frequency or Generator set Bus Frequency depending on Paralleling Application. Modbus and PCCnet has different multiplier value. For Modlon, use 0.1 Hz.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
40751	Utility/Genset Bus L1L2 Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This Modbus register is created for modlon register mapping. Utility L1L2 Voltage or Generator set Bus L1L2 voltage depending on paralleling application.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40752	Utility/Genset Bus L2L3 Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This Modbus register is created for modlon register mapping. Utility L2L3 voltage	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40753	Utility/Genset Bus L3L1 Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This Modbus register is created for modlon register mapping. Utility L3L1 voltage or Generator set Bus L3L1 voltage depending on paralleling application.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40754	Utility/Genset Bus L1N Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This Modbus register is created for modlon register mapping. Utility L1N voltage or Generator set Bus L1N voltage depending on paralleling application.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40755	Utility/Genset Bus L2N Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This Modbus register is created for modlon register mapping. Utility L2N voltage or Generator set Bus L2N voltage depending on paralleling application.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
40756	Utility/Genset Bus L3N Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This Modbus register is created for modlon register mapping. Utility L3N voltage or Generator set Bus L3N voltage depending on paralleling application.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40757	Customer Faults (Modlon)	Read Only	Multiplier: 1	Unit:	This Modbus register is created for modlon register mapping. 16 bit fault bitmap for Modbus interface.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: S			
40760	ES State (Modlon)	Read Only	0: Standby		This Modbus register is created for modlon register mapping. Internal paralleling status variable	PC 3.x
			1: Dead Bus			
			2: Synchronize			
			3: Load Share			
			4: Load Govern			
40761	Load Demand Stop Command (Modlon)	Read Only	0: Inactive		This Modbus register is created for modlon register mapping. Modbus input for load demand stop command.	PC 3.x
			1: Active			
40764	Genset CB Position Status (Modlon)	Read Only	0: Open		This Modbus register is created for modlon register mapping. indicates generator set breaker position	PC 3.x
			1: Closed			
			2: Not Available			
40765	Utility CB Position Status (Modlon)	Read Only	0: Open		This Modbus register is created for modlon register mapping. indicates utility breaker position	PC 3.x
			1: Closed			
			2: Not Available			
40766	Remote Start Switch (Modlon)	Read/Write	0: Inactive		This Modbus register is created for modlon register mapping. Modbus Remote Start	PC 3.x
			1: Active			

Addr.	Parameter	Access	Specifications		Description	Control
40767	Fault Reset (Modlon)	Read/Write	0: Inactive		This Modbus register is created for modlon register mapping. Modbus fault reset.	PC 3.x
			1: Active			
40800	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40801	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40802	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40803	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40804	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40805	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
40806	Aux101 1 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40807	Aux101 1 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40808	Aux101 1 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40809	Aux101 1 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40810	Aux101 1 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40811	Aux101 1 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40812	Aux101 1 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40813	Aux101 1 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40814	Aux101 1 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40815	Aux101 1 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40816	Aux101 1 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40817	Aux101 1 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40818	Aux101 1 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40819	Aux101 1 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40820	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40821	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40822	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40823	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40824	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
40825	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40826	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40827	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40828	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40829	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40830	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40831	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40832	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40833	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40834	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40835	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40836	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40837	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40838	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40839	Aux101 1 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40840	Aux102 0 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40841	Aux102 0 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40842	Aux102 0 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40843	Aux102 0 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
40844	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40845	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40846	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40847	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40848	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40849	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40850	Aux102 0 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40851	Aux102 0 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40852	Aux102 0 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40853	Aux102 0 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40854	Aux102 0 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40855	Aux102 0 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40856	Aux102 0 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40857	Aux102 0 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40858	Aux102 0 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40859	Aux102 0 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40860	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40861	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40862	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
40863	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40864	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40865	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40866	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40867	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40868	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40869	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40870	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40871	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40872	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40873	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40874	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40875	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40876	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40877	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40878	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40879	Aux102 0 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40880	Aux102 0 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40881	Aux102 0 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
40882	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40883	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40884	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40885	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40886	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40887	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40888	Aux102 0 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40889	Aux102 0 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40890	Aux102 0 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40891	Aux102 0 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40892	Aux102 0 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40893	Aux102 0 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40894	Aux102 0 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40895	Aux102 0 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40896	Aux102 0 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40897	Aux102 0 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40898	Aux102 0 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40899	Aux102 0 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40900	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
40901	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40902	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40903	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40904	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40905	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40906	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40907	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40908	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40909	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40910	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40911	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40912	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40913	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40914	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40915	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40916	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40917	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40918	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40919	Aux102 0 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
40920	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40921	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40922	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40923	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40924	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40925	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40926	Aux102 1 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40927	Aux102 1 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40928	Aux102 1 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40929	Aux102 1 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40930	Aux102 1 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40931	Aux102 1 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40932	Aux102 1 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40933	Aux102 1 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40934	Aux102 1 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40935	Aux102 1 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40936	Aux102 1 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40937	Aux102 1 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40938	Aux102 1 Fault 9 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
40939	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40940	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40941	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40942	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40943	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40944	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40945	Aux102 1 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40946	Aux102 1 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40947	Aux102 1 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40948	Aux102 1 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40949	Aux102 1 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40950	Aux102 1 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40951	Aux102 1 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40952	Aux102 1 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40953	Aux102 1 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40954	Aux102 1 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40955	Aux102 1 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40956	Aux102 1 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40957	Aux102 1 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
40958	Aux102 1 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40959	Aux102 1 Fault 10 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40960	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40961	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40962	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40963	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40964	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40965	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40966	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40967	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40968	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40969	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40970	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40971	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40972	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40973	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40974	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40975	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40976	Aux102 1 Fault 11 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
40977	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40978	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40979	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40980	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40981	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40982	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
40983	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40984	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40985	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40986	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40987	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40988	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40989	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40990	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40991	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40992	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40993	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40994	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40995	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
40996	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40997	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40998	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40999	Aux102 1 Fault 12 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43000	Genset % Ap- plication L1 Current	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set ap- plication L1 current percentage output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43001	Genset % Ap- plication L2 Current	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set ap- plication L2 current percentage output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
43002	Genset % Application L1 kVA	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set application L1 KVA percentage output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43003	Genset % Application L3 Current	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set application L3 current percentage output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43004	Genset % Application L2 kVA	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set application L2 KVA percentage output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43005	Genset % Application L3 kVA	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set application L3 KVA percentage output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43006	Genset % Application L1 kW	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set application L1 KW percentage output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43007	Genset % Application L2 kW	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set application L2 KW percentage output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43008	Genset % Application L3 kW	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set application L3 KW percentage output.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43009	Genset % Application Total kVA	Read Only	Multiplier: 0.1	Unit: %	Monitors the total generator set application KVA percentage output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43010	Genset % Application Total kW	Read Only	Multiplier: 0.1	Unit: %	Monitors the total generator set application KW percentage output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43017	Genset % Standby Total kVA	Read Only	Multiplier: 0.1	Unit: %	Monitors the total generator set standby KVA percentage output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43018	Genset Application kVA rating	Read Only	Multiplier: 0.1	Unit: kVA	The generator set KVA rating.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43019	Genset Application kW rating	Read Only	Multiplier: 0.1	Unit: kW	The generator set KW rating.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43020	Genset Application Nominal Current	Read Only	Multiplier: 1	Unit: Amps	The value of the generator set application nominal current. Displayed as "Generator set Application Rated Current" in HMI	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
43021	Genset Average Voltage%	Read Only	Multiplier: 0.01	Unit: %	Generator set average voltage percentage.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43030	Genset L1 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Generator set L1 power factor	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: S			
43031	Genset L1L2 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Generator set L1L2 voltage phase angle	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43032	Genset L1L2 Voltage%	Read Only	Multiplier: 0.01	Unit: %	Generator set L1L2 voltage%	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43033	Genset L1N Voltage%	Read Only	Multiplier: 0.01	Unit: %	Generator set L1N voltage%	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43044	Genset L2 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Generator set L2 power factor	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -1.28		
			Size (bits): 8	Upper Limit: 1.27		
			Sign: S			
43045	Genset L2L3 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Generator set L2L3 voltage phase angle	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 655.3		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
43046	Genset L2L3 Voltage%	Read Only	Multiplier: 0.01	Unit: %	Generator set L2L3 voltage%	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43047	Genset L2N Voltage%	Read Only	Multiplier: 0.01	Unit: %	Generator set L2N voltage%	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 655.3		
			Sign: U			
43058	Genset L3 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Generator set L3 power factor	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -1.28		
			Size (bits): 8	Upper Limit: 1.22		
			Sign: S			
43059	Genset L3L1 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Generator set L3L1 voltage phase angle	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 655.3		
			Sign: U			
43060	Genset L3L1 Voltage%	Read Only	Multiplier: 0.01	Unit: %	Generator set L3L1 voltage%	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 655.3		
			Sign: U			
43061	Genset L3N Voltage%	Read Only	Multiplier: 0.01	Unit: %	Generator set L3N voltage%	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43062	Genset Stand-by kVA rating	Read Only	Multiplier: 0.1	Unit: kVA	KVA rating for the generator set in Standby configuration.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
43063	Genset Stand-by kW rating	Read Only	Multiplier: 0.1	Unit: kW	KW rating for the generator set in Standby configuration.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43064	Genset Stand-by Nominal Current	Read Only	Multiplier: 1	Unit: Amps	The value of the generator set standby nominal current. Displayed as "Generator set Standby Rated Current" in HMI	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43065	Genset Total kVAh	Read Only	Multiplier: 1	Unit: kVAh	Generator set total kVAh accumulation	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
43066	Genset Total kVAh	Read Only	Multiplier: 1	Unit: kVAh	Generator set total kVAh accumulation	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
43067	Genset Total kVARs per Standby kVA	Read Only	Multiplier: 0.01	Unit: %	Total KVAR's per Standby kVA.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43111	Genset Bus L1 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Generator set Bus L1 power factor	PC 3.x
			Offset: 0	Lower Limit: -1.28		
			Size (bits): 8	Upper Limit: 1.22		
			Sign: S			
43112	Genset Bus L1L2 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Generator set bus L1L2 voltage phase angle	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: U			
43125	Genset Bus L2 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Generator set Bus L2 power factor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: S			
43126	Genset Bus L2L3 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Generator set bus L2L3 voltage phase angle	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43139	Genset Bus L3 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Generator set Bus L3 power factor	PC 3.x
			Offset: 0	Lower Limit: -1.28		
			Size (bits): 8	Upper Limit: 1.22		
			Sign: S			
43140	Genset Bus L3L1 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Generator set bus L3L1 voltage phase angle	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43143	Genset Bus Total kVAh	Read Only	Multiplier: 1	Unit: kVAh	Generator set bus total kVAh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
43144	Genset Bus Total kVAh	Read Only	Multiplier: 1	Unit: kVAh	Generator set bus total kVAh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
43146	Paralleling Application	Read/Write	0: None		Determines what the function of the Other Meter is.	PC 3.x
			1: Utility			
			2: Genset Bus			
43162	Utility L1 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Utility L1 power factor	PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: S			
43163	Utility L1L2 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Utility L1L2 voltage phase angle	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43176	Utility L2 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Utility L2 power factor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: S			
43177	Utility L2L3 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Utility L2L3 voltage phase angle	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43190	Utility L3 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Utility L3 power factor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: S			
43191	Utility L3L1 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Utility L3L1 voltage phase angle	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43194	Utility Total kVAh	Read Only	Multiplier: 1	Unit: kVAh	Utility total kVAh accumulation	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
43195	Utility Total kVAh	Read Only	Multiplier: 1	Unit: kVAh	Utility total kVAh accumulation	PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 32	Upper Limit:		
			Sign: U			
43200	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064 – 2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43201	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43202	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43203	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
43204	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43205	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43206	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43207	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43208	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 168	Upper Limit:		
			Sign: C			
43209	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying the model of this generator set. Modbus uses addresses 43200 – 43219 for the 20 characters of this string. Uses logical numbers 2064 – 2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43210	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43211	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43212	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
43213	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43214	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43215	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43216	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43217	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 168	Upper Limit:		
			Sign: C			
43218	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43219	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying the model of this generator set. Modbus uses addresses 43200–43219 for the 20 characters of this string. Uses logical numbers 2064–2083 to hold each of the 20 characters.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43220	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43221	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
43222	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048 – 6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43223	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048 – 6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43224	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43225	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
43226	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43227	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43228	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43229	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
43230	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43231	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43232	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43233	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
43234	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43235	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43236	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43237	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
43238	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43239	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220–43239 for the 20 characters of this string. Uses logical addresses 2048–6063 to store the first 16 characters. The last 4 are stored in 691–694.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43240	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43241	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43242	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 168	Upper Limit:		
			Sign: C			
43243	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43244	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43245	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43246	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43247	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
43248	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43249	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43250	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43251	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43252	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
43253	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43254	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43255	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43256	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43257	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
43258	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43259	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number indentifying this generator sets alternator model number. Modbus uses addresses 43240–43259 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43260	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number. Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43261	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number. Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43262	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number. Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
43263	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43264	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43265	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43266	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43267	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
43268	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43269	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43270	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43271	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43272	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
43273	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43274	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43275	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43276	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43277	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number indentifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
43278	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43279	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator sets alternator serial number.Modbus uses addresses 43260–43279 for the 20 characters text string.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43280	Coolant Level Switch	Read Only	0: Inactive		Coolant Level input software state status. Gives software Inactive/ Active state	PC 2.x, PC 3.x
			1: Active			
43281	Coolant Level/ Configurable Input #5 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #5.	PC 2.x, PC 3.x
			1: Active			
43283	Fault Reset Switch	Read Only	0: Inactive		Fault Reset input software state status. Gives software Inactive/ Active state	PC 2.x, PC 3.x
			1: Active			
43284	Fault Reset/ Configurable Input #10 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #10.	PC 2.x, PC 3.x
			1: Active			
43285	Genset CB Inhibit/Configurable Input #28 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #28.	PC 3.x
			1: Active			
43286	Genset CB Pos B/Configurable Input #26 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #26.	PC 3.x
			1: Active			

Addr.	Parameter	Access	Specifications		Description	Control
43287	Genset CB Tripped/Configurable Input #27 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #27.	PC 3.x
			1: Active			
43292	Ground Fault Switch	Read Only	0: Inactive		Ground Fault Switch function output status. Gives software Inactive/Active state	PC 2.x, PC 3.x
			1: Active			
43293	High Alt Temp Switch	Read Only	0: Inactive		High Alt Temperature Switch function output status. Gives software Inactive/Active state	PC 2.x, PC 3.x
			1: Active			
43295	Load Demand Stop/Configurable Input #31 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #31.	PC 3.x
			1: Active			
43296	Local E-stop Switch	Read Only	0: Inactive		Monitors the E-Stop switch.	PC 2.x, PC 3.x
			1: Active			
43297	Low Coolant #2 Switch	Read Only	0: Inactive		Low Coolant #2 Switch function output status. Gives software Inactive/Active state	PC 2.x, PC 3.x
			1: Active			
43298	Low Engine Temperature Switch	Read Only	0: Inactive		Low Engine Temperature Switch function output status. Gives software Inactive/Active state	PC 2.x, PC 3.x
			1: Active			
43299	Low Fuel In Day Tank Switch	Read Only	0: Inactive		Low Fuel In Day Tank Switch function output status. Gives software Inactive/Active state	PC 2.x, PC 3.x
			1: Active			
43300	Genset Bus Delta/Wye Connection	Read/Write	0: Delta		Delta or Wye for Utility connection	PC 3.x
			1: Wye			
43301	Genset Bus Nominal Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Bus nominal voltage	PC 3.x
			Offset: 0	Lower Limit: 110		
			Size (bits): 16	Upper Limit: 45000		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
43302	Genset Delta/Wye Connection	Read Only	0: Delta		Delta or Wye for Generator set connection	PC 2.x, PC 3.x
			1: Wye			
43303	Genset Nominal Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set nominal line-line voltage	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 110		
			Size (bits): 16	Upper Limit: 45000		
			Sign: U			
43304	Single/3 Phase Connection	Read Only	0: Single Phase		Setup mode interlocked. Generator set's single phase/3 phase metering setup configuration.	PC 2.x, PC 3.x
			1: Three Phase			
43306	Utility Delta/Wye Connection	Read/Write	0: Delta		Delta or Wye for Utility connection	PC 3.x
			1: Wye			
43307	Utility Nominal Voltage	Read Only	Multiplier: 1	Unit: Vac	Utility nominal voltage	PC 3.x
			Offset: 0	Lower Limit: 110		
			Size (bits): 16	Upper Limit: 45000		
			Sign: U			
43309	Overfrequency Enable	Read/Write	0: Disabled		Enables over frequency diagnostic witness test.	PC 2.x, PC 3.x
			1: Enabled			
43310	Overload Warning Set Time	Read/Write	Multiplier: 1	Unit: seconds	The time delay until an overload condition is reported as a fault	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 120		
			Sign: U			
43311	Overload Warning Threshold	Read/Write	Multiplier: 0.01	Unit: %	Sets the Overload Warning fault trip threshold as percentage of generator set application kW rating.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 80		
			Size (bits): 16	Upper Limit: 140		
			Sign: U			
43338	CAN Failure Retries	Read/Write	Multiplier: 1	Unit:	Sets the maximum number of CAN communication retries	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 10		
			Sign: U			

Addr.	Parameter	Access	Specifications	Description	Control	
43339	Auto Sleep Enable	Read/Write	0: Awake in Auto	Trim that determines if the control will stay awake in Auto mode or Fall asleep in Auto mode.	PC 2.x, PC 3.x	
			1: Sleep in Auto			
43340	Max Setup Mode Time	Read/Write	Multiplier: 1	Unit: Seconds	Max time allowed in Setup Mode.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 30		
			Size (bits): 16	Upper Limit: 3600		
			Sign: U			
43341	Power Down Mode Enable	Read/Write	0: Disable	Trim to enable Sleep Mode	PC 2.x, PC 3.x	
			1: Enable			
43342	Power Down Mode Time Delay	Read/Write	Multiplier: 1	Unit: seconds	Timer setting for the Power Down delay feature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 600		
			Sign: U			
43343	Setup Mode Enable	Read/Write	0: Disable	Volatile to allow entry into Setup Mode	PC 2.x, PC 3.x	
			1: Enable			
43344	Clock Date	Read/Write	Multiplier: 1	Unit:	Use to set or read the current date.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 31		
			Sign: U			
43345	Clock Hour	Read/Write	Multiplier: 1	Unit:	Use to set or read the current hour.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 23		
			Sign: U			
43346	Clock Minute	Read/Write	Multiplier: 1	Unit:	Use to set or read the current minute.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 59		
			Sign: U			
43347	Clock Mode	Read/Write	0: Normal	Use to set the real time clock and save settings.	PC 2.x, PC 3.x	
			1: Set Clock			
			2: Save Clock			
43348	Clock Month	Read/Write	Multiplier: 1	Unit:	Use to set or read the current month.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 12		
			Sign: U			
43349	Clock Second	Read/Write	Multiplier: 1	Unit:	Use to set or read the current second.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 59		
			Sign: U			
43350	Clock Year	Read/Write	Multiplier: 1	Unit:	Use to set or read the current year.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 99		
			Sign: U			
43351	Daylight Savings End Hour	Read/Write	Multiplier: 1	Unit:	Use to set the hour of the day when daylight savings time ends.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 2		
			Size (bits): 8	Upper Limit: 19		
			Sign: U			
43352	Daylight Savings End Month	Read/Write	Multiplier: 1	Unit:	Use to set the month when daylight savings time ends.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 12		
			Sign: U			
43353	Daylight Savings End Week Occurrence in Month	Read/Write	0: First Occurrence		Use to set the week of the month when daylight savings time ends.	PC 2.x, PC 3.x
			1: Second Occurrence			
			2: Third Occurrence			
			3: Fourth Occurrence			
			4: Last Occurrence			
43354	Daylight Savings Start Day	Read/Write	0: Sunday		Use to set the day of the week when daylight savings time starts.	PC 2.x, PC 3.x
			1: Monday			
			2: Tuesday			
			3: Wednesday			
			4: Thursday			
			5: Friday			
			6: Saturday			
43355	Daylight Savings Start Hour	Read/Write	Multiplier: 1	Unit:	Use to set the hour of the day when daylight savings time starts.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 2		
			Size (bits): 8	Upper Limit: 19		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: U			
43356	Daylight Savings Start Month	Read/Write	Multiplier: 1	Unit:	Use to set the month when daylight savings time starts.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 12		
			Sign: U			
43357	Daylight Savings Start Week Occurrence in Month	Read/Write	0: First Occurrence		Use to set the week of the month when daylight savings time starts.	PC 2.x, PC 3.x
			1: Second Occurrence			
			2: Third Occurrence			
			3: Fourth Occurrence			
			4: Last Occurrence			
43358	Daylight Savings Time Adjustment	Read/Write	Multiplier: 1	Unit: Minutes	Use to set the amount of daylight savings time adjustment applied.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 120		
			Sign: U			
43359	Daylight Savings Time Enable	Read/Write	0: Disabled		Use to enable the daylight savings time feature.	PC 2.x, PC 3.x
			1: Enabled			
43360	Exercise Scheduler Enable	Read/Write	0: Disabled		Enables the exercise scheduler.	PC 2.x, PC 3.x
			1: Enabled			
43361	Reset Fuel Consumption	Read/Write	0: Inactive		The reset trip fuel consumption command.	PC 2.x, PC 3.x
			1: Active			
43362	Reset Runs	Read/Write	0: Inactive		The reset runs command.	PC 2.x, PC 3.x
			1: Active			
43363	Reset Start Attempts	Read/Write	0: Inactive		The reset start attempts command.	PC 2.x, PC 3.x
			1: Active			
43364	Scheduler Exception Select	Read/Write	Multiplier: 1	Unit:	Used to select an exception to adjust.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 6		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
43374	Scheduler Program Select	Read/Write	Multiplier: 1	Unit:	Used to select a program to adjust.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 12		
			Sign: U			
43377	Scheduler Program x Enable	Read/Write	0: Disable		Used to enable or disable the selected program.	PC 2.x, PC 3.x
			1: Enable			
43379	Scheduler Program x Run Mode	Read/Write	0: No Load		Used to adjust the run mode for the selected program.	PC 3.x
			1: With Load			
			2: Extended Parallel			
43383	Daylight Savings End Day	Read/Write	0: Sunday		Use to set the day of the week when daylight savings time ends.	PC 2.x, PC 3.x
			1: Monday			
			2: Tuesday			
			3: Wednesday			
			4: Thursday			
			5: Friday			
			6: Saturday			
43502	Idle Rated Command	Read Only	0: Idle		The output command of the Idle/Rated Logic	PC 2.x, PC 3.x
			1: Rated			
43507	Load Dump Overload Condition	Read Only	0: Inactive		Monitors the state of the load dump overload detection algorithm	PC 2.x, PC 3.x
			1: Active			
			2: Reserved			
			3: Not Available			
43508	Load Dump Underfrequency Condition	Read Only	0: Inactive		The state of the load dump underfrequency detection algorithm	PC 2.x, PC 3.x
			1: Active			
			2: Reserved			
			3: Not Available			
43509	Low Battery Voltage Running Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	The low battery voltage threshold when the generator set is in rated mode	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
43510	Low Battery Voltage Stopped Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	The low battery voltage threshold when the generator set is not in rated mode	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43511	Low Battery Voltage Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	The selection of the running or stopped threshold	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43516	Prelube Mode	Read Only	0: Crank After Prelube		Set to a required mode based on the type of starting requirement	PC 2.x, PC 3.x
			1: Crank With Prelube			
			2: Prelube Only			
43517	Prelube State	Read Only	0: Complete		The monitor point for the prelube state.	PC 2.x, PC 3.x
			1: Armed			
			2: Prelube Output ON			
			3: Prelube Output OFF			
			4: Enable Crank			
43524	Remote Start Command	Read Only	0: Stop		The output of the Remote Start Command OR logic	PC 2.x, PC 3.x
			1: Start			
43530	Speed and Voltage Bias Relay Command	Read Only	0: Inactive		Monitor point for the command which closes the on-board relay enabling the voltage and speed bias outputs.	PC 3.x
			1: Active			
43533	Start Countdown	Read Only	Multiplier: 1	Unit: seconds	Time remaining until start is initiated	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 300		
			Sign: U			
43538	Starter Command	Read Only	0: Inactive		State of hardware output.	PC 2.x, PC 3.x
			1: Active			
			2: Reserved			
			3: Not Available			

Addr.	Parameter	Access	Specifications		Description	Control
43539	Stop Count-down	Read Only	Multiplier: 1	Unit: seconds	Time remaining until generator set stops	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 5000		
			Sign: U			
43543	Time At No Load	Read Only	Multiplier: 1	Unit: seconds	Amount of time the generator set has run at no load	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 600		
			Sign: U			
43544	Time at Rated Cooldown	Read Only	Multiplier: 1	Unit: seconds	Amount of time spend in Rated Cooldown	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 5000		
			Sign: U			
43547	Voltage Set-point	Read Only	Multiplier: 0.01	Unit: %	The voltage setpoint command	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 150		
			Sign: U			
43550	Weak Battery Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	Monitor point for the weak battery voltage threshold	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 6		
			Size (bits): 16	Upper Limit: 16		
			Sign: U			
43551	Weak Battery Voltage Set Time	Read/Write	Multiplier: 1	Unit: seconds	The time delay until a weak battery condition is reported as a fault	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 1		
			Size (bits): 16	Upper Limit: 5		
			Sign: U			
43553	Synchronizer Status	Read Only	0: Synchronizer Off		Indicates whether synchronizer is on or off	PC 3.x
			1: Synchronizer On			
43554	Active Transition Timer	Read Only	Multiplier: 0.1	Unit: seconds	Countdown value of the active transition timer	PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit:		
			Sign: U			
43555	Active Transition Type	Read Only	0: None		Indicates the active transition type for PTC	PC 3.x
			1: Programmed Transition			
			2: Transfer			
			3: Retransfer			
			4: Max Parallel			
43558	ES State	Read Only	0: Standby		Internal paralleling status variable	PC 3.x
			1: Dead Bus			
			2: Synchronize			
			3: Load Share			
			4: Load Govern			
43560	Genset CB Close Command	Read Only	0: Inactive		Generator set cb close command status	PC 3.x
			1: Active			
43562	Genset CB Position Status	Read Only	0: Open		Indicates generator set breaker position	PC 3.x
			1: Closed			
			2: Not Available			
43563	Genset Availability Status	Read Only	0: Not Available		Indicates status of the generator set source	PC 3.x
			1: Available			
			2: Unknown			
43564	Bus Status	Read Only	0: Unavailable		Indicates status of the bus	PC 3.x
			1: Dead			
			2: Live			
43565	Genset CB Inhibit Command	Read Only	0: Inactive		Generator set cb inhibit command	PC 3.x
			1: Active			
43566	Genset CB Tripped Command	Read Only	0: Inactive		Generator set cb tripped command	PC 3.x
			1: Active			
43568	Genset Frequency Lower Drop-Out Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Indicates the lower drop-out threshold in Hz for generator set frequency sensor	PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit:		
			Sign: U			
43569	Genset Frequency Lower Pick-Up Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Indicates the lower pick-up threshold in Hz for generator set frequency sensor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43570	Genset Frequency Sensor Status	Read Only	0: Unknown		Indicates generator set frequency sensor status	PC 3.x
			1: Picked Up			
			2: Dropped Out			
43571	Genset Frequency Upper Drop-Out Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Indicates the upper drop-out threshold in Hz for generator set frequency sensor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43572	Genset Frequency Upper Pick-Up Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Indicates the upper pick-up threshold in Hz for generator set frequency sensor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43573	Genset Loss of Phase Sensor Status	Read Only	0: Unknown		Indicates generator set loss of phase sensor status	PC 3.x
			1: Picked Up			
			2: Dropped Out			
43574	Genset Over-voltage Drop-Out Threshold	Read Only	Multiplier: 1	Unit: Vac	Indicates the drop-out threshold in volts for generator set over voltage sensor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
43575	Genset Over-voltage Pick-Up Threshold	Read Only	Multiplier: 1	Unit: Vac	Indicates the pick-up threshold in volts for generator set over voltage sensor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43576	Genset Over-voltage Sensor Status	Read Only	0: Unknown		Indicates generator set over voltage sensor status	PC 3.x
			1: Picked Up			
			2: Dropped Out			
43577	Genset Phase Rotation Sensor Status	Read Only	0: Unknown		Indicates generator set phase rotation sensor status	PC 3.x
			1: Picked Up			
			2: Dropped Out			
43578	Genset Under-voltage Drop-Out Threshold	Read Only	Multiplier: 1	Unit: Vac	Indicates the drop-out threshold in volts for generator set under voltage sensor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43579	Genset Under-voltage Pick-Up Threshold	Read Only	Multiplier: 1	Unit: Vac	Indicates the pick-up threshold in volts for generator set under voltage sensor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43580	Genset Under-voltage Sensor Status	Read Only	0: Unknown		Indicates generator set under voltage sensor status	PC 3.x
			1: Picked Up			
			2: Dropped Out			
43584	Paralleling Speed Control Mode	Read Only	0: Isochronous		Indicates which speed control algorithm is in effect	PC 2.x, PC 3.x
			1: Droop			
			2: Synchronize			
			3: Load Share			
			4: Load Govern			

Addr.	Parameter	Access	Specifications	Description	Control	
43585	Paralleling Voltage Control Mode	Read Only	0: Isochronous	Indicates which voltage control algorithm is in effect	PC 2.x, PC 3.x	
			1: Droop			
			2: Synchronize			
			3: Load Share			
			4: Load Govern			
43589	PTC Operating Transition Type	Read Only	0: Open Transition	Indicates the transition type currently in effect	PC 3.x	
			1: Hard Closed Transition			
			2: Soft Closed Transition			
43590	PTC State	Read Only	0: PTC Not Enabled	Indicates the connected state of the Power Transfer Control	PC 3.x	
			1: No Source Connected			
			2: Utility Connected			
			3: Genset Connected			
			4: Paralleled			
43597	Utility CB Close Command	Read Only	0: Inactive	Utility cb close command status	PC 3.x	
			1: Active			
43598	Utility CB Open Command	Read Only	0: Inactive	Utility cb open command status	PC 3.x	
			1: Active			
43599	Utility CB Position Status	Read Only	0: Open	Indicates utility breaker position	PC 3.x	
			1: Closed			
			2: Not Available			
43600	Load Govern kW Method	Read/Write	0: Genset kW	Use to select how generator set kW output will be controlled when paralleled to utility.	PC 3.x	
			1: Genset kW w/Utility Constraint			
			2: Utility kW			
43608	Configurable Output #1 Event Code	Read/Write	Multiplier: 1	Unit:	The event code for this output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43610	Configurable Output #2 Event Code	Read/Write	Multiplier: 1	Unit:	The event code for this output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43613	Configurable Output #20 Event Code	Read/Write	Multiplier: 1	Unit:	The event code for this output.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43616	Configurable Output #21 Event Code	Read/Write	Multiplier: 1	Unit:	The event code for this output.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43619	Configurable Output #22 Event Code	Read/Write	Multiplier: 1	Unit:	The event code for this output.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43622	Configurable Output #3 Event Code	Read/Write	Multiplier: 1	Unit:	The event code for this output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43625	Configurable Output #4 Event Code	Read/Write	Multiplier: 1	Unit:	The event code for this output.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43641	Delayed Shut-down Enable	Read/Write	0: Disabled		Enables the Delayed Shutdown feature.	PC 2.x, PC 3.x
			1: Enabled			
43642	Delayed Shut-down Time Delay	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the shutdown fault delayed time delay for the Delayed Shut-down feature.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit: 3		
			Sign: U			
43643	Remote Fault Reset Enabled	Read/Write	0: Disable		Trim to enable Remote Fault Reset. Can only reset Warning Faults	PC 2.x, PC 3.x
			1: Enable			
43644	Fail To Shutdown Delay	Read/Write	Multiplier: 1	Unit: seconds	Trim to set the time for a shutdown fault to be active and the generator set not shutting down before the Fail to Shutdown fault occurs.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
43645	LCL Detection Response	Read/Write	0: None		Sets low coolant level fault response to None, Warning, or Shutdown.	PC 2.x, PC 3.x
			1: Warning			
			2: Shutdown			
43646	LCT Warning Clear Time	Read/Write	Multiplier: 1	Unit: Minutes	Sets time to clear the low coolant temperature fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 30		
			Sign: U			
43647	LCT Warning Set Time	Read/Write	Multiplier: 1	Unit: Minutes	Sets time to set the low coolant temperature fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 30		
			Sign: U			
43648	LCT Warning Threshold	Read/Write	Multiplier: 1	Unit: degF	Sets threshold for the low coolant temperature fault warning.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -20		
			Size (bits): 16	Upper Limit: 100		
			Sign: S			
43649	V/Hz Knee Frequency	Read/Write	Multiplier: 0.1	Unit: Hz	The voltage will roll off (decrease) proportionally to the V/Hz setup, once the frequency drops below the set point in the V/Hz Knee Frequency. This allows the generator set to recover faster when the frequency drops.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43650	V/Hz Rolloff Slope	Read/Write	Multiplier: 0.1	Unit: % / Hz	The amount of voltage roll off when the frequency is below the knee frequency	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43651	12 V High Battery Voltage Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	Sets 12V high battery voltage fault threshold.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 14		
			Size (bits): 16	Upper Limit: 17		
			Sign: U			
43652	12 V Low Battery Voltage Running Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	Sets 12V low battery voltage fault threshold for generator set operation while in rated mode	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 12		
			Size (bits): 16	Upper Limit: 16		
			Sign: U			
43653	12 V Low Battery Voltage Stopped Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	Sets 12V low battery voltage fault threshold for generator set operation in all modes except rated	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 11		
			Size (bits): 16	Upper Limit: 13		
			Sign: U			
43654	12 V Weak Battery Voltage Threshold	Read/Write	Multiplier: 0.1	Unit: Vdc	Sets 12V weak battery voltage fault threshold	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 6		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43655	24 V High Battery Voltage Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	Sets 24V high battery voltage fault threshold	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 28		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit: 34		
			Sign: U			
43656	24 V Low Battery Voltage Running Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	Sets 24V low battery voltage fault threshold for generator set operation while in rated mode	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 24		
			Size (bits): 16	Upper Limit: 28		
			Sign: U			
43657	24 V Low Battery Voltage Stopped Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	Sets 24V low battery voltage fault threshold for generator set operation in all modes except rated	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 22		
			Size (bits): 16	Upper Limit: 26		
			Sign: U			
43658	24 V Weak Battery Voltage Threshold	Read/Write	Multiplier: 0.1	Unit: Vdc	Sets 24V weak battery voltage fault threshold	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 12		
			Size (bits): 16	Upper Limit: 16		
			Sign: U			
43659	Adjustable Freq/Speed Gain	Read/Write	Multiplier: 0.01	Unit: RPM/Hz	Sets the RPM/Hz conversion factor when the Freq to Speed Gain Select trim is set to this trim	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 240		
			Sign: U			
43660	Alternate Frequency Switch	Read Only	0: 50 Hz		Sets the generator set nominal frequency.	PC 2.x, PC 3.x
			1: 60 Hz			
43661	AVR Gain Adjust Trim	Read/Write	Multiplier: 0.01	Unit:	A trim that allows the user to modify the overall gains of the AVR.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0.05		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
43662	Charging Alternator Fault Time Delay	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the time delay for the charging alt failure fault	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 2		
			Size (bits): 16	Upper Limit: 300		
			Sign: U			
43663	Continuous Crank Engage Time	Read/Write	Multiplier: 1	Unit: seconds	Sets the maximum amount of time to engage the starter when using the continuous cranking method	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 40		
			Size (bits): 16	Upper Limit: 100		
			Sign: U			
43664	Controlled Shutdown Advance Notice Delay	Read/Write	Multiplier: 1	Unit: seconds	Delay allowed for a shutdown with cooldown fault prior to shutting down the generator set	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 300		
			Sign: U			
43665	Crank Attempts	Read/Write	Multiplier: 1	Unit:	Sets the maximum number of times to engage the starter when attempting to start engine using the cycle cranking method	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 1		
			Size (bits): 16	Upper Limit: 7		
			Sign: U			
43666	Cycle / Cont Crank Select	Read Only	0: Cycle		Selects whether to use continuous cranking or cycle cranking when attempting to start engine	PC 2.x, PC 3.x
			1: Continuous			
43667	Cycle Crank Engage Time	Read/Write	Multiplier: 1	Unit: seconds	Sets the maximum amount of time to engage the starter during a single crank attempt when using the cycle cranking method	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 2		
			Size (bits): 16	Upper Limit: 20		
			Sign: U			
43668	Cycle Crank Rest Time	Read/Write	Multiplier: 1	Unit: seconds	Sets the amount of time to wait between crank attempts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 7		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit: 40		
			Sign: U			
43669	Delayed Off FSO Relay Time	Read/Write	Multiplier: 0.1	Unit: seconds	Time delay between when the Delayed Off Command turns off and Run Command turns off	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 120		
			Sign: U			
43671	External Bias Commands Enable	Read/Write	0: Disabled		Enables the external bias (speed and voltage commands) to the hardware outputs.	PC 3.x
			1: Enabled			
43672	Frequency Adjust	Read/Write	Multiplier: 0.01	Unit: Hz	A method of adding in a frequency offset to the base frequency subject to high and low limit calibrations	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -6		
			Size (bits): 16	Upper Limit: 6		
			Sign: S			
43673	Genset Exercise Time	Read/Write	Multiplier: 0.1	Unit: hours	Sets the total exercise time not including warmup at idle or idle cooldown time	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 25		
			Sign: U			
43674	Governor Gain Adjust	Read Only	Multiplier: 0.01	Unit:	A trim that allows the user to modify the overall gain of the governor	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0.05		
			Size (bits): 16	Upper Limit: 15		
			Sign: U			
43675	High Battery Voltage Set Time	Read Only	Multiplier: 1	Unit: seconds	The time delay until a high battery voltage condition is reported as a fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 2		
			Size (bits): 16	Upper Limit: 60		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
43676	High Battery Voltage Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	The high battery voltage threshold	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43677	Idle Cooldown Time	Read/Write	Multiplier: 0.25	Unit: minutes	Sets time to run at idle before shutting down generator set on normal stops	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 60		
			Sign: U			
43678	Idle Speed	Read Only	Multiplier: 1	Unit: RPM	Sets the speed at which the engine will idle subject to high and low limit calibrations	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 700		
			Size (bits): 16	Upper Limit: 1100		
			Sign: U			
43679	Idle to Rated Ramp Time	Read/Write	Multiplier: 0.1	Unit: seconds	The time over which the speed reference is to ramp from idle speed to rated speed	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
43680	Idle Warmup Coolant Temp	Read/Write	Multiplier: 1	Unit: degF	Coolant temperature threshold to end idle warmup time	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 300		
			Sign: S			
43681	Idle Warmup Time	Read/Write	Multiplier: 1	Unit: seconds	Sets maximum idle warmup time. Warmup time may be less if coolant temperature exceeds threshold	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 3600		
			Sign: U			
43682	Load Dump Activation Method	Read/Write	0: Overload		Enables the load dump output as a function of the overload and underfrequency conditions	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			1: Underfrequency			
			2: Overload or Underfrequency			
			3: Disabled			
43683	Load Dump Overload Set Time	Read/Write	Multiplier: 1	Unit: seconds	The time delay until the load dump overload condition is set active	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 120		
			Sign: U			
43684	Load Dump Overload Threshold	Read/Write	Multiplier: 1	Unit: %	The load dump overload threshold as a percentage of the generator set application rating	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 80		
			Size (bits): 16	Upper Limit: 140		
			Sign: U			
43685	Load Dump Underfrequency Offset	Read/Write	Multiplier: 1	Unit: Hz	The frequency amount which the load dump underfrequency threshold is below the final frequency reference	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: S			
43686	Load Dump Underfrequency Set Time	Read/Write	Multiplier: 1	Unit: seconds	The time delay until the load dump underfrequency condition is set active	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 20		
			Sign: U			
43687	Load Dump Underfrequency Threshold	Read Only	Multiplier: 0.1	Unit: Hz	The frequency trip threshold for the load dump underfrequency condition	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 90		
			Sign: U			
43688	Low Battery Voltage Set Time	Read Only	Multiplier: 1	Unit: seconds	The time delay until a low battery voltage condition is reported as a fault	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 2		
			Size (bits): 16	Upper Limit: 60		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: U			
43689	Low Fuel in Day Tank Time	Read/Write	Multiplier: 1	Unit: seconds	Low Fuel in Day Tank Fault time delay from switch input.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 20		
			Sign: U			
43690	Low Fuel Set/Clear Time	Read/Write	Multiplier: 1	Unit: seconds	A trim that sets the delay time for generating the inactive and active faults.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 2		
			Size (bits): 16	Upper Limit: 60		
			Sign: U			
43691	Manual Warmup Bypass	Read/Write	0: Normal		Use to command idle speed or to bypass idle warmup during a manual run	PC 2.x, PC 3.x
			1: Bypass Warmup			
43692	Max Idle Time	Read/Write	Multiplier: 0.1	Unit: minutes	Sets the fault time for the Too Long in Idle fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 20		
			Sign: U			
43693	Nominal Battery Voltage	Read Only	0: 12V		Selects the generator set's nominal battery operating voltage	PC 2.x, PC 3.x
			1: 24V			
43694	Prelube Cycle Enable	Read/Write	0: Disabled		Enables Or Disables the cyclic mode of prelube operation	PC 2.x, PC 3.x
			1: Enabled			
43695	Prelube Cycle Time	Read/Write	Multiplier: 0.1	Unit: hours	Sets the period of the Prelube Cycle Iteration	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 1		
			Size (bits): 16	Upper Limit: 1000		
			Sign: U			
43696	Prelube Function Enable	Read/Write	0: Disabled		Selects whether the Prelube function is enabled or disabled. This is Setup mode interlocked	PC 2.x, PC 3.x
			1: Enabled			
43697	Prelube Oil Pressure Threshold	Read/Write	Multiplier: 0.1	Unit: psig	The oil pressure value which when reached the prelube driver will turn off	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43698	Prelube Time-out Period	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the maximum time for which the Prelube Driver will Remain ON	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
43699	Rated to Idle Ramp Time	Read/Write	Multiplier: 0.1	Unit: seconds	The time over which the speed reference is to ramp from rated speed to idle speed	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
43700	Utility Availability Status	Read Only	0: Not Available		Indicates status of the utility source	PC 3.x
			1: Available			
			2: Unknown			
43701	Utility CB Inhibit Command	Read Only	0: Inactive		Utility cb inhibit command	PC 3.x
			1: Active			
43702	Utility CB Tripped Command	Read Only	0: Inactive		Utility cb tripped command	PC 3.x
			1: Active			
43703	Utility Current Based Breaker Position	Read Only	0: Unknown		Indicates utility breaker position based on current	PC 3.x
			1: Closed			
43704	Utility Frequency Lower Drop-Out Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Indicates the lower drop-out threshold in Hz for utility frequency sensor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43705	Utility Frequency Lower Pick-Up Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Indicates the lower pick-up threshold in Hz for utility frequency sensor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: U			
43706	Utility Frequency Sensor Status	Read Only	0: Unknown		Indicates utility frequency sensor status	PC 3.x
			1: Picked Up			
			2: Dropped Out			
43707	Utility Frequency Upper Drop-Out Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Indicates the upper drop-out threshold in Hz for utility frequency sensor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43708	Utility Frequency Upper Pick-Up Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Indicates the upper pick-up threshold in Hz for utility frequency sensor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43709	Utility Loss of Phase Sensor Status	Read Only	0: Unknown		Indicates utility loss of phase sensor status	PC 3.x
			1: Picked Up			
			2: Dropped Out			
43710	Utility Overvoltage Drop-Out Threshold	Read Only	Multiplier: 1	Unit: Vac	Indicates the drop-out threshold in volts for utility over voltage sensor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43711	Utility Overvoltage Pick-Up Threshold	Read Only	Multiplier: 1	Unit: Vac	Indicates the pick-up threshold in volts for utility over voltage sensor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43712	Utility Overvoltage Sensor Status	Read Only	0: Unknown		Indicates utility over voltage sensor status	PC 3.x
			1: Picked Up			
			2: Dropped Out			

Addr.	Parameter	Access	Specifications		Description	Control
43713	Utility Phase Rotation Sensor Status	Read Only	0: Unknown		Indicates utility phase rotation sensor status	PC 3.x
			1: Picked Up			
			2: Dropped Out			
43714	Utility Undervoltage Drop-Out Threshold	Read Only	Multiplier: 1	Unit: Vac	Indicates the drop-out threshold in volts for utility under voltage sensor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43715	Utility Undervoltage Pick-Up Threshold	Read Only	Multiplier: 1	Unit: Vac	Indicates the pick-up threshold in volts for utility under voltage sensor	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43716	Utility Undervoltage Sensor Status	Read Only	0: Unknown		Indicates utility under voltage sensor status	PC 3.x
			1: Picked Up			
			2: Dropped Out			
43719	Alternator Temperature 1 (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Alternator Temperature 1 input from the Aux 101 I/O module.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -32767		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43720	Alternator Temperature 2 (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Alternator Temperature 2 input from the Aux 101 I/O module.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -32767		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43721	Alternator Temperature 3 (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Alternator Temperature 3 input from the Aux 101 I/O module.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -32767		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43722	Ambient Temperature (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Ambient Temperature input from the Aux 101 I/O module.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -32767		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43723	Aux101 0 Analog Input 1 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 0 analog input 1 in volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -500		
			Size (bits): 16	Upper Limit: 500		
			Sign: S			
43724	Aux101 0 Analog Input 2 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 0 analog input 2 in volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -500		
			Size (bits): 16	Upper Limit: 500		
			Sign: S			
43725	Aux101 0 Analog Input 3 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 0 analog input 3 in volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43726	Aux101 0 Analog Input 4 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 0 analog input 4 in volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43727	Aux101 0 Analog Input 5 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 0 analog input 5 in volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: S			
43728	Aux101 0 Analog Input 6 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 0 analog input 6 in volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43729	Aux101 0 Analog Input 7 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 0 analog input 7 in volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43730	Aux101 0 Analog Input 8 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 0 analog input 8 in volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43731	Aux101 1 Analog Input 1 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 1 analog input 1 in volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -500		
			Size (bits): 16	Upper Limit: 500		
			Sign: S			
43732	Aux101 1 Analog Input 2 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 1 analog input 2 in volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -500		
			Size (bits): 16	Upper Limit: 500		
			Sign: S			
43733	Aux101 1 Analog Input 3 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 1 analog input 3 in volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

Addr.	Parameter	Access	Specifications		Description	Control
43734	Aux101 1 Analog Input 4 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 1 analog input 4 in volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43735	Aux101 1 Analog Input 5 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 1 analog input 5 in volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43736	Aux101 1 Analog Input 6 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 1 analog input 6 in volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43737	Aux101 1 Analog Input 7 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 1 analog input 7 in volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43738	Aux101 1 Analog Input 8 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 1 analog input 8 in volts	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43739	Battery Charger AC Failure (HMI113)	Read Only	0: Inactive		Monitor point for the battery charger failure input from the PCCNET annunciator.	PC 2.x, PC 3.x
			1: Active			
43740	Drive End Bearing Temperature (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Drive End Bearing Temperature input from the I/O module.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -32767		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43741	Exhaust Stack Temperature 1 (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Exhaust Stack Temperature1 input from the I/O module.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -32767		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43742	Exhaust Stack Temperature 2 (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Exhaust Stack Temperature2 input from the I/O module.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43745	Fuel Level % (PCCnet)	Read Only	Multiplier: 0.1	Unit: %	Monitor point for the % fuel level input from the I/O module.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43746	Fuel Level (PCCnet)	Read Only	Multiplier: 1	Unit:	Monitor point for the fuel level (in gallons) input from the I/O module.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43747	HMI113 Fault 1 Status	Read Only	0: Inactive		Monitor point for input #1 from the annunciator.	PC 2.x, PC 3.x
			1: Active			
43748	HMI113 Fault 2 Status	Read Only	0: Inactive		Monitor point for input #2 from the annunciator.	PC 2.x, PC 3.x
			1: Active			
43749	HMI113 Fault 3 Status	Read Only	0: Inactive		Monitor point for the input #3 from the annunciator.	PC 2.x, PC 3.x
			1: Active			
43750	Intake Manifold Temperature 1 (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Intake Manifold Temperature 1 input from the I/O module.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43751	Low Coolant Level (HMI113)	Read Only	0: Inactive		Monitor point for the Low Coolant Level input from the PCCnet annunciator.	PC 2.x, PC 3.x
			1: Active			
43752	Low Fuel Level (HMI113)	Read Only	0: Inactive		Monitor point for the Low Fuel Level input from the PCCnet annunciator.	PC 2.x, PC 3.x
			1: Active			
43755	Non-Drive End Bearing Temperature (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Non-Drive End Bearing Temperature input from the I/O module.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -65534		
			Size (bits): 16	Upper Limit: 65535		
			Sign: S			
43756	Number of Connected Bargraph Modules	Read Only	Multiplier: 1	Unit:	Used to monitor the amount of connected bargraph modules.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 255		
			Sign: U			
43757	Oil Temperature (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Oil Temperature input from the I/O Module.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -65534		
			Size (bits): 16	Upper Limit: 65535		
			Sign: S			
43758	Modbus Bus Message Count	Read Only	Multiplier: 1	Unit:	Modbus bus message count	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43759	Modbus CRC Errors Count	Read Only	Multiplier: 1	Unit:	Modbus CRC errors count	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit:		
			Sign: U			
43760	Modbus Exception Count	Read Only	Multiplier: 1	Unit:	Modbus exception count	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43761	Modbus No Response Count	Read Only	Multiplier: 1	Unit:	Modbus no response count	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43762	Modbus Slave Message Count	Read Only	Multiplier: 1	Unit:	Modbus slave message count	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43763	Frequency Match Error	Read Only	Multiplier: 0.001	Unit: Hz	frequency match error value used by frequency match PI loop	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43767	Load Govern kVAR Target	Read Only	Multiplier: 0.01	Unit: %	Indicates the final target setpoint for generator set kVAR output when paralleled to utility	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43769	Load Govern kW Target	Read Only	Multiplier: 0.01	Unit: %	Indicates the final target setpoint for generator set kW output when paralleled to utility	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43770	Permissive Close Allowed	Read Only	0: Not Allowed		Indicates when permissive sync check conditions have been met	PC 3.x
			1: Allowed			

Addr.	Parameter	Access	Specifications		Description	Control
43773	Phase Match Error	Read Only	Multiplier: 0.01	Unit: deg	Phase error signal for the synchronizer control algorithm	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43777	Start Type/Configurable Input #11 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #11.	PC 2.x, PC 3.x
			1: Active			
43778	Scheduler Run Command	Read Only	0: Off		Indicates the current run command coming from the scheduler.	PC 2.x, PC 3.x
			1: No Load			
			2: With Load			
			3: Extended Parallel			
43785	Start Attempts Since Reset	Read Only	Multiplier: 1	Unit:	Number of start attempts since the last reset.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967290		
			Sign: U			
43786	Start Attempts Since Reset	Read Only	Multiplier: 1	Unit:	Number of start attempts since the last reset.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967290		
			Sign: U			
43787	Total Start Attempts	Read Only	Multiplier: 1	Unit:	Total number of start attempts.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967295		
			Sign: U			
43788	Total Start Attempts	Read Only	Multiplier: 1	Unit:	Total number of start attempts.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967295		
			Sign: U			
43789	Backup Start Disconnect/Configurable Input #33 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #33.	PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			1: Active			
43791	Battery Charger Failed Switch	Read Only	0: Inactive		Battery Charger Failed Switch function output status; gives software Inactive/Active state	PC 2.x, PC 3.x
			1: Active			
43792	Battle Short Switch	Read Only	0: Inactive		Battle Short Switch function output status (Active or Inactive).	PC 2.x, PC 3.x
			1: Active			
43793	Configurable Input #1 Switch	Read Only	0: Inactive		Configurable Input #1 input software state status. Gives software Inactive/Active state	PC 2.x, PC 3.x
			1: Active			
43794	Configurable Input #2 Switch	Read Only	0: Inactive		Configurable Input #2 input software state status. Gives software Inactive/Active state	PC 2.x, PC 3.x
			1: Active			
43795	Configurable Input #13 Switch	Read Only	0: Inactive		Configurable Input #13 input software state status. Gives software Inactive/Active state	PC 2.x, PC 3.x
			1: Active			
43796	Genset CB Open Command	Read Only	0: Inactive		generator set cb open command status	PC 3.x
			1: Active			
43800	Rated Cool-down Time	Read/Write	Multiplier: 1	Unit: seconds	Minimum time to spend at rated speed less than 10% load before normal shutdown is allowed	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 600		
			Sign: U			
43801	Rated to Idle Transition Delay	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the delay time for transitioning from Rated to Idle speed. 0 seconds = feature is disabled.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43802	Rupture Basin Time	Read/Write	Multiplier: 0.1	Unit: seconds	Rupture Basin fault time delay	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 20		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
43803	Start Time Delay	Read/Write	Multiplier: 1	Unit: seconds	Sets the time to wait from receiving a valid remote start signal until starting the generator set	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 300		
			Sign: U			
43804	Starting to Rated Ramp Time	Read/Write	Multiplier: 0.1	Unit: seconds	The time over which the speed reference is to ramp from starting speed to rated speed	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
43805	Time Delay to Stop	Read/Write	Multiplier: 1	Unit: seconds	Sets time to run at rated speed before going to cooldown at idle. Does not apply to manual runs	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 600		
			Sign: U			
43806	Voltage Adjust	Read/Write	Multiplier: 0.01	Unit: %	A trim that allows the user to add/subtract an offset to the nominal voltage when calculating the voltage setpoint	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -5		
			Size (bits): 16	Upper Limit: 5		
			Sign: S			
43807	Voltage Ramp Time	Read/Write	Multiplier: 0.01	Unit: seconds	The time period over which the voltage setpoint command should rise from 0% to the target voltage	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 5		
			Sign: U			
43808	Commit to Transfer State	Read Only	0: Not Committed		PTC – Indicates if system is committed to transferring to generator set	PC 3.x
			1: Committed			
43810	Battle Short Switch (Modbus)	Read/Write	0: Inactive		Trim to enable Battle Short via Modbus.	PC 2.x, PC 3.x
			1: Active			

Addr.	Parameter	Access	Specifications		Description	Control
43811	Exercise Switch (Modbus)	Read/Write	0: Inactive		Modbus exercise switch	PC 2.x, PC 3.x
			1: Active			
43813	Extended Parallel Switch (Modbus)	Read/Write	0: Inactive		Modbus extended parallel switch	PC 2.x, PC 3.x
			1: Active			
43814	PTC Mode Switch (Modbus)	Read/Write	0: Inactive		Modbus PTC Mode switch	PC 3.x
			1: Active			
43815	Start Type (Modbus)	Read/Write	0: Emergency		Modbus start type switch	PC 2.x, PC 3.x
			1: Non Emergency			
43818	Isolated Bus Speed Control Method	Read/Write	0: Constant		Sets the speed control method for isolated bus paralleling. Parameter is also known as Load Share Speed Droop Control Method	PC 2.x, PC 3.x
			1: Droop			
43819	Isolated Bus Voltage Control Method	Read/Write	0: Constant		Sets the voltage control method for isolated bus paralleling.	PC 2.x, PC 3.x
			1: Droop			
43820	Maximum Parallel Time (TDMP)	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the maximum time that the generator set can remain paralleled to the utility during closed transition transfers.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 1800		
			Sign: U			
43821	Programmed Transition Delay (TDPT)	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the time delay from when one source opens until the other closes during open transition transfers.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 60		
			Sign: U			
43822	Retransfer Delay (TDEN)	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the amount of time that the utility source must be available before the control will retransfer to that source.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 1800		

Addr.	Parameter	Access	Specifications	Description	Control	
			Sign: U			
43823	Synchronizer Speed Control Method	Read/Write	0: Phase Match	Sets the speed control method for synchronizing.	PC 3.x	
			1: Slip Frequency			
			2: External			
43824	Synchronizer Voltage Control Method	Read/Write	0: Voltage Match	Sets the voltage control method for synchronizing.	PC 3.x	
			1: External			
43825	Transfer Delay (TDNE)	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the amount of time that the generator set source must be available before the control will transfer to that source.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 120		
			Sign: U			
43826	Transition Type	Read/Write	0: Open Transition	Sets the load transfer transition type for use when Generator set Application Type = Power Transfer Control.	PC 3.x	
			1: Hard Closed Transition			
			2: Soft Closed Transition			
43829	Utility Parallel Speed Control Method	Read/Write	0: Load Govern	Sets the speed control method for utility paralleling.	PC 3.x	
			1: Droop			
43830	Utility Parallel Voltage Control Method	Read/Write	0: Load Govern	Sets the voltage control method for utility paralleling.	PC 3.x	
			1: Droop			
			2: Load Govern with Droop Feed Forward			
43831	Aux101 Device 0 PCCnet Failure Response Type	Read/Write	0: Critical Device Response	Selects the generator set reaction to a loss of a Device 0 I/O module as critical (Shutdown) or non-critical (Warning).	PC 2.x, PC 3.x	
			1: Non-Critical Device Response			
43832	Aux101 Device 1 PCCnet Failure Response Type	Read/Write	0: Critical Device Response	Selects the generator set reaction to a loss of a Device 1 I/O module as critical (Shutdown) or non-critical (Warning).	PC 2.x, PC 3.x	
			1: Non-Critical Device Response			

Addr.	Parameter	Access	Specifications	Description	Control	
43834	HMI113 Annunciator PCCnet Failure Response Type	Read/Write	0: Critical Device Response	Selects the generator set reaction to a loss of an annunciator as critical or non-critical. Selecting critical will cause a shutdown when the annunciator loses communication.	PC 2.x, PC 3.x	
			1: Non-Critical Device Response			
43836	HMI220 PCCnet Failure Response Type	Read/Write	0: Critical Device Response	Selects the generator set reaction to a loss of an HMI220 operator panel as critical or non-critical.. A critical response will shutdown the generator set when PCCnet communication is lost.	PC 2.x, PC 3.x	
			1: Non-Critical Device Response			
43837	HMI320 PCCnet Failure Response Type	Read/Write	0: Critical Device Response	Selects the generator set reaction to a loss of an HMI320 operator panel as critical or non-critical.. A critical response will shutdown the generator set when PCCnet communication is lost.	PC 2.x, PC 3.x	
			1: Non-Critical Device Response			
43839	PCCnet Device Failure Time Delay	Read/Write	Multiplier: 1	Unit: seconds	Selects the time allowed for arbitration to occur before a PCCnet failure fault is generated.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 250		
			Sign: U			
43840	Test With Load Enable	Read/Write	0: Disabled		Use to choose whether a test is with load or without load.	PC 3.x
			1: Enabled			
43842	Commit to Transfer Method	Read/Write	0: Utility Disconnect		PTC – sets point at which system commits to transfer to generator set	PC 3.x
			1: Genset Start			
			2: No Commit			
43843	Commit to Transfer Timeout	Read/Write	Multiplier: 1	Unit: seconds	PTC – sets time system will wait for generator set when committed to transfer	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 3200		
			Sign: U			
43844	Commit to Transfer Timer	Read Only	Multiplier: 0.05	Unit: sec	PTC – remaining time system to wait for generator set when committed to transfer	PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit:		
			Sign: U			
43845	Modbus Failure Time Delay	Read/Write	Multiplier: 1	Unit: seconds	Time delay before the control activates the Modbus failure fault after the master is sensed as no longer present.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43846	Modbus Communications Lost Response Method	Read/Write	0: Do Nothing		When set to Reset Commands will reset the Modbus control logicals to an inactive state when Modbus communications are lost	PC 2.x, PC 3.x
			1: Reset Commands			
43847	Modbus Clear Counters	Read/Write	0: Do Nothing		Resets all Modbus counters, including J14 if applicable.	PC 2.x, PC 3.x
			1: Clear Counters			
43848	Controlled Shutdown Max Ramp Unload Time	Read/Write	Multiplier: 1	Unit: seconds	maximum ramp unload time during a shutdown with cooldown	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 300		
			Sign: U			
43849	Genset kVAR Setpoint	Read/Write	Multiplier: 1	Unit: kVAR	Sets the generator set load govern kVAR base load internal operating setpoint in units of kVAR. Requires that Load Govern kVAR Setpoint Source = Internal and Load Govern kVAR Method = generator set kVAR.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 20000		
			Sign: S			
43850	Genset kVAR Setpoint Percent	Read/Write	Multiplier: 0.01	Unit: %	Sets the generator set load govern kVAR base load internal operating setpoint in % of standby kVA rating. Requires that Load Govern kVAR Setpoint Source = Internal and Load Govern kVAR Method = generator set kVAR.	PC 3.x
			Offset: 0	Lower Limit: 0		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit: 60		
			Sign: S			
43851	Genset kW Setpoint	Read/Write	Multiplier: 1	Unit: kW	Sets the generator set load govern kW base load internal operating setpoint in units of kW. Requires that Load Govern kW Setpoint Source = Internal and Load Govern kW Method = Genset kW.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 20000		
			Sign: S			
43852	Genset kW Setpoint Percent	Read/Write	Multiplier: 0.01	Unit: %	Sets the generator set load govern kW base load internal operating setpoint in % of standby rating. Requires that Load Govern kW Setpoint Source = Internal and Load Govern kW Method = Genset kW.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 100		
			Sign: S			
43853	Genset Power Factor Setpoint	Read/Write	Multiplier: 0.01	Unit: PF	Sets the load govern setpoint for generator set power factor control. Requires that Load Govern kVAR Setpoint Source = Internal and Load Govern kVAR Method = Genset Power Factor.	PC 3.x
			Offset: 0	Lower Limit: 0.7		
			Size (bits): 8	Upper Limit: 1		
			Sign: S			
43854	Load Demand Stop (Modbus)	Read/Write	0: Inactive		Modbus input for activating load demand stop on the generator set	PC 3.x
			1: Active			
43855	Load Govern kVAR Method	Read/Write	0: Genset kVAR		Use to select how generator set kVAR output will be controlled when paralleled to utility.	PC 3.x
			1: Genset Power Factor			
			2: Utility kVAR			
			3: Utility Power Factor			
43856	Load Govern kVAR Ramp Load Time	Read/Write	Multiplier: 1	Unit: seconds	Sets load govern kVAR ramp load rate = Genset Standby kVA * 0.6/ this time.	PC 3.x
			Offset: 0	Lower Limit: 0		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit: 900		
			Sign: U			
43857	Load Govern kVAR Ramp Unload Time	Read/ Write	Multiplier: 1	Unit: seconds	Sets load govern kVAR ramp un- load rate = Genset Standby KVA * 0.6/ this time.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 900		
			Sign: U			
43858	Utility Breaker Opening Point	Read/ Write	0: After Transfer Delay		PTC – point in time at which sys- tem opens utility breaker	PC 3.x
			1: Upon Utility Failure			
43859	Load Govern kW Ramp Load Time	Read/ Write	Multiplier: 1	Unit: seconds	Sets load govern kW ramp load rate = Genset Standby kW rating/ this time.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 900		
			Sign: U			
43860	Load Govern kW Ramp Un- load Time	Read/ Write	Multiplier: 1	Unit: seconds	Sets load govern kW ramp unload rate = Genset Standby kW rating/ this time.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 900		
			Sign: U			
43862	Slip Frequency	Read/ Write	Multiplier: 0.001	Unit: Hz	Sets the synchronizer slip fre- quency. Requires that Sync Speed Control Method = Slip Fre- quency.	PC 3.x
			Offset: 0	Lower Limit: -3		
			Size (bits): 16	Upper Limit: 3		
			Sign: S			
43863	Utility kVAR Setpoint	Read/ Write	Multiplier: 1	Unit: kVAR	Sets the utility kVAR peak shave internal operating setpoint in units of kVAR. Requires that Load Gov- ern kVAR Setpoint Source = Inter- nal and Load Govern kVAR Meth- od = Utility kVAR	PC 3.x
			Offset: 0	Lower Limit: -20000		
			Size (bits): 16	Upper Limit: 20000		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: S			
43864	Utility kVAR Setpoint Percent	Read/Write	Multiplier: 0.01	Unit: %	Sets the utility kVAR peak shave internal operating setpoint in % of generator set standby kVA rating. Requires that Load Govern kVAR Setpoint Source = Internal and Load Govern kVAR Method = Utility kVAR.	PC 3.x
			Offset: 0	Lower Limit: -320		
			Size (bits): 16	Upper Limit: 320		
			Sign: S			
43865	Utility kW Constraint	Read/Write	Multiplier: 1	Unit: kW	Sets the utility kW minimum load level for constrained base load mode of operation. Requires that Load Govern kW Setpoint Source = Internal and Load Govern kW Method = Genset kW w/Utility Constraint.	PC 3.x
			Offset: 0	Lower Limit: -20000		
			Size (bits): 16	Upper Limit: 20000		
			Sign: S			
43866	Utility kW Constraint Percent	Read/Write	Multiplier: 0.01	Unit: %	Sets utility kW minimum load level for constrained base load mode in % of generator set standby rating. Requires that Load Govern kW Setpoint Source = Internal and Load Govern kW Method = Genset kW w/Utility Constraint.	PC 3.x
			Offset: 0	Lower Limit: -320		
			Size (bits): 16	Upper Limit: 320		
			Sign: S			
43867	Utility kW Setpoint	Read/Write	Multiplier: 1	Unit: kW	Sets the utility kW peak shave internal operating setpoint in units of kW. Requires that Load Govern kW Setpoint Source = Internal and Load Govern kW Method = Utility kW.	PC 3.x
			Offset: 0	Lower Limit: -20000		
			Size (bits): 16	Upper Limit: 20000		
			Sign: S			

Addr.	Parameter	Access	Specifications		Description	Control
43868	Utility kW Setpoint Percent	Read/Write	Multiplier: 0.01	Unit: %	Sets the utility kW peak shave internal operating setpoint in % of generator set standby rating. Requires that Load Govern kW Setpoint Source = Internal and Load Govern kW Method = Utility kW.	PC 3.x
			Offset: 0	Lower Limit: -320		
			Size (bits): 16	Upper Limit: 320		
			Sign: S			
43869	Utility Power Factor Setpoint	Read/Write	Multiplier: 0.01	Unit: PF	Sets the internal setpoint for utility power factor control mode when paralleled to utility. Requires that Load Govern kVAR Setpoint Source = Internal and Load Govern kVAR Method = Utility Power Factor.	PC 3.x
			Offset: 0	Lower Limit: 0.7		
			Size (bits): 8	Upper Limit: 1		
			Sign: S			
43870	Aux101 0 Output 2 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43871	Aux101 0 Output 4 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43872	Aux101 0 Output 5 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43873	Aux101 0 Output 6 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43874	Aux101 0 Output 7 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43875	Aux101 1 Output 1 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43876	Aux101 1 Output 2 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43877	Aux101 1 Output 3 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43878	Aux101 1 Output 4 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43879	Aux101 1 Output 5 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
43880	Aux101 1 Output 6 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43881	Aux101 1 Output 7 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43882	Aux101 1 Output 8 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43883	Aux102 0 Output 10 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43884	Aux102 0 Output 11 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43885	Aux102 0 Output 12 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43886	Aux102 0 Output 13 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43887	Aux102 0 Output 14 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43888	Aux102 0 Output 15 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43889	Aux102 0 Output 16 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43890	Aux102 0 Output 9 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43891	Aux102 1 Output 10 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43892	Aux102 1 Output 11 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: U			
43893	Aux102 1 Output 12 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43894	Aux102 1 Output 13 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43895	Aux102 1 Output 14 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43896	Aux102 1 Output 15 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43897	Aux102 1 Output 16 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43898	Aux102 1 Output 9 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
43900	HMI113 Output 1 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43901	HMI113 Output 2 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43902	HMI113 Output 3 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43903	HMI113 Output 4 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43911	Aux101 0 Output 3 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43912	Aux101 0 Output 1 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43913	Aux101 0 Output 8 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43915	Extended Parallel Enable	Read/Write	0: Disabled		use to enable the extended paralleling mode of PTC	PC 3.x
			1: Enabled			
43916	V/Hz Knee Frequency 50Hz	Read Only	Multiplier: 0.1	Unit: Hz	The voltage will roll off (decrease) proportionally to the V/Hz setup, once the frequency drops below the set point in the V/Hz Knee Frequency. This allows the generator set to recover faster when the frequency drops. This is for 50Hz frequency.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43917	V/Hz Knee Frequency 60Hz	Read Only	Multiplier: 0.1	Unit: Hz	The voltage will roll off (decrease) proportionally to the V/Hz setup, once the frequency drops below the set point in the V/Hz Knee Frequency. This allows the generator set to recover faster when the frequency drops. This is for 60Hz frequency.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43918	V/Hz Rolloff Slope 50Hz	Read Only	Multiplier: 0.1	Unit: % / Hz	The amount of voltage roll off when the frequency is below the knee frequency	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43919	V/Hz Rolloff Slope 60Hz	Read Only	Multiplier: 0.1	Unit: % / Hz	The amount of voltage roll off when the frequency is below the knee frequency	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
43920	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43921	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43922	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43923	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43924	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43925	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43926	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43927	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43928	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43929	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43930	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43931	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43932	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43933	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43934	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 136	Upper Limit:		
			Sign: C			
43935	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43952	Speed/Frequency Delay	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the delay time for generating the Speed/Frequency mismatch fault	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0.5		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43953	Speed/Frequency Threshold	Read/Write	Multiplier: 0.1	Unit: Hz	Sets the threshold for generating the Speed/Frequency mismatch fault	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0.5		
			Size (bits): 16	Upper Limit: 20		
			Sign: U			
43955	Genset Idle Enable	Read Only	0: Disabled		Enables or Disable idling of generator set with external governor.	PC 2.x, PC 3.x
			1: Enabled			
43959	Utility Unloaded Level	Read/Write	Multiplier: 1	Unit: kW	Sets threshold at which utility source is considered as unloaded.	PC 3.x
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43960	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43961	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 168	Upper Limit:		
			Sign: C			
43962	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43963	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43964	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43965	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43966	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43967	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
43968	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43969	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43970	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43971	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43972	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43973	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43974	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43975	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43976	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43977	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43978	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43979	HMI113 Fault 1 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43980	HMI113 Fault 2 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
43981	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43982	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43983	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43984	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43985	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43986	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
43987	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43988	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43989	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43990	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43991	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43992	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43993	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43994	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43995	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43996	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43997	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43998	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43999	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
45999	Unrecognized SPN/FMI Status	Read Only	0: All Pairs Recognized		Indicates whether or not all pairs in current DM1 are recognized	PC 2.x, PC 3.x
			1: Pair Not Recognized			
46000	Genset Phase Rotation	Read Only	0: L1-L2-L3		Generator set phase rotation	PC 2.x, PC 3.x
			1: L1-L3-L2			
			2: Not Available			
46001	Utility Phase Rotation	Read Only	0: L1-L2-L3		Utility phase rotation	PC 3.x
			1: L1-L3-L2			
			2: Not Available			
46002	Genset Bus Phase Rotation	Read Only	0: L1-L2-L3		Generator set bus phase rotation	PC 3.x
			1: L1-L3-L2			
			2: Not Available			
46003	Base Speed	Read Only	Multiplier: 0.0625	Unit: RPM	Provides a point to monitor the base speed	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
46004	Base Speed	Read Only	Multiplier: 0.0625	Unit: RPM	Provides a point to monitor the base speed	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
46005	Final Speed Reference	Read Only	Multiplier: 0.0625	Unit: RPM	Provides a point to monitor the final speed reference	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
46006	Final Speed Reference	Read Only	Multiplier: 0.0625	Unit: RPM	Provides a point to monitor the final speed reference	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
46008	Exhaust Port 1 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 1 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -459		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46009	Exhaust Port 2 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 2 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46010	Exhaust Port 3 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 3 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46011	Exhaust Port 4 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 4 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46012	Exhaust Port 5 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 5 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46013	Exhaust Port 6 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 6 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46014	Exhaust Port 7 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 7 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46015	Exhaust Port 8 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 8 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: S			
46016	Exhaust Port 9 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 9 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46017	Exhaust Port 10 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 10 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46018	Exhaust Port 11 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 11 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46019	Exhaust Port 12 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 12 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46020	Exhaust Port 13 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 13 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46021	Exhaust Port 14 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 14 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46022	Exhaust Port 15 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 15 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			

Addr.	Parameter	Access	Specifications		Description	Control
46023	Exhaust Port 16 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 16 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46024	Exhaust Port 17 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 17 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46025	Exhaust Port 18 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 18 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46026	Exhaust Port 19 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 19 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46027	Exhaust Port 20 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 20 Temperature	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46028	Knock Level Cylinder 1	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 1	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46029	Knock Level Cylinder 2	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 2	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46030	Knock Level Cylinder 3	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 3	PC 3.x
			Offset: 0	Lower Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 8	Upper Limit:		
			Sign: U			
46031	Knock Level Cylinder 4	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 4	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46032	Knock Level Cylinder 5	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 5	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46033	Knock Level Cylinder 6	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 6	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46034	Knock Level Cylinder 7	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 7	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46035	Knock Level Cylinder 8	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 8	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46036	Knock Level Cylinder 9	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 9	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46037	Knock Level Cylinder 10	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 10	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46038	Knock Level Cylinder 11	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 11	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
46039	Knock Level Cylinder 12	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 12	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46040	Knock Level Cylinder 13	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 13	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46041	Knock Level Cylinder 14	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 14	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46042	Knock Level Cylinder 15	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 15	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46043	Knock Level Cylinder 16	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 16	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46044	Knock Level Cylinder 17	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 17	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46045	Knock Level Cylinder 18	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 18	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46048	Knock Count Cyl 1	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 1	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46049	Knock Count Cyl 2	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 2	PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46050	Knock Count Cyl 3	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 3	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46051	Knock Count Cyl 4	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 4	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46052	Knock Count Cyl 5	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 5	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46053	Knock Count Cyl 6	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 6	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46054	Knock Count Cyl 7	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 7	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46055	Knock Count Cyl 8	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 8	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46056	Knock Count Cyl 9	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 9	PC 3.x
			Offset: 0	Lower Limit: 0		

Addr.	Parameter	Access	Specifications		Description	Control
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46057	Knock Count Cyl 10	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 10	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46058	Knock Count Cyl 11	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 11	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46059	Knock Count Cyl 12	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 12	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46060	Knock Count Cyl 13	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 13	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46061	Knock Count Cyl 14	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 14	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46062	Knock Count Cyl 15	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 15	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46063	Knock Count Cyl 16	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 16	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: U			
46064	Knock Count Cyl 17	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 17	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46065	Knock Count Cyl 18	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 18	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46068	Spark Timing Cyl 1	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 1	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46069	Spark Timing Cyl 2	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 2	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46070	Spark Timing Cyl 3	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 3	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46071	Spark Timing Cyl 4	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 4	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46072	Spark Timing Cyl 5	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 5	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

Addr.	Parameter	Access	Specifications		Description	Control
46073	Spark Timing Cyl 6	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 6	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46074	Spark Timing Cyl 7	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 7	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46075	Spark Timing Cyl 8	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 8	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46076	Spark Timing Cyl 9	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 9	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46077	Spark Timing Cyl 10	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 10	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46078	Spark Timing Cyl 11	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 11	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46079	Spark Timing Cyl 12	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 12	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46080	Spark Timing Cyl 13	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 13	PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46081	Spark Timing Cyl 14	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 14	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46082	Spark Timing Cyl 15	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 15	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46083	Spark Timing Cyl 16	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 16	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46084	Spark Timing Cyl 17	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 17	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46085	Spark Timing Cyl 18	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 18	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46088	Internal SSM558 1 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Temperature of the engine elec- tronic control unit SSM558 1	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46089	Internal SSM558 2 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Temperature of the engine elec- tronic control unit SSM558 2	PC 3.x

Addr.	Parameter	Access	Specifications	Description	Control	
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46090	Internal MCM700 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Temperature of the engine electronic control unit MCM700	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46091	Derate Authorization	Read Only	0: NO		Derate authorization request from customer.	PC 3.x
			1: YES			
			2: Reserved			
			3: N/A			
46093	Ventilator Fan Status	Read Only	0: OFF		Vent Fan status monitor point.	PC 3.x
			1: ON			
			2: TRIPPED			
			3: N/A			
46096	GIB Isolator Open (Aux101)	Read Only	0: Close		GIB Isolator Open monitor point.	PC 3.x
			1: Open			
			2: Reserved			
			3: N/A			
46097	Alternator Heater Status	Read Only	0: OFF		Alternator Heater status monitor point.	PC 3.x
			1: ON			
			2: TRIPPED			
			3: N/A			
46101	Start Inhibit No1 (Aux101)	Read Only	0: Inactive		Start Inhibit No1 monitor point.	PC 3.x
			1: Active			
			2: Reserved			
			3: N/A			
46102	Start Inhibit No2 (Aux101)	Read Only	0: Inactive		Start Inhibit No2 monitor point.	PC 3.x
			1: Active			
			2: Reserved			
			3: N/A			
46103	Start Inhibit No3 (Aux101)	Read Only	0: Inactive		Start Inhibit No3 monitor point.	PC 3.x

Addr.	Parameter	Access	Specifications	Description	Control	
			1: Active			
			2: Reserved			
			3: N/A			
46104	DC PSU Unavailable (Aux101)	Read Only	0: No	Engine PSU Not Available monitor point.	PC 3.x	
			1: Yes			
46105	Ventilator Fan Trip (Aux101)	Read Only	0: No	Ventilator Fan Trip monitor point.	PC 3.x	
			1: Yes			
46106	Aux101-3 Software Version	Read Only	Multiplier: 0.01	Unit:	Software version of the firmware for the Aux101-3	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46107	Aux101-4 Software Version	Read Only	Multiplier: 0.01	Unit:	Software version of the firmware for the Aux101-4	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46108	Aux101-5 Software Version	Read Only	Multiplier: 0.01	Unit:	Software version of the firmware for the Aux101-5	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46113	Downstream Valve Command Status	Read Only	0: Open	The result of the FSO driver output command logic for fuel shutoff valve 1	PC 3.x	
			1: Closed			
			2: Reserved			
			3: N/A			
46117	Engine Oil Pre-Heater Ctrl Status	Read Only	0: OFF	Engine Oil pre heater command status	PC 3.x	
			1: ON			
			2: Reserved			
			3: N/A			
46120	Engine Coolant Pump Ctrl Status	Read Only	0: OFF	Engine coolant circulating pump status	PC 3.x	
			1: ON			

Addr.	Parameter	Access	Specifications	Description	Control	
			2: Reserved			
			3: N/A			
46124	Coolant Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Coolant Pressure.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46125	Coolant 2 Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Coolant 2 Pressure.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 145		
			Sign: U			
46127	Coolant 2 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Coolant 2 Temperature	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46128	Compressor Bypass Position	Read Only	Multiplier: 0.1	Unit: %	Engine turbocharger compressor bypass actuator position	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46130	Oil Priming Pump Control Status	Read Only	0: OFF		Status for the priming pump (ON or OFF)	PC 3.x
			1: ON			
			2: Reserved			
			3: N/A			
46131	Oil Priming State	Read Only	0: Low		Status of the engine before start (Pre-Lubed or Not)	PC 3.x
			1: Optimum			
			2: Reserved			
			3: N/A			
46133	Coolant Pre-Heated State	Read Only	0: Cold		Status of the engine coolant before start (Pre-Heated or Not)	PC 3.x
			1: Heated			
			2: Reserved			
			3: N/A			
46135	Intake Manifold Pressure 1	Read Only	Multiplier: 0.1	Unit: psi	Intake Manifold Pressure 1	PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46136	Compressor Outlet Pressure	Read Only	Multiplier: 0.1	Unit: kPa	Absolute Pressure at the outlet of the compressor.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46139	Fuel Valve 1 Inlet Absolute Pressure	Read Only	Multiplier: 0.1	Unit: psi	Absolute Pressure of Gas on the inlet side of the first system control valve	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46140	Fuel Valve 1 Outlet Absolute Pressure	Read Only	Multiplier: 0.1	Unit: psi	Absolute Pressure of Gas on the outlet side of the first system control valve	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46141	Fuel Valve 1 Position	Read Only	Multiplier: 0.1	Unit: %		PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46142	Fuel Valve 2 Inlet Absolute Pressure	Read Only	Multiplier: 0.1	Unit: psi	Absolute Pressure of Gas on the inlet side of the second system control valve	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46143	Fuel Valve 2 Outlet Absolute Pressure	Read Only	Multiplier: 0.1	Unit: psi	Absolute Pressure of Gas on the outlet side of the second system control valve	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
46144	Fuel Valve 2 Position	Read Only	Multiplier: 0.1	Unit: %		PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46145	Gas Mass Flow	Read Only	Multiplier: 0.1	Unit: Pounds per hour	Gas Mass Flow value of the engine.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
46146	Gas Mass Flow	Read Only	Multiplier: 0.1	Unit: Pounds per hour	Gas Mass Flow value of the engine.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
46147	Throttle 1 Position	Read Only	Multiplier: 0.1	Unit: %	Position of the throttle 1.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46148	Throttle 2 Position	Read Only	Multiplier: 0.1	Unit: %	Position of the throttle 2.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46155	MCM700 Battery Voltage	Read Only	Multiplier: 0.1	Unit: Vdc	Engine Control Module Battery Voltage.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65535		
			Sign: U			
46161	SSM558 1 Isolated Battery Voltage	Read Only	Multiplier: 0.1	Unit: Vdc	SSM558 1 Engine Control Module Isolated Battery Voltage.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65535		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
46163	SSM558 2 Iso- lated Battery Voltage	Read Only	Multiplier: 0.1	Unit: Vdc	SSM558 2 Engine Control Mod- ule Isolated Battery Voltage.	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65535		
			Sign: U			
46164	Intake Manifold Pressure 2	Read Only	Multiplier: 0.1	Unit: psi	Intake Manifold Pressure 2	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46166	Exhaust Back Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for exhaust back pressure value	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46170	Gas Mass Flow 2	Read Only	Multiplier: 0.1	Unit: Pounds per hour	Gas Mass Flow 2 value of the en- gine.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
46171	Gas Mass Flow 2	Read Only	Multiplier: 0.1	Unit: Pounds per hour	Gas Mass Flow 2 value of the en- gine.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
46182	Radiator Fan control	Read Only	0: Inactive		Radiator fan control command	PC 3.x
			1: Active			
46183	Ventilator Fan mode	Read/ Write	0: Limited		Vent fan control mode, limited or continuous	PC 3.x
			1: Continuous			
46184	Louvre Control	Read Only	0: Inactive		Louvre control	PC 3.x
			1: Active			
46191	Ventilator Fan control	Read Only	0: Inactive		Ventilator fan control command	PC 3.x
			1: Active			

Addr.	Parameter	Access	Specifications		Description	Control
46288	DE/NDE Cylinder Viewpoint Reference	Read/Write	0: Drive End		Gives reference point for engine cylinder numbering	PC 3.x
			1: Non-Drive End			
			2: Reserved			
			3: N/A			
46289	Start System Trip (Aux 101)	Read Only	0: Not Tripped		Start system trip monitor point.	PC 3.x
			1: Tripped			
			2: Reserved			
			3: N/A			
46290	Louvres Closed (Aux 101)	Read Only	0: Open		Louvres Closed monitor point.	PC 3.x
			1: Closed			
			2: Reserved			
			3: N/A			
46291	Radiator Fan Trip (Aux 101)	Read Only	0: Not Tripped		Radiator Fan Trip monitor point.	PC 3.x
			1: Tripped			
			2: Reserved			
			3: N/A			
46300	LBNG Genset Enable	Read/Write	0: Disable		Switch to enable or disable the gas specific features and parameters	PC 3.x
			1: Enable			
46301	Aux101-3 Enable	Read/Write	0: Disable		Enable the processing for Aux101-3 messages	PC 3.x
			1: Enable			
46302	Aux101-4 Enable	Read/Write	0: Disable		Enable the processing for Aux101-4 messages	PC 3.x
			1: Enable			
46303	Aux101-5 Enable	Read/Write	0: Disable		Enable the processing for Aux101-5 messages	PC 3.x
			1: Enable			
46304	Aux101-6 Enable	Read/Write	0: Disable		Enable the processing for Aux101-6 messages	PC 3.x
			1: Enable			
46308	Aux101-3 Input Port Config	Read Only	Multiplier: 1	Unit:	Input Port configuration byte for the Aux101-3	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
46309	Aux101-4 Input Port Config	Read Only	Multiplier: 1	Unit:	Input Port configuration byte for the Aux101-4	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			
46310	Aux101-5 Input Port Config	Read Only	Multiplier: 1	Unit:	Input Port configuration byte for the Aux101-5	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			
46311	Aux101-3 DI Active High/Low Selection	Read Only	Multiplier: 1	Unit:	Digital Input Port configuration active High or active low for the Aux101-3	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			
46312	Aux101-4 DI Active High/Low Selection	Read Only	Multiplier: 1	Unit:	Digital Input Port configuration active High or active low for the Aux101-4	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			
46313	Aux101-5 DI Active High/Low Selection	Read Only	Multiplier: 1	Unit:	Digital Input Port configuration active High or active low for the Aux101-5	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			
46314	Aux101-3 DI Config Mask	Read Only	Multiplier: 1	Unit:	Discrete Input configuration bit mask for the Aux101-3	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			
46315	Aux101-4 DI Config Mask	Read Only	Multiplier: 1	Unit:	Discrete Input configuration bit mask for the Aux101-4	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: U			
46316	Aux101-5 DI Config Mask	Read Only	Multiplier: 1	Unit:	Discrete Input configuration bit mask for the Aux101-5	PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			
46323	Vehicle Electrical Power 2 PGN65165 Enable	Read/Write	0: Disabled		A trim that enables the Vehicle Electrical Power 2 message	PC 3.x
			1: Enabled			
46326	Gaseous Fuel Pressure PGN65163 Enable	Read/Write	0: Disabled		A trim that enables the Gaseous Fuel Pressure message	PC 3.x
			1: Enabled			
46327	Fuel Information 3 - Gaseous PGN64930 Enable	Read/Write	0: Disabled		A trim that enables the Fuel Information 3 - Gaseous message	PC 3.x
			1: Enabled			
46328	Fuel Information 2 - Gaseous PGN65153 Enable	Read/Write	0: Disabled		A trim that enables the Fuel Information 2 - Gaseous message	PC 3.x
			1: Enabled			
46332	Inlet/Exhaust Conditions PGN65270 Enable	Read/Write	0: Disabled		A trim that enables the Inlet/Exhaust Conditions message	PC 3.x
			1: Enabled			
46333	Knock Count 1 PGN65336 Enable	Read/Write	0: Disabled		A trim that enables Knock Count 1 message	PC 3.x
			1: Enabled			
46334	Knock Count 2 PGN65337 Enable	Read/Write	0: Disabled		A trim that enables Knock Count 2 message	PC 3.x
			1: Enabled			
46335	Knock Count 3 PGN65338 Enable	Read/Write	0: Disabled		A trim that enables Knock Count 3 message	PC 3.x
			1: Enabled			

Addr.	Parameter	Access	Specifications		Description	Control
46336	Knock Count 4 PGN65339 Enable	Read/ Write	0: Disabled		A trim that enables Knock Count 4 message	PC 3.x
			1: Enabled			
46337	Knock Count 5 PGN65340 Enable	Read/ Write	0: Disabled		A trim that enables Knock Count 5 message	PC 3.x
			1: Enabled			
46338	Ignition Timing 1 PGN65154 Enable	Read/ Write	0: Disabled		A trim that enables the Ignition Timing 1 message	PC 3.x
			1: Enabled			
46339	Ignition Timing 2 PGN65155 Enable	Read/ Write	0: Disabled		A trim that enables the Ignition Timing 2 message	PC 3.x
			1: Enabled			
46340	Ignition Timing 3 PGN65156 Enable	Read/ Write	0: Disabled		A trim that enables the Ignition Timing 3 message	PC 3.x
			1: Enabled			
46341	Ignition Timing 4 PGN65157 Enable	Read/ Write	0: Disabled		A trim that enables the Ignition Timing 4 message	PC 3.x
			1: Enabled			
46342	Ignition Timing 5 PGN65158 Enable	Read/ Write	0: Disabled		A trim that enables the Ignition Timing 5 message	PC 3.x
			1: Enabled			
46344	Start-Enable (MODBUS Input)	Read/ Write	0: Disable		Remote MODBUS Start-Enable input.	PC 3.x
			1: Enable			
46366	Modbus Stop Bits (J14)	Read/ Write	0:01		Sets the Modbus number of stop bits for this node Limited to 1 bit if parity = Odd or Even	PC 3.x
			1:02			
46367	Modbus Bus Message Count (J14)	Read Only	Multiplier: 1	Unit:	The number of Modbus messages with no response, for J14 port only	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46368	Modbus CRC Error Count (J14)	Read Only	Multiplier: 1	Unit:	The number of Modbus CRC errors, for J14 only.	PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46369	Modbus Exception Count (J14)	Read Only	Multiplier: 1	Unit:	Modbus exception count, for J14 only.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46370	Modbus No Response Count (J14)	Read Only	Multiplier: 1	Unit:	Modbus no response count, for J14 only.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46371	Modbus Slave Message Count (J14)	Read Only	Multiplier: 1	Unit:	The number of Modbus slave messages, for J14 only.	PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46372	Modbus Node Address (J14)	Read/Write	Multiplier: 1	Unit:	Sets the Modbus address for this node, for J14 only.	PC 3.x
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 247		
			Sign: U			
46373	Modbus Baud Rate (J14)	Read/Write		1.6666667	Sets the baud rate for Modbus communications, for J14 only.	PC 3.x
				3.375		
				6.75		
			3: 19200			
46374	Modbus Parity (J14)	Read/Write	0: Even		Sets the Modbus parity for this node, for J14 only.	PC 3.x
			1: Odd			
			2: None			
46376	Modbus Baud Rate	Read/Write	0: 2400 Baud		Sets the Modbus baud rate.	PC 2.x, PC 3.x
			1: 4800 Baud			
			2: 9600 Baud			
			3: 19200 Baud			

Addr.	Parameter	Access	Specifications	Description	Control	
			4: 38400 Baud			
46377	Modbus Parity	Read/Write	0: Even	Sets the Modbus parity for this node	PC 2.x, PC 3.x	
			1: Odd			
			2: None			
46378	Modbus Node Address	Read/Write	Multiplier: 1	Unit:	Sets the Modbus address for this node	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 247		
			Sign: U			
46379	Modbus Stop Bits	Read/Write	0:01		Sets the Modbus number of stop bits for this node Limited to 1 bit if parity = Odd or Even	PC 2.x, PC 3.x
			1:02			
46380	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46381	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46382	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46383	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46384	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46385	HMI113 Fault 3 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46386	HMI113 Fault 3 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46387	HMI113 Fault 3 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46388	HMI113 Fault 3 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46389	HMI113 Fault 3 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46390	HMI113 Fault 3 Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
46391	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46392	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46393	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46394	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46395	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46396	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
46397	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46398	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46399	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46600	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46601	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46602	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46603	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46604	Aux101 0 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46605	Aux101 0 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46606	Aux101 0 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46607	Aux101 0 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46608	Aux101 0 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46609	Aux101 0 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
46610	Aux101 0 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46611	Aux101 0 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46612	Aux101 0 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46613	Aux101 0 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46614	Aux101 0 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46615	Aux101 0 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
46616	Aux101 0 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46617	Aux101 0 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46618	Aux101 0 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46619	Aux101 0 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46620	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46621	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46622	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46623	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46624	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46625	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46626	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46627	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46628	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
46629	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46630	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46631	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46632	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46633	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46634	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
46635	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46636	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46637	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46638	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46639	Aux101 0 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46640	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46641	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46642	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46643	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46644	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46645	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46646	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46647	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
46648	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46649	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46650	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46651	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46652	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46653	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
46654	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46655	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46656	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46657	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46658	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46659	Aux101 1 Input 1 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46660	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46661	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46662	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46663	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46664	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46665	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46666	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
46667	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46668	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46669	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46670	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46671	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46672	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
46673	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46674	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46675	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46676	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46677	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46678	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46679	Aux101 1 Input 2 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46800	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46801	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46802	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46803	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46804	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46805	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
46806	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46807	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46808	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46809	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46810	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46811	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
46812	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46813	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46814	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46815	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46816	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46817	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46818	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46819	Aux101 0 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46820	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46821	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46822	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46823	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46824	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
46825	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46826	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46827	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46828	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46829	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46830	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
46831	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46832	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46833	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46834	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46835	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46836	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46837	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46838	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46839	Aux101 0 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46840	Aux101 0 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46841	Aux101 0 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46842	Aux101 0 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46843	Aux101 0 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
46844	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46845	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46846	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46847	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46848	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46849	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
46850	Aux101 0 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46851	Aux101 0 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46852	Aux101 0 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46853	Aux101 0 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46854	Aux101 0 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46855	Aux101 0 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46856	Aux101 0 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46857	Aux101 0 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46858	Aux101 0 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46859	Aux101 0 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46860	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46861	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46862	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
46863	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46864	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46865	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46866	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46867	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46868	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
46869	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46870	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46871	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46872	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46873	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46874	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46875	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46876	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46877	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46878	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46879	Aux101 0 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46880	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46881	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
46882	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46883	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46884	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46885	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46886	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46887	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
46888	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46889	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46890	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46891	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46892	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46893	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46894	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46895	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46896	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46897	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46898	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46899	Aux101 1 Input 3 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46900	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
46901	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46902	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46903	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46904	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46905	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46906	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
46907	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46908	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46909	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46910	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46911	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46912	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46913	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46914	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46915	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46916	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46917	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46918	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46919	Aux101 1 Input 4 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
46920	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46921	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46922	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46923	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46924	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46925	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
46926	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46927	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46928	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46929	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46930	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46931	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46932	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46933	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46934	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46935	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46936	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46937	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46938	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
46939	Aux101 1 Input 5 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46940	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46941	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46942	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46943	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46944	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
46945	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46946	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46947	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46948	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46949	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46950	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46951	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46952	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46953	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46954	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46955	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46956	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46957	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
46958	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46959	Aux101 1 Input 6 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46960	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46961	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46962	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46963	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
46964	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46965	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46966	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46967	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46968	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46969	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46970	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46971	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46972	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46973	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46974	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46975	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46976	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
46977	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46978	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46979	Aux101 0 Input 7 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46980	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46981	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46982	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Addr.	Parameter	Access	Specifications		Description	Control
46983	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46984	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46985	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46986	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46987	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46988	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46989	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46990	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46991	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46992	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46993	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46994	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46995	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		

Addr.	Parameter	Access	Specifications		Description	Control
			Sign: C			
46996	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46997	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46998	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46999	Aux101 0 Input 8 Fault Text	Read/ Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
47002	GK1 (60Hz)	Read Only	Multiplier: 1	Unit:	The governor 60Hz K1 gain adjust. MODBUS Access: Read Only	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47003	GK2 (60Hz)	Read Only	Multiplier: 1	Unit:	The governor 60Hz integral gain adjust. MODBUS Access: Read Only	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
47004	GK3 (60Hz)	Read Only	Multiplier: 1	Unit:	The governor 60Hz K3 gain adjust. MODBUS Access: Read Only	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47005	Governor Damping Effect (60Hz)	Read Only	Multiplier: 1.52587890 625E-05	Unit:	The governor 60Hz damping adjust. MODBUS Access: Read Only	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0.6		
			Size (bits): 16	Upper Limit: 0.95		
			Sign: U			
47006	GK1 (50Hz)	Read Only	Multiplier: 1	Unit:	The governor 50Hz K1 gain adjust. MODBUS Access: Read Only	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47007	GK2 (50Hz)	Read Only	Multiplier: 1	Unit:	The governor 50Hz integral gain adjust. MODBUS Access: Read Only	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47008	GK3 (50Hz)	Read Only	Multiplier: 1	Unit:	The governor 50Hz K3 gain adjust. MODBUS Access: Read Only	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47009	Governor Damping Effect (50Hz)	Read Only	Multiplier: 1.52587890 625E-05	Unit:	The governor 50Hz damping adjust. MODBUS Access: Read Only	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0.6		
			Size (bits): 16	Upper Limit: 0.95		
			Sign: U			
47010	GK1 (Idle)	Read Only	Multiplier: 1	Unit:	This trim is used to adjust gk1 in idle mode. MODBUS Access: Read Only	PC 2.x, PC 3.x

Addr.	Parameter	Access	Specifications		Description	Control
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47011	GK2(Idle)	Read Only	Multiplier: 1	Unit:	This trim is used to adjust gk2 in idle mode. MODBUS Access: Read Only	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47014	Gain Windowing Enable	Read Only	0: Disable		Either enables or disables Gain Windowing feature. MODBUS Access: Read Only	PC 2.x, PC 3.x
			1: Enable			
47015	GK1 Low(50Hz)	Read Only	Multiplier: 1	Unit:	The governor 50Hz K1 low gain adjust. MODBUS Access: Read Only	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47016	GK1 Low(60Hz)	Read Only	Multiplier: 1	Unit:	The governor 60Hz K1 low gain adjust. MODBUS Access: Read Only	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47017	GK1 High(50Hz)	Read Only	Multiplier: 1	Unit:	The governor 50Hz K1 high gain adjust. MODBUS Access: Read Only	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47018	GK1 High(60Hz)	Read Only	Multiplier: 1	Unit:	The governor 60Hz K1 high gain adjust. MODBUS Access: Read Only	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			

Addr.	Parameter	Access	Specifications		Description	Control
47019	Governor Speed Delta High	Read Only	Multiplier: 1	Unit:	The speed error higher limit. MODBUS Access: Read Only	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 50		
			Size (bits): 16	Upper Limit: 1000		
			Sign: U			
47020	Governor Speed Delta Low	Read Only	Multiplier: 1	Unit:	The speed error lower limit. MODBUS Access: Read Only	PC 2.x, PC 3.x
			Offset: 0	Lower Limit: 50		
			Size (bits): 16	Upper Limit: 1000		
			Sign: U			
47021	Intake Manifold Temperature Sensor Type	Read Only	0: PGBU		Either PGBU(Onan) or EBU(Cummins) sensor. Modbus Access : Read Only	PC 2.x, PC 3.x
			1: EBU			
47022	Intake Manifold Temperature Sensor Enable	Read Only	0: Disable		Intake Manifold Temperature Sensor available or not. MODBUS Access : Read Only	PC 2.x, PC 3.x
			1: Enable			
47023	Oil Temperature Sensor Type	Read Only	0: PGBU		Either PGBU(Onan) or EBU(Cummins) sensor.	PC 2.x, PC 3.x
			1: EBU			
47024	Oil Temperature Sensor Enable	Read Only	0: Disable		High Oil Temperature Sensor available or not.	PC 2.x, PC 3.x
			1: Enable			
47025	AVR PWM Command	Read Only	Multiplier: 0.01	Unit: %	The AVR PWM software command. Linear relationship between counts and % duty cycle with 10000 counts=100% duty cycle. MODBUS Access : Read Only	PC 2.x, PC 3.x
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			



THIS PAGE LEFT INTENTIONALLY BLANK



3. PowerCommand 2.x/3.x Modbus Fault Status Bitmaps

Note: Earlier versions of software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

Note: If an address or bit is not listed in this table it is not used.

Note: The external device can read 1–40 contiguous registers, write 1–40 contiguous registers, or read diagnostic counters.

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40400	0	Fault Status Bitmap 1	115	Engine Magnetic Crankshaft Speed/ Position	Shutdown	PC 2.x, PC 3.x
40400	1	Fault Status Bitmap 1	122	Intake Manifold 1 Pressure: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40400	2	Fault Status Bitmap 1	123	Intake Manifold 1 Pressure: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40400	3	Fault Status Bitmap 1	124	Intake Manifold 1 Pressure: Moderately Severe	Warning	PC 2.x, PC 3.x
40400	4	Fault Status Bitmap 1	135	Engine Oil Rifle Pressure 1: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40400	5	Fault Status Bitmap 1	141	Engine Oil Rifle Pressure 1: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40400	6	Fault Status Bitmap 1	143	Engine Oil Rifle Pressure –Moderately Severe	Warning	PC 2.x, PC 3.x
40400	7	Fault Status Bitmap 1	144	Engine Coolant Temp 1: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40400	8	Fault Status Bitmap 1	145	Engine Coolant Temp 1: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40400	9	Fault Status Bitmap 1	146	Engine Coolant Temp: Moderately Above Normal	Derate	PC 2.x, PC 3.x
40400	10	Fault Status Bitmap 1	151	Engine Coolant Temp: Severely Above Normal	Shutdown	PC 2.x, PC 3.x
40400	11	Fault Status Bitmap 1	153	Intake Manifold 1 Temp: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40400	12	Fault Status Bitmap 1	154	Intake Manifold 1 Temp: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40400	13	Fault Status Bitmap 1	155	Intake Manifold 1 Temp: Severely Above Normal	Shutdown	PC 2.x, PC 3.x
40400	14	Fault Status Bitmap 1	187	Sensor Supply 2: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40400	15	Fault Status Bitmap 1	195	Coolant Level Sensor 1: Vtg Above Normal	Warning	PC 2.x, PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40401	0	Fault Status Bitmap 2	196	Coolant Level Sensor 1: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40401	1	Fault Status Bitmap 2	197	Coolant Level: Below Normal – Moderately Severe	Warning	PC 2.x, PC 3.x
40401	2	Fault Status Bitmap 2	212	Engine Oil Temp Sensor 1: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40401	3	Fault Status Bitmap 2	213	Engine Oil Temp Sensor 1: Vtg below Normal	Warning	PC 2.x, PC 3.x
40401	4	Fault Status Bitmap 2	214	Engine Oil Temp: Above Normal – Most severe	Shutdown	PC 2.x, PC 3.x
40401	5	Fault Status Bitmap 2	221	Barometric Pressure: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40401	6	Fault Status Bitmap 2	222	Barometric Pressure Sensor: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40401	7	Fault Status Bitmap 2	223	Eng Oil Burn Valve Solenoid: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40401	8	Fault Status Bitmap 2	224	Engine Oil Burn Valve Solenoid: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40401	9	Fault Status Bitmap 2	227	Sensor Supply 2: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40401	10	Fault Status Bitmap 2	228	Coolant Pressure: Below Normal–Most Severe	Shutdown	PC 2.x, PC 3.x
40401	11	Fault Status Bitmap 2	231	Coolant Pressure Sensor: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40401	12	Fault Status Bitmap 2	232	Coolant Pressure Sensor: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40401	13	Fault Status Bitmap 2	234	Engine Crankshaft Speed/Posn: Above Normal	Shutdown	PC 2.x, PC 3.x
40401	14	Fault Status Bitmap 2	235	Coolant Level: Below Normal–Most Severe	Shutdown	PC 2.x, PC 3.x
40401	15	Fault Status Bitmap 2	238	Sensor Supply 3: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40402	0	Fault Status Bitmap 3	239	Voltage Supply C High Error	Warning	PC 2.x, PC 3.x
40402	1	Fault Status Bitmap 3	245	Radiator Fan Control Driver Low Error	Warning	PC 2.x, PC 3.x
40402	2	Fault Status Bitmap 3	261	Engine Fuel Temp: Above Normal–Moderately Severe	Warning	PC 2.x, PC 3.x
40402	3	Fault Status Bitmap 3	263	Engine Fuel Temp Sensor 1: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40402	4	Fault Status Bitmap 3	265	Engine Fuel Temp Sensor 1: Vtg Below Normal	Warning	PC 2.x, PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40402	5	Fault Status Bitmap 3	266	Engine Fuel Temp: Above Normal–Most severe	Shutdown	PC 2.x, PC 3.x
40402	6	Fault Status Bitmap 3	271	Fuel Pump Pressurizing Assembly 1: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40402	7	Fault Status Bitmap 3	272	Fuel Pump Pressurizing Assembly 1: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40402	8	Fault Status Bitmap 3	281	APC_DIESEL_CYL_PRS_IMBAL_ERROR	Warning	PC 2.x, PC 3.x
40402	9	Fault Status Bitmap 3	285	SAE J1939 Muxing PGN Timeout: Abnormal Update Rate	Warning	PC 2.x, PC 3.x
40402	10	Fault Status Bitmap 3	286	SAE J1939 Muxing Config: Out of Calibration	Warning	PC 2.x, PC 3.x
40402	13	Fault Status Bitmap 3	295	AMBIENT_AIR_PRESS_KEYON_ERROR	Warning	PC 2.x, PC 3.x
40402	14	Fault Status Bitmap 3	319	RTC PWR Intr: Data Erratic Intermittent or Wrong	Warning	PC 2.x, PC 3.x
40402	15	Fault Status Bitmap 3	322	Injector Solenoid Driver Cylinder 1: UnderCurrent	Warning	PC 2.x, PC 3.x
40403	0	Fault Status Bitmap 4	323	Injector Solenoid Driver Cylinder 5: UnderCurrent	Warning	PC 2.x, PC 3.x
40403	1	Fault Status Bitmap 4	324	Injector Solenoid Driver Cylinder 3: UnderCurrent	Warning	PC 2.x, PC 3.x
40403	2	Fault Status Bitmap 4	325	Injector Solenoid Driver Cylinder 6: UnderCurrent	Warning	PC 2.x, PC 3.x
40403	3	Fault Status Bitmap 4	331	Injector Solenoid Driver Cylinder 2: UnderCurrent	Warning	PC 2.x, PC 3.x
40403	4	Fault Status Bitmap 4	332	Injector Solenoid Driver Cylinder 4: UnderCurrent	Warning	PC 2.x, PC 3.x
40403	6	Fault Status Bitmap 4	342	Electronic Calibration Code: Out of Calibration	Shutdown	PC 2.x, PC 3.x
40403	7	Fault Status Bitmap 4	343	Eng Ctrl: internal h/w failure–Bad Device/Component	Warning	PC 2.x, PC 3.x
40403	8	Fault Status Bitmap 4	351	Injector Power Supply: Bad Device/Component	Warning	PC 2.x, PC 3.x
40403	9	Fault Status Bitmap 4	352	Sensor Supply 1: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40403	10	Fault Status Bitmap 4	359	Fail To Start Fault	Shutdown	PC 2.x, PC 3.x
40403	11	Fault Status Bitmap 4	386	Sensor Supply 1: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40403	12	Fault Status Bitmap 4	415	Eng Oil Rifle Pressure: Below Normal–Most Severe	Shutdown	PC 2.x, PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40403	13	Fault Status Bitmap 4	418	Water in Fuel Indicator: Above Normal–Least Severe	Warning	PC 2.x, PC 3.x
40403	14	Fault Status Bitmap 4	421	Eng Oil Temp: Above Normal–Moderately Severe	Warning	PC 2.x, PC 3.x
40403	15	Fault Status Bitmap 4	422	COOLANT_LEVEL_READING_INCORRECT	Warning	PC 2.x, PC 3.x
40404	0	Fault Status Bitmap 5	425	OIL_TEMPERATURE_IN_RANGE_ERROR	Warning	PC 2.x, PC 3.x
40404	1	Fault Status Bitmap 5	426	J1939 Datalink: Data Erratic/Intermittent/Wrong	NONE	PC 2.x, PC 3.x
40404	2	Fault Status Bitmap 5	427	CAN Datalink Degraded	Warning	PC 2.x, PC 3.x
40404	3	Fault Status Bitmap 5	435	OIL_PRESSURE_SWITCH_ERROR	Warning	PC 2.x, PC 3.x
40404	4	Fault Status Bitmap 5	441	Low Battery Voltage	Warning	PC 2.x, PC 3.x
40404	5	Fault Status Bitmap 5	442	High Battery Voltage	Warning	PC 2.x, PC 3.x
40404	6	Fault Status Bitmap 5	449	Injector Metering Rail 1 Pressure: Above Normal	Shutdown	PC 2.x, PC 3.x
40404	7	Fault Status Bitmap 5	451	Injector Metering Rail 1 Pressure: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40404	8	Fault Status Bitmap 5	452	Injector Metering Rail 1 Pressure: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40404	9	Fault Status Bitmap 5	488	Intake Manifold 1 Temp: Above Normal–Moderate	Derate	PC 2.x, PC 3.x
40404	10	Fault Status Bitmap 5	546	Fuel Delivery Pressure: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40404	11	Fault Status Bitmap 5	547	Fuel Delivery Pressure: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40404	12	Fault Status Bitmap 5	553	APC_DIESEL_HIGH_PRS_ERROR	Warning	PC 2.x, PC 3.x
40404	13	Fault Status Bitmap 5	554	APC_DIESEL_PRS_SIR_ERROR	Warning	PC 2.x, PC 3.x
40404	15	Fault Status Bitmap 5	559	Injector Metering Rail 1 Pressure: Below Normal	Warning	PC 2.x, PC 3.x
40405	1	Fault Status Bitmap 6	611	Engine Shut Down Hot Condition Exists	Warning	PC 2.x, PC 3.x
40405	2	Fault Status Bitmap 6	698	ECM Internal Temperature Low Error	Warning	PC 2.x, PC 3.x
40405	3	Fault Status Bitmap 6	689	Eng Crankshaft Speed/Pos Warning	Warning	PC 2.x, PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40405	4	Fault Status Bitmap 6	731	Eng Speed: Cam/Crankshaft Misalignment	Warning	PC 2.x, PC 3.x
40405	5	Fault Status Bitmap 6	2661	At Least One ACK: Most Severe Fault	Shutdown	PC 2.x, PC 3.x
40405	6	Fault Status Bitmap 6	781	CAN Datalink Failed	Shutdown	PC 2.x, PC 3.x
40405	7	Fault Status Bitmap 6	1117	Power Lost With Ignition On	Warning	PC 2.x, PC 3.x
40405	8	Fault Status Bitmap 6	1122	Rated to Idle Transition	NONE	PC 2.x, PC 3.x
40405	9	Fault Status Bitmap 6	1124	Delayed Shutdown Fault	Warning	PC 2.x, PC 3.x
40405	10	Fault Status Bitmap 6	1131	Battle Short Mode Active	Warning	PC 2.x, PC 3.x
40405	11	Fault Status Bitmap 6	1132	Controlled Shutdown In Process	Warning	PC 3.x
40405	13	Fault Status Bitmap 6	1243	Engine Derate	Derate	PC 2.x, PC 3.x
40405	14	Fault Status Bitmap 6	1244	Engine Normal Shutdown	Shutdown w/Cooldown	PC 2.x, PC 3.x
40405	15	Fault Status Bitmap 6	1245	Engine Shutdown	Shutdown	PC 2.x, PC 3.x
40406	0	Fault Status Bitmap 7	1246	Unrecognized Engine Fault	Warning	PC 2.x, PC 3.x
40406	1	Fault Status Bitmap 7	1247	Engine Shutdown – Unannounced	Shutdown	PC 2.x, PC 3.x
40406	2	Fault Status Bitmap 7	1248	Engine Warning	Warning	PC 2.x, PC 3.x
40406	3	Fault Status Bitmap 7	1256	Ctrl Module ID Input State Warning Error	Warning	PC 2.x, PC 3.x
40406	4	Fault Status Bitmap 7	1257	Ctrl Module ID I/P State shutdown Error	Shutdown	PC 2.x, PC 3.x
40406	5	Fault Status Bitmap 7	1322	kW Load Setpoint OOR High	Warning	PC 3.x
40406	6	Fault Status Bitmap 7	1323	kW Load Setpoint OOR Low	Warning	PC 3.x
40406	7	Fault Status Bitmap 7	1324	kVAR Load Setpoint OOR High	Warning	PC 3.x
40406	8	Fault Status Bitmap 7	1325	kVAR Load Setpoint OOR Low	Warning	PC 3.x
40406	9	Fault Status Bitmap 7	1336	Cooldown Completed Fault	Shutdown	PC 2.x, PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40406	10	Fault Status Bitmap 7	1357	Eng Oil Lvl Remote Reservoir: Below Normal	Warning	PC 2.x, PC 3.x
40406	11	Fault Status Bitmap 7	219	Eng Oil Level Remote Reservoir: Least Severe Level	Warning	PC 2.x, PC 3.x
40406	12	Fault Status Bitmap 7	233	HT Coolant Pressure Moderate Low	Warning	PC 2.x, PC 3.x
40406	13	Fault Status Bitmap 7	254	FSO NON Low Control Error	Shutdown	PC 2.x, PC 3.x
40406	14	Fault Status Bitmap 7	686	Turbo 1 Speed Incorrect	Warning	PC 2.x, PC 3.x
40406	15	Fault Status Bitmap 7	697	ECM Internal Temperature High Error	Warning	PC 2.x, PC 3.x
40407	0	Fault Status Bitmap 8	1376	Eng Camshaft Speed/Pos Warning	Warning	PC 2.x, PC 3.x
40407	1	Fault Status Bitmap 8	3611	Custom Overcurrent Fault	Warning	PC 3.x
40407	2	Fault Status Bitmap 8	3513	Negative Sequence Overcurrent	Warning	PC 3.x
40407	3	Fault Status Bitmap 8	1416	Fail to Shutdown	Warning	PC 2.x, PC 3.x
40407	4	Fault Status Bitmap 8	1417	Power Down Failure	Warning	PC 2.x, PC 3.x
40407	5	Fault Status Bitmap 8	1433	Local E-Stop	Shutdown	PC 2.x, PC 3.x
40407	6	Fault Status Bitmap 8	1434	Remote E-Stop	Shutdown	PC 2.x, PC 3.x
40407	7	Fault Status Bitmap 8	1435	Low Coolant Temperature	Warning	PC 2.x, PC 3.x
40407	8	Fault Status Bitmap 8	1438	Fail To Crank Fault	Shutdown	PC 2.x, PC 3.x
40407	9	Fault Status Bitmap 8	1439	Low Fuel in Day Tank	Warning	PC 2.x, PC 3.x
40407	10	Fault Status Bitmap 8	1441	Low Fuel Level	Warning	PC 2.x, PC 3.x
40407	11	Fault Status Bitmap 8	1442	Weak Battery	Warning	PC 2.x, PC 3.x
40407	12	Fault Status Bitmap 8	1443	Dead Battery	Shutdown	PC 2.x, PC 3.x
40407	13	Fault Status Bitmap 8	1444	Overload	Warning	PC 2.x, PC 3.x
40407	14	Fault Status Bitmap 8	1445	Short Circuit	Shutdown	PC 2.x, PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40407	15	Fault Status Bitmap 8	1446	High AC Voltage	Shutdown	PC 2.x, PC 3.x
40408	0	Fault Status Bitmap 9	1447	Low AC Voltage	Shutdown	PC 2.x, PC 3.x
40408	1	Fault Status Bitmap 9	1448	Underfrequency	Shutdown	PC 2.x, PC 3.x
40408	2	Fault Status Bitmap 9	1449	Overfrequency	Warning	PC 2.x, PC 3.x
40408	3	Fault Status Bitmap 9	1459	Reverse kW	Shutdown	PC 2.x, PC 3.x
40408	4	Fault Status Bitmap 9	1461	Loss of Field	Shutdown	PC 2.x, PC 3.x
40408	5	Fault Status Bitmap 9	1463	Not In Auto	NONE	PC 2.x, PC 3.x
40408	6	Fault Status Bitmap 9	1464	Load Dump	Warning	PC 2.x, PC 3.x
40408	7	Fault Status Bitmap 9	1465	Ready To Load	NONE	PC 2.x, PC 3.x
40408	8	Fault Status Bitmap 9	1469	Speed/Frequency Mismatch Fault	Shutdown	PC 2.x, PC 3.x
40408	9	Fault Status Bitmap 9	1471	High Current Warning	Warning	PC 2.x, PC 3.x
40408	10	Fault Status Bitmap 9	1472	Overcurrent Shutdown	Shutdown	PC 2.x, PC 3.x
40408	11	Fault Status Bitmap 9	1483	Common Alarm	None	PC 2.x, PC 3.x
40408	12	Fault Status Bitmap 9	1548	Injector Solenoid Driver Cylinder 7: UnderCurrent	Warning	PC 2.x, PC 3.x
40408	13	Fault Status Bitmap 9	1549	Injector Solenoid Driver Cylinder 8: UnderCurrent	Warning	PC 2.x, PC 3.x
40408	14	Fault Status Bitmap 9	1551	Injector Solenoid Driver Cylinder 10: UnderCurrent	Warning	PC 2.x, PC 3.x
40408	15	Fault Status Bitmap 9	1552	Injector Solenoid Driver Cylinder 11: UnderCurrent	Warning	PC 2.x, PC 3.x
40409	0	Fault Status Bitmap 10	1553	Injector Solenoid Driver Cylinder 12: UnderCurrent	Warning	PC 2.x, PC 3.x
40409	1	Fault Status Bitmap 10	1554	Injector Solenoid Driver Cylinder 13: UnderCurrent	Warning	PC 2.x, PC 3.x
40409	2	Fault Status Bitmap 10	1555	Injector Solenoid Driver Cylinder 14: UnderCurrent	Warning	PC 2.x, PC 3.x
40409	3	Fault Status Bitmap 10	1556	Injector Solenoid Driver Cylinder 15: UnderCurrent	Warning	PC 2.x, PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40409	4	Fault Status Bitmap 10	1557	Injector Solenoid Driver Cylinder 16: UnderCurrent	Warning	PC 2.x, PC 3.x
40409	7	Fault Status Bitmap 10	1622	Injector Solenoid Driver Cylinder 9: UnderCurrent	Warning	PC 2.x, PC 3.x
40409	8	Fault Status Bitmap 10	1689	Real Time Clock Power Interrupt Fault	Warning	PC 2.x, PC 3.x
40409	9	Fault Status Bitmap 10	1695	SENSOR_SUPPLY_5_VOLT-AGE_HIGH_ERROR	Warning	PC 2.x, PC 3.x
40409	10	Fault Status Bitmap 10	1696	SENSOR_SUPPLY_5_VOLT-AGE_LOW_ERROR	Warning	PC 2.x, PC 3.x
40409	11	Fault Status Bitmap 10	1843	Crankcase Pressure: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40409	12	Fault Status Bitmap 10	1844	Crankcase Pressure: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40409	13	Fault Status Bitmap 10	1845	Water in Fuel Indicator: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40409	14	Fault Status Bitmap 10	1846	Water in Fuel Indicator: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40409	15	Fault Status Bitmap 10	1847	Eng Coolant Temp – Shutdown w/Cool	Shutdown w/Cooldown	PC 2.x, PC 3.x
40410	0	Fault Status Bitmap 11	1852	Water in Fuel Indicator: Above Normal-Moderate	Warning	PC 2.x, PC 3.x
40410	1	Fault Status Bitmap 11	1853	HMI113 Fault 1	NONE	PC 2.x, PC 3.x
40410	2	Fault Status Bitmap 11	1854	HMI113 Fault 2	NONE	PC 2.x, PC 3.x
40410	3	Fault Status Bitmap 11	1855	HMI113 Fault 3	NONE	PC 2.x, PC 3.x
40410	5	Fault Status Bitmap 11	1891	Eng Oil Change Interval	Warning	PC 2.x, PC 3.x
40410	6	Fault Status Bitmap 11	1893	J39_EGR_VALVE_COMM_TIMEOUT_ERROR	Warning	PC 2.x, PC 3.x
40410	7	Fault Status Bitmap 11	1894	J39_VGT_COMM_TIMEOUT_ERROR	Warning	PC 2.x, PC 3.x
40410	8	Fault Status Bitmap 11	1896	EGR_DL_VALVE_STUCK_ERROR	Warning	PC 2.x, PC 3.x
40410	9	Fault Status Bitmap 11	1899	EGR_DELTA_P_IR_LOW_ERROR	Warning	PC 2.x, PC 3.x
40410	11	Fault Status Bitmap 11	1912	Utility Loss Of Phase	Warning	PC 3.x
40410	12	Fault Status Bitmap 11	1913	Genset Loss Of Phase	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40410	13	Fault Status Bitmap 11	1914	Utility Phase Rotation	Warning	PC 3.x
40410	14	Fault Status Bitmap 11	1915	Genset Phase Rotation	Warning	PC 3.x
40410	15	Fault Status Bitmap 11	1916	Sync Check OK	NONE	PC 3.x
40411	0	Fault Status Bitmap 12	1917	High Fuel Level	Warning	PC 2.x, PC 3.x
40411	1	Fault Status Bitmap 12	1918	Very Low Fuel Level	Shutdown	PC 2.x, PC 3.x
40411	2	Fault Status Bitmap 12	1933	EGR_DL_VOLTAGE_HIGH_ERROR	Warning	PC 2.x, PC 3.x
40411	3	Fault Status Bitmap 12	1934	EGR_DL_VOLTAGE_LOW_ERROR	Warning	PC 2.x, PC 3.x
40411	4	Fault Status Bitmap 12	1935	EGR_DL_COMMAND_SOURCE_ERROR	Warning	PC 2.x, PC 3.x
40411	5	Fault Status Bitmap 12	1942	BEYOND_THD_AZ_ERROR	Warning	PC 2.x, PC 3.x
40411	6	Fault Status Bitmap 12	1943	CBR_DENSITY_DERATE_ERROR_ID	NONE	PC 2.x, PC 3.x
40411	7	Fault Status Bitmap 12	1944	HMI113 Output Configuration Fault	Warning	PC 2.x, PC 3.x
40411	8	Fault Status Bitmap 12	1961	EGR_DL_EDU_TMPTR_HIGH_ERROR	Warning	PC 2.x, PC 3.x
40411	9	Fault Status Bitmap 12	1974	CRANKCASE_PRESSURE_LEAST_SEV_HIGH	Warning	PC 2.x, PC 3.x
40411	10	Fault Status Bitmap 12	1992	Eng Crankshaft Speed/Posn: Above Normal	Shutdown	PC 2.x, PC 3.x
40411	11	Fault Status Bitmap 12	1999	Maximum Parallel Time	Warning	PC 3.x
40411	12	Fault Status Bitmap 12	2185	Sensor Supply 4: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40411	13	Fault Status Bitmap 12	2186	Sensor Supply 4: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40411	14	Fault Status Bitmap 12	2215	Fuel Pump Delivery Pressure: Below Normal	Warning	PC 2.x, PC 3.x
40411	15	Fault Status Bitmap 12	2249	APC_DIESEL_LOW2_PRS_ERROR	Warning	PC 2.x, PC 3.x
40412	0	Fault Status Bitmap 13	2261	Fuel Pump Delivery Pressure: Above Normal	Warning	PC 2.x, PC 3.x
40412	1	Fault Status Bitmap 13	2262	Fuel Pump Delivery–Below Normal	Warning	PC 2.x, PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40412	2	Fault Status Bitmap 13	2265	Electric Lift Pump for Eng Fuel: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40412	3	Fault Status Bitmap 13	2266	Electric Lift Pump for Eng Fuel: Vtg Below Normal	Warning	PC 2.x, PC 3.x
40412	4	Fault Status Bitmap 13	2292	APC_DIESEL_FLOW_HIGH_ERROR	Warning	PC 2.x, PC 3.x
40412	5	Fault Status Bitmap 13	2293	APC_DIESEL_FLOW_LOW_ERROR	Warning	PC 2.x, PC 3.x
40412	6	Fault Status Bitmap 13	2311	Electronic Fuel Injection Control Valve	Warning	PC 2.x, PC 3.x
40412	7	Fault Status Bitmap 13	2328	Utility Available	NONE	PC 3.x
40412	8	Fault Status Bitmap 13	2331	Utility Undervoltage	Warning	PC 3.x
40412	9	Fault Status Bitmap 13	2332	Utility Connected	NONE	PC 3.x
40412	10	Fault Status Bitmap 13	2333	Genset Connected	NONE	PC 3.x
40412	11	Fault Status Bitmap 13	2335	Excitation/Loss of AC Voltage Sensing	Shutdown	PC 2.x, PC 3.x
40412	13	Fault Status Bitmap 13	2342	Too Long in Idle	Warning	PC 2.x, PC 3.x
40412	14	Fault Status Bitmap 13	2358	Utility Overvoltage	Warning	PC 3.x
40412	15	Fault Status Bitmap 13	2377	Fan Control: Vtg Above Normal	Warning	PC 2.x, PC 3.x
40413	0	Fault Status Bitmap 14	2396	Utility Breaker Fail To Close	Warning	PC 3.x
40413	1	Fault Status Bitmap 14	2397	Utility Breaker Fail To Open	Warning	PC 3.x
40413	2	Fault Status Bitmap 14	3226	Base Load	NONE	PC 3.x
40413	3	Fault Status Bitmap 14	3227	Peak Shave	NONE	PC 3.x
40413	4	Fault Status Bitmap 14	2555	GHC_LOW_VOLTAGE_ERROR_1	Warning	PC 2.x, PC 3.x
40413	5	Fault Status Bitmap 14	2556	GHC_HIGH_VOLTAGE_ERROR_1	Warning	PC 2.x, PC 3.x
40413	6	Fault Status Bitmap 14	2678	Charging Alternator Failure Fault	Warning	PC 2.x, PC 3.x
40413	7	Fault Status Bitmap 14	2965	Genset Available	NONE	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40413	8	Fault Status Bitmap 14	2971	Test/Exercise is Active Fault	NONE	PC 2.x, PC 3.x
40413	9	Fault Status Bitmap 14	2972	Field Overload	Shutdown	PC 2.x, PC 3.x
40413	10	Fault Status Bitmap 14	2973	CHARGE_PRESS_IR_ERROR	Warning	PC 2.x, PC 3.x
40413	11	Fault Status Bitmap 14	2943	Manual Switch Configuration Fault	Warning	PC 2.x, PC 3.x
40413	12	Fault Status Bitmap 14	2944	Auto Switch Configuration Fault	Warning	PC 2.x, PC 3.x
40413	13	Fault Status Bitmap 14	2914	Genset AC Meter Failed	Shutdown	PC 2.x, PC 3.x
40413	14	Fault Status Bitmap 14	2915	Genset Bus AC Meter Failed	Warning	PC 3.x
40413	15	Fault Status Bitmap 14	2916	Utility AC Meter Failed	Warning	PC 3.x
40414	0	Fault Status Bitmap 15	2814	Genset CT Ratio Too Small	Shutdown	PC 2.x, PC 3.x
40414	1	Fault Status Bitmap 15	2815	Genset CT Ratio Too Large	Warning	PC 2.x, PC 3.x
40414	2	Fault Status Bitmap 15	2816	Genset PT Ratio Too Small	Shutdown	PC 2.x, PC 3.x
40414	3	Fault Status Bitmap 15	2817	Genset PT Ratio Too Large	Warning	PC 2.x, PC 3.x
40414	4	Fault Status Bitmap 15	2818	Genset Bus PT Ratio Too Small	Shutdown	PC 3.x
40414	5	Fault Status Bitmap 15	2819	Genset Bus PT Ratio Too Large	Warning	PC 3.x
40414	6	Fault Status Bitmap 15	2821	Utility PT Ratio Too Small	Shutdown	PC 3.x
40414	7	Fault Status Bitmap 15	2822	Utility PT Ratio Too Large	Warning	PC 3.x
40414	8	Fault Status Bitmap 15	2619	Aux101 0 Input 1 Fault	Warning	PC 2.x, PC 3.x
40414	9	Fault Status Bitmap 15	2621	Aux101 0 Input 2 Fault	Warning	PC 2.x, PC 3.x
40414	10	Fault Status Bitmap 15	2622	Aux101 0 Input 3 Fault	Warning	PC 2.x, PC 3.x
40414	11	Fault Status Bitmap 15	2623	Aux101 0 Input 4 Fault	Warning	PC 2.x, PC 3.x
40414	12	Fault Status Bitmap 15	2624	Aux101 0 Input 5 Fault	Warning	PC 2.x, PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40414	13	Fault Status Bitmap 15	2625	Aux101 0 Input 6 Fault	Warning	PC 2.x, PC 3.x
40414	14	Fault Status Bitmap 15	2626	Aux101 0 Input 7 Fault	Warning	PC 2.x, PC 3.x
40414	15	Fault Status Bitmap 15	2627	Aux101 0 Input 8 Fault	Warning	PC 2.x, PC 3.x
40415	0	Fault Status Bitmap 16	2882	Aux101 1 Input 1 Fault	Warning	PC 2.x, PC 3.x
40415	1	Fault Status Bitmap 16	2883	Aux101 1 Input 2 Fault	Warning	PC 2.x, PC 3.x
40415	2	Fault Status Bitmap 16	2884	Aux101 1 Input 3 Fault	Warning	PC 2.x, PC 3.x
40415	3	Fault Status Bitmap 16	2885	Aux101 1 Input 4 Fault	Warning	PC 2.x, PC 3.x
40415	4	Fault Status Bitmap 16	2886	Aux101 1 Input 5 Fault	Warning	PC 2.x, PC 3.x
40415	5	Fault Status Bitmap 16	2887	Aux101 1 Input 6 Fault	Warning	PC 2.x, PC 3.x
40415	6	Fault Status Bitmap 16	2888	Aux101 1 Input 7 Fault	Warning	PC 2.x, PC 3.x
40415	7	Fault Status Bitmap 16	2889	Aux101 1 Input 8 Fault	Warning	PC 2.x, PC 3.x
40415	8	Fault Status Bitmap 16	2628	Aux102 0 Expansion Input 9 Fault	Warning	PC 2.x, PC 3.x
40415	9	Fault Status Bitmap 16	2629	Aux102 0 Expansion Input 10 Fault	Warning	PC 2.x, PC 3.x
40415	10	Fault Status Bitmap 16	2631	Aux102 0 Expansion Input 11 Fault	Warning	PC 2.x, PC 3.x
40415	11	Fault Status Bitmap 16	2632	Aux102 0 Expansion Input 12 Fault	Warning	PC 2.x, PC 3.x
40415	12	Fault Status Bitmap 16	2891	Aux102 1 Expansion Input 9 Fault	Warning	PC 2.x, PC 3.x
40415	13	Fault Status Bitmap 16	2892	Aux102 1 Expansion Input 10 Fault	Warning	PC 2.x, PC 3.x
40415	14	Fault Status Bitmap 16	2893	Aux102 1 Expansion Input 11 Fault	Warning	PC 2.x, PC 3.x
40415	15	Fault Status Bitmap 16	2894	Aux102 1 Expansion Input 12 Fault	Warning	PC 2.x, PC 3.x
40416	0	Fault Status Bitmap 17	2895	PCCnet Device Failed Warning	Warning	PC 2.x, PC 3.x
40416	1	Fault Status Bitmap 17	2896	PCCnet Device Failed Shutdown	Shutdown	PC 2.x, PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40416	2	Fault Status Bitmap 17	2917	Genset Bus Voltage OOR Warning	Warning	PC 3.x
40416	3	Fault Status Bitmap 17	2918	Utility Voltage OOR Warning	Warning	PC 3.x
40416	4	Fault Status Bitmap 17	2919	Utility Current OOR Warning	Warning	PC 3.x
40416	5	Fault Status Bitmap 17	2921	Genset Bus Current OOR Warning	Warning	PC 3.x
40416	6	Fault Status Bitmap 17	2922	Genset Neutral Current OOR Warning	Warning	PC 3.x
40416	7	Fault Status Bitmap 17	2923	Genset Bus kW OOR Warning	Warning	PC 3.x
40416	8	Fault Status Bitmap 17	2924	Genset Bus kVAR OOR Warning	Warning	PC 3.x
40416	9	Fault Status Bitmap 17	2925	Genset Bus kVA OOR Warning	Warning	PC 3.x
40416	10	Fault Status Bitmap 17	2926	Utility kW OOR Warning	Warning	PC 3.x
40416	11	Fault Status Bitmap 17	2927	Utility kVAR OOR Warning	Warning	PC 3.x
40416	12	Fault Status Bitmap 17	2928	Utility kVA OOR Warning	Warning	PC 3.x
40416	13	Fault Status Bitmap 17	3599	Ground Current OOR Warning	Warning	PC 3.x
40416	14	Fault Status Bitmap 17	2931	AUX101 Device ID Fault	Shutdown	PC 2.x, PC 3.x
40416	15	Fault Status Bitmap 17	2779	Utility Unloaded Event	NONE	PC 3.x
40417	3	Fault Status Bitmap 18	2932	AUX101 Oil Temp OOR Hi	Warning	PC 2.x, PC 3.x
40417	4	Fault Status Bitmap 18	2933	AUX101 Oil Temp OOR Low	Warning	PC 2.x, PC 3.x
40417	5	Fault Status Bitmap 18	2657	Exhaust Stack Temp 1 OOR High	Warning	PC 2.x, PC 3.x
40417	6	Fault Status Bitmap 18	2947	Exhaust Stack Temp 1 OOR Low	Warning	PC 2.x, PC 3.x
40417	7	Fault Status Bitmap 18	2949	High Exhaust Stack Temperature 1	Warning	PC 2.x, PC 3.x
40417	8	Fault Status Bitmap 18	2653	Exhaust Stack Temp 2 OOR High	Warning	PC 2.x, PC 3.x
40417	9	Fault Status Bitmap 18	2946	Exhaust Stack Temp 2 OOR Low	Warning	PC 2.x, PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40417	10	Fault Status Bitmap 18	2948	High Exhaust Stack Temperature 2	Warning	PC 2.x, PC 3.x
40417	11	Fault Status Bitmap 18	2934	Ambient Temp OOR High	Warning	PC 2.x, PC 3.x
40417	12	Fault Status Bitmap 18	2935	Ambient Temp OOR Low	Warning	PC 2.x, PC 3.x
40417	13	Fault Status Bitmap 18	2936	Fuel Level OOR High	Warning	PC 2.x, PC 3.x
40417	14	Fault Status Bitmap 18	2937	Fuel Level OOR Low	Warning	PC 2.x, PC 3.x
40417	15	Fault Status Bitmap 18	2951	Alternator Temp 1 OOR High	Warning	PC 2.x, PC 3.x
40418	0	Fault Status Bitmap 19	2952	Alternator Temp 1 OOR Low	Warning	PC 2.x, PC 3.x
40418	1	Fault Status Bitmap 19	2953	High Alternator Temp 1	Warning	PC 2.x, PC 3.x
40418	2	Fault Status Bitmap 19	2954	Alternator Temp 2 OOR High	Warning	PC 2.x, PC 3.x
40418	3	Fault Status Bitmap 19	2955	Alternator Temp 2 OOR Low	Warning	PC 2.x, PC 3.x
40418	4	Fault Status Bitmap 19	2956	High Alternator Temp 2	Warning	PC 2.x, PC 3.x
40418	5	Fault Status Bitmap 19	2957	Alternator Temp 3 OOR High	Warning	PC 2.x, PC 3.x
40418	6	Fault Status Bitmap 19	2958	Alternator Temp 3 OOR Low	Warning	PC 2.x, PC 3.x
40418	7	Fault Status Bitmap 19	2959	High Alternator Temp 3	Warning	PC 2.x, PC 3.x
40418	8	Fault Status Bitmap 19	2992	Intake Manifold Temp 1 OOR High	Warning	PC 2.x, PC 3.x
40418	9	Fault Status Bitmap 19	2978	Intake Manifold Temp 1 OOR Low	Warning	PC 2.x, PC 3.x
40418	10	Fault Status Bitmap 19	2981	Drive End Bearing Temp OOR High	Warning	PC 2.x, PC 3.x
40418	11	Fault Status Bitmap 19	2982	Drive End Bearing Temp OOR Low	Warning	PC 2.x, PC 3.x
40418	12	Fault Status Bitmap 19	2983	High Drive End Bearing Temperature	Warning	PC 2.x, PC 3.x
40418	13	Fault Status Bitmap 19	2984	Non-Drive End Bearing Temp OOR High	Warning	PC 2.x, PC 3.x
40418	14	Fault Status Bitmap 19	2985	Non-Drive End Bearing Temp OOR Low	Warning	PC 2.x, PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40418	15	Fault Status Bitmap 19	2986	High Non-Drive End Bearing Temperature	Warning	PC 2.x, PC 3.x
40419	0	Fault Status Bitmap 20	2945	Rupture Basin	Warning	PC 2.x, PC 3.x
40419	1	Fault Status Bitmap 20	2979	High Alternator Temp Switch fault	Warning	PC 2.x, PC 3.x
40419	2	Fault Status Bitmap 20	2993	Battery Charger Failed Fault	Warning	PC 2.x, PC 3.x
40419	3	Fault Status Bitmap 20	2938	Earth/Ground Fault	Warning	PC 2.x, PC 3.x
40419	4	Fault Status Bitmap 20	2939	Modbus Failure Fault	Warning	PC 2.x, PC 3.x
40419	5	Fault Status Bitmap 20	2977	Low Coolant Level #2	Warning	PC 2.x, PC 3.x
40419	6	Fault Status Bitmap 20	1978	Speed Bias OOR High	Warning	PC 2.x, PC 3.x
40419	7	Fault Status Bitmap 20	2541	Voltage Bias OOR Low	Warning	PC 2.x, PC 3.x
40419	8	Fault Status Bitmap 20	2539	Voltage Bias OOR High	Warning	PC 2.x, PC 3.x
40419	9	Fault Status Bitmap 20	1573	Configurable Input #1	NONE	PC 2.x, PC 3.x
40419	10	Fault Status Bitmap 20	1312	Configurable Input #2	NONE	PC 2.x, PC 3.x
40419	11	Fault Status Bitmap 20	1317	Configurable Input #13	NONE	PC 2.x, PC 3.x
40419	12	Fault Status Bitmap 20	1318	Configurable Input #14	NONE	PC 2.x, PC 3.x
40419	13	Fault Status Bitmap 20	1979	Speed Bias OOR Low	Warning	PC 2.x, PC 3.x
40419	14	Fault Status Bitmap 20	236	Both Engine Speed Signals Lost: Most Severe Level	Shutdown	PC 2.x, PC 3.x
40419	15	Fault Status Bitmap 20	3629	Less Severe Response-Warning	Warning	PC 3.x
40420	0	Fault Status Bitmap 21	3631	Most Severe-Shutdown	Shutdown	PC 3.x
40430	0	Event Status Bitmap 1	1540	Common Warning	NONE	PC 2.x, PC 3.x
40430	1	Event Status Bitmap 1	1541	Common Shutdown	NONE	PC 2.x, PC 3.x
40431	0	Fault Status Gas Bitmap 1	121	EPS Main Channel Lost Error	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40431	1	Fault Status Gas Bitmap 1	136	Oil Inlet Pressure High Error	Warning	PC 3.x
40431	2	Fault Status Gas Bitmap 1	137	Oil Inlet Pressure Low Error	Warning	PC 3.x
40431	3	Fault Status Gas Bitmap 1	142	Oil Overpressure Error	Warning	PC 3.x
40431	4	Fault Status Gas Bitmap 1	156	Intake Manifold Temp 2 OORH	Warning	PC 3.x
40431	5	Fault Status Gas Bitmap 1	157	Intake Manifold Temp 2 OORL	Warning	PC 3.x
40431	6	Fault Status Gas Bitmap 1	158	Intake Manifold Temp 2 High	Shutdown	PC 3.x
40431	7	Fault Status Gas Bitmap 1	159	Intake Manifold 3 Temp OORH	Warning	PC 3.x
40431	8	Fault Status Gas Bitmap 1	161	Intake Manifold 3 Temp OORL	Warning	PC 3.x
40431	9	Fault Status Gas Bitmap 1	162	Intake Manifold 3 Temp High	Shutdown	PC 3.x
40431	10	Fault Status Gas Bitmap 1	163	Intake Manifold 4 Temp OORH	Warning	PC 3.x
40431	11	Fault Status Gas Bitmap 1	164	Intake Manifold 4 Temp OORL	Warning	PC 3.x
40431	12	Fault Status Gas Bitmap 1	165	Intake Manifold 4 Temp High	Shutdown	PC 3.x
40431	13	Fault Status Gas Bitmap 1	175	Throttle_Driver_Feedback_High_Error	Shutdown w/Cooldown	PC 3.x
40431	14	Fault Status Gas Bitmap 1	176	Throttle_Driver_Feedback_Low_Error	Shutdown w/Cooldown	PC 3.x
40431	15	Fault Status Gas Bitmap 1	177	Throttle_Actuator_Error	Shutdown w/Cooldown	PC 3.x
40432	2	Fault Status Gas Bitmap 2	244	Red Stop Lamp Driver OORL	Warning	PC 3.x
40432	3	Fault Status Gas Bitmap 2	246	Exhaust Gas Temp Sensor 1 OORH	Warning	PC 3.x
40432	4	Fault Status Gas Bitmap 2	247	Exhaust Gas Temp Sensor 1 OORL	Warning	PC 3.x
40432	5	Fault Status Gas Bitmap 2	248	Exhaust Gas Temp Sensor 1 High	Warning	PC 3.x
40432	6	Fault Status Gas Bitmap 2	253	Oil Level Low Error	Shutdown w/Cooldown	PC 3.x
40432	8	Fault Status Gas Bitmap 2	277	Fuel Control Valve Out of Adj	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40432	9	Fault Status Gas Bitmap 2	346	Powerdown Data Lost Error	Warning	PC 3.x
40432	10	Fault Status Gas Bitmap 2	354	Manifold_Absolute_Pressure_1_High_Error	Warning	PC 3.x
40432	11	Fault Status Gas Bitmap 2	355	Manifold_Absolute_Pressure_1_Low_Error	Warning	PC 3.x
40432	12	Fault Status Gas Bitmap 2	412	J1708 Link Cannot Transmit Error	NONE	PC 3.x
40432	13	Fault Status Gas Bitmap 2	414	J1708 Link Not Fast Enough Error	NONE	PC 3.x
40432	14	Fault Status Gas Bitmap 2	453	Gas_Mass_Flow_High_Error	Warning	PC 3.x
40432	15	Fault Status Gas Bitmap 2	454	Gas_Mass_Flow_Low_Error	Warning	PC 3.x
40433	0	Fault Status Gas Bitmap 3	458	Spark_Timing_B_Error	Shutdown w/Cooldown	PC 3.x
40433	1	Fault Status Gas Bitmap 3	459	Spark_Timing_A_Error	Shutdown w/Cooldown	PC 3.x
40433	2	Fault Status Gas Bitmap 3	461	Spark_Reference_B_Error	Shutdown w/Cooldown	PC 3.x
40433	3	Fault Status Gas Bitmap 3	462	Spark_Reference_A_Error	Shutdown w/Cooldown	PC 3.x
40433	4	Fault Status Gas Bitmap 3	477	Isolated Battery Voltage Low Error	Warning	PC 3.x
40433	5	Fault Status Gas Bitmap 3	478	Isolated Battery Voltage High Error	Warning	PC 3.x
40433	6	Fault Status Gas Bitmap 3	512	Throttle Pos 1 Feedback OOR High	Warning	PC 3.x
40433	7	Fault Status Gas Bitmap 3	513	Throttle Pos 1 Feedback OOR Low	Warning	PC 3.x
40433	8	Fault Status Gas Bitmap 3	557	Fuel Control Valve 2 OORH	Shutdown w/Cooldown	PC 3.x
40433	9	Fault Status Gas Bitmap 3	558	Fuel Control Valve 2 OORL	Warning	PC 3.x
40433	10	Fault Status Gas Bitmap 3	561	Heavy_Knock_Error_1_(A1)	Shutdown w/Cooldown	PC 3.x
40433	11	Fault Status Gas Bitmap 3	562	Heavy_Knock_Error_2_(B1)	Shutdown w/Cooldown	PC 3.x
40433	12	Fault Status Gas Bitmap 3	563	Heavy_Knock_Error_3_(A2)	Shutdown w/Cooldown	PC 3.x
40433	13	Fault Status Gas Bitmap 3	564	Heavy_Knock_Error_4_(B2)	Shutdown w/Cooldown	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40433	14	Fault Status Gas Bitmap 3	565	Heavy_Knock_Error_5_(A3)	Shutdown w/Cooldown	PC 3.x
40433	15	Fault Status Gas Bitmap 3	566	Heavy_Knock_Error_6_(B3)	Shutdown w/Cooldown	PC 3.x
40434	0	Fault Status Gas Bitmap 4	567	Heavy_Knock_Error_7_(A4)	Shutdown w/Cooldown	PC 3.x
40434	1	Fault Status Gas Bitmap 4	568	Heavy_Knock_Error_8_(B4)	Shutdown w/Cooldown	PC 3.x
40434	2	Fault Status Gas Bitmap 4	569	Heavy_Knock_Error_9_(A5)	Shutdown w/Cooldown	PC 3.x
40434	3	Fault Status Gas Bitmap 4	571	Knock Cyl 1 (A1) OORL	Warning	PC 3.x
40434	4	Fault Status Gas Bitmap 4	572	Knock Cyl 2 (B1) OORL	Warning	PC 3.x
40434	5	Fault Status Gas Bitmap 4	573	Knock Cyl 3 (A2) OORL	Warning	PC 3.x
40434	6	Fault Status Gas Bitmap 4	574	Knock Cyl 4 (B2) OORL	Warning	PC 3.x
40434	7	Fault Status Gas Bitmap 4	575	Knock Cyl 5 (A3) OORL	Warning	PC 3.x
40434	8	Fault Status Gas Bitmap 4	576	Knock Cyl 6 (B3) OORL	Warning	PC 3.x
40434	9	Fault Status Gas Bitmap 4	577	Knock Cyl 7 (A4) OORL	Warning	PC 3.x
40434	10	Fault Status Gas Bitmap 4	578	Knock Cyl 8 (B4) OORL	Warning	PC 3.x
40434	11	Fault Status Gas Bitmap 4	579	Knock Cyl 9 (A5) OORL	Warning	PC 3.x
40434	12	Fault Status Gas Bitmap 4	584	High Side DRV3 High Control Error	Warning	PC 3.x
40434	13	Fault Status Gas Bitmap 4	585	High Side DRV3 Low Control Error	Warning	PC 3.x
40434	14	Fault Status Gas Bitmap 4	591	Exhaust_Backpressure_High_Error	Warning	PC 3.x
40434	15	Fault Status Gas Bitmap 4	592	Exhaust_Backpressure_Low_Error	Warning	PC 3.x
40435	0	Fault Status Gas Bitmap 5	595	Turbo 1 Overspeed Warning Error	Warning	PC 3.x
40435	1	Fault Status Gas Bitmap 5	618	Turbo 1 Inlet Pressure High	Warning	PC 3.x
40435	2	Fault Status Gas Bitmap 5	619	Turbo 2 Inlet Press High	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40435	3	Fault Status Gas Bitmap 5	641	Exhaust Temp 1 (A1) High Serious Error	Shutdown w/Cooldown	PC 3.x
40435	4	Fault Status Gas Bitmap 5	642	Exhaust Temp 3 (A2) High Serious Error	Shutdown w/Cooldown	PC 3.x
40435	5	Fault Status Gas Bitmap 5	643	Exhaust Temp 5 (A3) High Serious Error	Shutdown w/Cooldown	PC 3.x
40435	6	Fault Status Gas Bitmap 5	644	Exhaust Temp 7 (A4) High Serious Error	Shutdown w/Cooldown	PC 3.x
40435	7	Fault Status Gas Bitmap 5	645	Exhaust Temp 9 (A5) High Serious Error	Shutdown w/Cooldown	PC 3.x
40435	8	Fault Status Gas Bitmap 5	646	Exhaust Temp 11 (A6) High Serious Error	Shutdown w/Cooldown	PC 3.x
40435	9	Fault Status Gas Bitmap 5	647	Exhaust Temp 13 (A7) High Serious Error	Shutdown w/Cooldown	PC 3.x
40435	10	Fault Status Gas Bitmap 5	648	Exhaust Temp 15 (A8) High Serious Error	Shutdown w/Cooldown	PC 3.x
40435	11	Fault Status Gas Bitmap 5	651	Exhaust Temp 17 (A9) High Serious Error	Shutdown w/Cooldown	PC 3.x
40435	12	Fault Status Gas Bitmap 5	652	Exhaust Temp 2 (B1) High Serious Error	Shutdown w/Cooldown	PC 3.x
40435	13	Fault Status Gas Bitmap 5	653	Exhaust Temp 4 (B2) High Serious Error	Shutdown w/Cooldown	PC 3.x
40435	14	Fault Status Gas Bitmap 5	654	Exhaust Temp 6 (B3) High Serious Error	Shutdown w/Cooldown	PC 3.x
40435	15	Fault Status Gas Bitmap 5	655	Exhaust Temp 8 (B4) High Serious Error	Shutdown w/Cooldown	PC 3.x
40436	0	Fault Status Gas Bitmap 6	656	Exhaust Temp 10 (B5) High Serious Error	Shutdown w/Cooldown	PC 3.x
40436	1	Fault Status Gas Bitmap 6	657	Exhaust Temp 12 (B6) High Serious Error	Shutdown w/Cooldown	PC 3.x
40436	2	Fault Status Gas Bitmap 6	658	Exhaust Temp 14 (B7) High Serious Error	Shutdown w/Cooldown	PC 3.x
40436	3	Fault Status Gas Bitmap 6	671	Exhaust Gas Temp Cyl 1 (A1) OORL	Warning	PC 3.x
40436	4	Fault Status Gas Bitmap 6	672	Exhaust Gas Temp Cyl 3 (A2) OORL	Warning	PC 3.x
40436	5	Fault Status Gas Bitmap 6	673	Exhaust Gas Temp Cyl 5 (A3) OORL	Warning	PC 3.x
40436	6	Fault Status Gas Bitmap 6	674	Exhaust Gas Temp Cyl 7 (A4) OORL	Warning	PC 3.x
40436	7	Fault Status Gas Bitmap 6	675	Exhaust Gas Temp Cyl 9 (A5) OORL	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40436	8	Fault Status Gas Bitmap 6	676	Exhaust Gas Temp Cyl 11 (A6) OORL	Warning	PC 3.x
40436	9	Fault Status Gas Bitmap 6	677	Exhaust Gas Temp Cyl 13 (A7) OORL	Warning	PC 3.x
40436	10	Fault Status Gas Bitmap 6	678	Exhaust Gas Temp Cyl 15 (A8) OORL	Warning	PC 3.x
40436	11	Fault Status Gas Bitmap 6	683	Turbo 2 Speed Moderate High	Warning	PC 3.x
40436	12	Fault Status Gas Bitmap 6	684	Turbo 2 Speed Moderate Low	Warning	PC 3.x
40436	13	Fault Status Gas Bitmap 6	685	Turbo 2 Speed Incorrect	Warning	PC 3.x
40436	15	Fault Status Gas Bitmap 6	687	Turbo 1 Speed Low	Warning	PC 3.x
40437	2	Fault Status Gas Bitmap 7	721	Exhaust Gas Temp 2 (B1) OORL	Warning	PC 3.x
40437	3	Fault Status Gas Bitmap 7	722	Exhaust Gas Temp 4 (B2) OORL	Warning	PC 3.x
40437	4	Fault Status Gas Bitmap 7	723	Exhaust Gas Temp 6 (B3) OORL	Warning	PC 3.x
40437	5	Fault Status Gas Bitmap 7	724	Exhaust Gas Temp 8 (B4) OORL	Warning	PC 3.x
40437	6	Fault Status Gas Bitmap 7	725	Exhaust Gas Temp 10 (B5) OORL	Warning	PC 3.x
40437	7	Fault Status Gas Bitmap 7	726	Exhaust Gas Temp 12 (B6) OORL	Warning	PC 3.x
40437	8	Fault Status Gas Bitmap 7	727	Exhaust Gas Temp 14 (B7) OORL	Warning	PC 3.x
40437	9	Fault Status Gas Bitmap 7	728	Exhaust Gas Temp 16 (B8) OORL	Warning	PC 3.x
40437	10	Fault Status Gas Bitmap 7	736	Starter Air Pressure OORL	Warning	PC 3.x
40437	11	Fault Status Gas Bitmap 7	737	Starter Air Pressure OORH	Warning	PC 3.x
40437	12	Fault Status Gas Bitmap 7	738	Starter Air Press Underpressure Error	Warning	PC 3.x
40437	13	Fault Status Gas Bitmap 7	741	Air Filter Restriction Pressure High Error	Warning	PC 3.x
40437	14	Fault Status Gas Bitmap 7	742	Air Filter Restriction Pressure Low Error	Warning	PC 3.x
40437	15	Fault Status Gas Bitmap 7	751	Gas_Mass_Flow_In_Range_Error	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40438	0	Fault Status Gas Bitmap 8	752	Exhaust_Gas_Oxygen_In_Range_Error	Warning	PC 3.x
40438	1	Fault Status Gas Bitmap 8	783	Intake Manifold 1 Temp Abnormal	Shutdown w/Cooldown	PC 3.x
40438	2	Fault Status Gas Bitmap 8	1213	COP_Overboost_Error	Shutdown w/Cooldown	PC 3.x
40438	3	Fault Status Gas Bitmap 8	1274	Heavy_Knock_Error_10_(B5)	Shutdown w/Cooldown	PC 3.x
40438	4	Fault Status Gas Bitmap 8	1281	Heavy_Knock_Error_12_(B6)	Shutdown w/Cooldown	PC 3.x
40438	5	Fault Status Gas Bitmap 8	1285	Continuous_Light_Knock_Error_13_(A7)	Shutdown w/Cooldown	PC 3.x
40438	6	Fault Status Gas Bitmap 8	1286	Heavy_Knock_Error_13_(A7)	Shutdown w/Cooldown	PC 3.x
40438	7	Fault Status Gas Bitmap 8	1291	Heavy_Knock_Error_14_(B7)	Shutdown w/Cooldown	PC 3.x
40438	8	Fault Status Gas Bitmap 8	1295	Continuous_Light_Knock_Error_15_(A8)	Shutdown w/Cooldown	PC 3.x
40438	9	Fault Status Gas Bitmap 8	1296	Heavy_Knock_Error_15_(A8)	Shutdown w/Cooldown	PC 3.x
40438	10	Fault Status Gas Bitmap 8	1311	Heavy_Knock_Error_18_(B9)	Shutdown w/Cooldown	PC 3.x
40438	11	Fault Status Gas Bitmap 8	1362	Oil Filter Restriction Error	Warning	PC 3.x
40438	12	Fault Status Gas Bitmap 8	1452	Genset Breaker Fail To Close	Shutdown	PC 3.x
40438	13	Fault Status Gas Bitmap 8	1457	Fail To Synchronize	Warning	PC 3.x
40438	14	Fault Status Gas Bitmap 8	1458	Sync Phase Rotation Mismatch	Warning	PC 3.x
40438	15	Fault Status Gas Bitmap 8	1474	ECM Software mismatch	Shutdown w/Cooldown	PC 3.x
40439	0	Fault Status Gas Bitmap 9	1521	Exhaust Gas Temp 3 (A2) OORH	Warning	PC 3.x
40439	1	Fault Status Gas Bitmap 9	1522	Exhaust Gas Temp 5 (A3) OORH	Warning	PC 3.x
40439	2	Fault Status Gas Bitmap 9	1523	Exhaust Gas Temp 7 (A4) OORH	Warning	PC 3.x
40439	3	Fault Status Gas Bitmap 9	1524	Exhaust Gas Temp 9 (A5) OORH	Warning	PC 3.x
40439	4	Fault Status Gas Bitmap 9	1525	Exhaust Gas Temp 11 (A6) OORH	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40439	5	Fault Status Gas Bitmap 9	1526	Exhaust Gas Temp 13 (A7) OORH	Warning	PC 3.x
40439	6	Fault Status Gas Bitmap 9	1527	Exhaust Gas Temp 15 (A8) OORH	Warning	PC 3.x
40439	7	Fault Status Gas Bitmap 9	1528	Exhaust Gas Temp 17 (A9) OORH	Warning	PC 3.x
40439	8	Fault Status Gas Bitmap 9	1529	Exhaust Gas Temp 2 (B1) OORH	Warning	PC 3.x
40439	9	Fault Status Gas Bitmap 9	1531	Exhaust Gas Temp 6 (B3) OORH	Warning	PC 3.x
40439	10	Fault Status Gas Bitmap 9	1532	Exhaust Gas Temp 8 (B4) OORH	Warning	PC 3.x
40439	11	Fault Status Gas Bitmap 9	1533	Exhaust Gas Temp 10 (B5) OORH	Warning	PC 3.x
40439	12	Fault Status Gas Bitmap 9	1534	Exhaust Gas Temp 12 (B6) OORH	Warning	PC 3.x
40439	13	Fault Status Gas Bitmap 9	1535	Exhaust Gas Temp 14 (B7) OORH	Warning	PC 3.x
40439	14	Fault Status Gas Bitmap 9	1536	Exhaust Gas Temp 16 (B8) OORH	Warning	PC 3.x
40439	15	Fault Status Gas Bitmap 9	1537	Exhaust Gas Temp 18 (B9) OORH	Warning	PC 3.x
40440	0	Fault Status Gas Bitmap 10	1545	EPS Backup Channel Lost	Warning	PC 3.x
40440	1	Fault Status Gas Bitmap 10	1546	EPS Main Channel Lost	Warning	PC 3.x
40440	2	Fault Status Gas Bitmap 10	1579	Continuous_Light_Knock_Error_12_(B6)	Shutdown w/Cooldown	PC 3.x
40440	3	Fault Status Gas Bitmap 10	1581	Continuous_Light_Knock_Error_14_(B7)	Shutdown w/Cooldown	PC 3.x
40440	4	Fault Status Gas Bitmap 10	1582	Continuous_Light_Knock_Error_16_(B8)	Shutdown w/Cooldown	PC 3.x
40440	5	Fault Status Gas Bitmap 10	1583	Heavy_Knock_Error_16_(B8)	Shutdown w/Cooldown	PC 3.x
40440	6	Fault Status Gas Bitmap 10	1587	Continuous_Light_Knock_Error_17_(A9)	Shutdown w/Cooldown	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40440	7	Fault Status Gas Bitmap 10	1588	Heavy_Knock_Error_17_(A9)	Shutdown w/Cooldown	PC 3.x
40440	8	Fault Status Gas Bitmap 10	1593	Continuous_Light_Knock_Error_18_(B9)	Shutdown w/Cooldown	PC 3.x
40440	9	Fault Status Gas Bitmap 10	1618	Exhaust Gas Temp, Cyl 1 (A1) OORH	Warning	PC 3.x
40440	10	Fault Status Gas Bitmap 10	1619	Exhaust Gas Temp, Cyl 4 (B2) OORH	Warning	PC 3.x
40440	11	Fault Status Gas Bitmap 10	1636	Intake Manif Press 2 OORH	Warning	PC 3.x
40440	12	Fault Status Gas Bitmap 10	1637	Intake Manif Press 2 OORL	Warning	PC 3.x
40440	13	Fault Status Gas Bitmap 10	1737	CAN_Throttle_Internal_Failure_Error	Shutdown w/Cooldown	PC 3.x
40440	14	Fault Status Gas Bitmap 10	1738	CAN_Throttle_Internal_Fault_Error	Warning	PC 3.x
40440	15	Fault Status Gas Bitmap 10	1739	Engine Throttle Control Condition Exists	Warning	PC 3.x
40441	0	Fault Status Gas Bitmap 11	1741	CAN_Throttle_High_Temp_Warning_Error	Warning	PC 3.x
40441	1	Fault Status Gas Bitmap 11	1742	CAN_Throttle_Temp_Limiting_Error	Warning	PC 3.x
40441	2	Fault Status Gas Bitmap 11	1743	Throttle Ctrl 2 OOR High	Shutdown w/Cooldown	PC 3.x
40441	3	Fault Status Gas Bitmap 11	1744	Throttle Ctrl 2 OOR Low	Shutdown w/Cooldown	PC 3.x
40441	4	Fault Status Gas Bitmap 11	1745	Throttle Ctrl 2 Incorrect	Shutdown w/Cooldown	PC 3.x
40441	5	Fault Status Gas Bitmap 11	1746	Throttle Ctrl 2 Out of Adjustment	Shutdown w/Cooldown	PC 3.x
40441	6	Fault Status Gas Bitmap 11	1747	Throttle Ctrl 2 Bad Device	Shutdown w/Cooldown	PC 3.x
40441	7	Fault Status Gas Bitmap 11	1748	Throttle Ctrl 2 Root Unknown	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40441	8	Fault Status Gas Bitmap 11	1749	Throttle Ctrl 2 Condition Exists	Warning	PC 3.x
40441	9	Fault Status Gas Bitmap 11	1751	Throttle Ctrl 2 Warning High	Warning	PC 3.x
40441	10	Fault Status Gas Bitmap 11	1752	Throttle Ctrl 2 Moderate High	Warning	PC 3.x
40441	11	Fault Status Gas Bitmap 11	1753	Fuel Shutoff 2 OOR High	Warning	PC 3.x
40441	12	Fault Status Gas Bitmap 11	1754	Fuel Tmp 2 OOR High	Warning	PC 3.x
40441	13	Fault Status Gas Bitmap 11	1755	Fuel Tmp 2 OOR Low	Warning	PC 3.x
40441	14	Fault Status Gas Bitmap 11	1756	Gas Flow 2 OOR High	Warning	PC 3.x
40441	15	Fault Status Gas Bitmap 11	1757	Gas Flow 2 OOR Low	Warning	PC 3.x
40442	0	Fault Status Gas Bitmap 12	1758	Gas Flow 2 Incorrect Data	Warning	PC 3.x
40442	1	Fault Status Gas Bitmap 12	1759	FCV 2 Pos Feedback Incorrect	Shutdown w/Cooldown	PC 3.x
40442	2	Fault Status Gas Bitmap 12	1761	FCV_Actuator_Error_1761	Shutdown w/Cooldown	PC 3.x
40442	3	Fault Status Gas Bitmap 12	1984	Int Man 2 Tmp Moderate High	Warning	PC 3.x
40442	4	Fault Status Gas Bitmap 12	1765	FCV 2 In Pr OOR High	Warning	PC 3.x
40442	5	Fault Status Gas Bitmap 12	1766	FCV 2 In Pr OOR Low	Warning	PC 3.x
40442	6	Fault Status Gas Bitmap 12	1767	FCV 2 Out Pr OOR High	Warning	PC 3.x
40442	7	Fault Status Gas Bitmap 12	1768	FCV 2 Out Pr OOR Low	Warning	PC 3.x
40442	8	Fault Status Gas Bitmap 12	1769	E_Shutd Indication OORH	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40442	9	Fault Status Gas Bitmap 12	1771	E_Shutd Indication OORL	Warning	PC 3.x
40442	10	Fault Status Gas Bitmap 12	1772	Eng Derate Request OORH	Warning	PC 3.x
40442	11	Fault Status Gas Bitmap 12	1773	Eng Derate Request OORL	Warning	PC 3.x
40442	12	Fault Status Gas Bitmap 12	1774	Oil Priming Pump OORH	Warning	PC 3.x
40442	13	Fault Status Gas Bitmap 12	1775	Oil Priming Pump OORL	Warning	PC 3.x
40442	14	Fault Status Gas Bitmap 12	3362	Power Conservation Control OORH	Warning	PC 3.x
40442	15	Fault Status Gas Bitmap 12	3363	Power Conservation Control OORL	Warning	PC 3.x
40443	0	Fault Status Gas Bitmap 13	1778	Engine_Heater_Control_Driver_High_Error	Warning	PC 3.x
40443	1	Fault Status Gas Bitmap 13	1779	Engine_Heater_Control_Driver_Low_Error	Warning	PC 3.x
40443	2	Fault Status Gas Bitmap 13	1781	Shutd Request OOR High	Warning	PC 3.x
40443	3	Fault Status Gas Bitmap 13	1782	Shutd Request OOR Low	Warning	PC 3.x
40443	4	Fault Status Gas Bitmap 13	1783	Coolant_Pump_Control_Driver_High_Error	Warning	PC 3.x
40443	5	Fault Status Gas Bitmap 13	1784	Coolant_Pump_Control_Driver_Low_Error	Warning	PC 3.x
40443	6	Fault Status Gas Bitmap 13	1785	Oil_Priming_Pump_Manual_Override_Input_On	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40443	7	Fault Status Gas Bitmap 13	1786	Oil_Priming_Pump_Stuck_On_Error	Warning	PC 3.x
40443	8	Fault Status Gas Bitmap 13	1787	Post_Lube_Oil_Priming_Error	Warning	PC 3.x
40443	9	Fault Status Gas Bitmap 13	1788	Maintenance_Lube_Oil_Priming_Error	Warning	PC 3.x
40443	10	Fault Status Gas Bitmap 13	1789	Pre_Start_Lube_Oil_Priming_Error	Shutdown w/Cooldown	PC 3.x
40443	11	Fault Status Gas Bitmap 13	1791	Failure_To_Meet_Load_Speed_Error	Shutdown w/Cooldown	PC 3.x
40443	12	Fault Status Gas Bitmap 13	1792	Idle when CB Closed	Warning	PC 3.x
40443	13	Fault Status Gas Bitmap 13	1793	Speed/Posit sensor out of Adj	Warning	PC 3.x
40443	14	Fault Status Gas Bitmap 13	1794	Fire Detected	Shutdown w/Cooldown	PC 3.x
40443	15	Fault Status Gas Bitmap 13	1795	Compressor_Bypass_Position_High_Error	Warning	PC 3.x
40444	0	Fault Status Gas Bitmap 14	1796	Compressor_Bypass_Position_Low_Error	Warning	PC 3.x
40444	1	Fault Status Gas Bitmap 14	1797	Compressor Bypass ctrl OORH	Warning	PC 3.x
40444	2	Fault Status Gas Bitmap 14	1798	Compressor Bypass ctrl OORL	Warning	PC 3.x
40444	3	Fault Status Gas Bitmap 14	1799	CB_Position_Err_Status	Warning	PC 3.x
40444	4	Fault Status Gas Bitmap 14	1811	HIGH_SIDE_DRV2_High_Control_Error (VPS)	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40444	5	Fault Status Gas Bitmap 14	1812	HIGH_SIDE_DRV2_Low_Control_Error (VPS)	Warning	PC 3.x
40444	6	Fault Status Gas Bitmap 14	1813	Valve_Proving_System_Test_Failed_Warning_Error	Warning	PC 3.x
40444	7	Fault Status Gas Bitmap 14	1814	Valve_Proving_System_Test_Failed_Shutdown_Error	Shutdown w/Cooldown	PC 3.x
40444	8	Fault Status Gas Bitmap 14	1815	RLY14_High_Control_Error	Warning	PC 3.x
40444	9	Fault Status Gas Bitmap 14	1816	Oil_PreHtr Ctrl OOR Low	Warning	PC 3.x
40444	10	Fault Status Gas Bitmap 14	1817	Oil_Pre-Heater_Tripped_Error	Warning	PC 3.x
40444	11	Fault Status Gas Bitmap 14	1818	Oil_Pre-Heater_Not_Warming_Error	Warning	PC 3.x
40444	12	Fault Status Gas Bitmap 14	1819	Common AC Aux CB tripped	Warning	PC 3.x
40444	13	Fault Status Gas Bitmap 14	1821	Min_FSO_Speed_Error	Shutdown w/Cooldown	PC 3.x
40444	14	Fault Status Gas Bitmap 14	1822	LT Coolant Level Low Shutdown Error	Shutdown w/Cooldown	PC 3.x
40444	15	Fault Status Gas Bitmap 14	1823	LT Coolant Level Low Warning Error	Warning	PC 3.x
40445	0	Fault Status Gas Bitmap 15	1824	Idle_Rated_Trans_Oil_Temp_Low_Error	Warning	PC 3.x
40445	1	Fault Status Gas Bitmap 15	1825	Dirty_Oil_Level_Error	Warning	PC 3.x
40445	2	Fault Status Gas Bitmap 15	1826	ECM Software incompatible	Shutdown w/Cooldown	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40445	3	Fault Status Gas Bitmap 15	1827	Fuel_Inlet_Pressure_High_Error	Warning	PC 3.x
40445	4	Fault Status Gas Bitmap 15	1828	Fuel_Inlet_Pressure_Low_Error	Warning	PC 3.x
40445	5	Fault Status Gas Bitmap 15	1829	Vent_Gas_Valve_Error	Shutdown w/Cooldown	PC 3.x
40445	6	Fault Status Gas Bitmap 15	1831	Upstream_FSO_Valve_Error	Shutdown w/Cooldown	PC 3.x
40445	7	Fault Status Gas Bitmap 15	1832	Downstream_FSO_Valve_Error	Shutdown w/Cooldown	PC 3.x
40445	8	Fault Status Gas Bitmap 15	1833	Engine_Heater_Trip_Error	Warning	PC 3.x
40445	9	Fault Status Gas Bitmap 15	1834	Coolant_Pump_Trip_Error	Warning	PC 3.x
40445	10	Fault Status Gas Bitmap 15	1835	Oil_Priming_Pump_Tripped_Error	Warning	PC 3.x
40445	11	Fault Status Gas Bitmap 15	1836	LCP_(LT)_Low_Serious_Error	Shutdown w/Cooldown	PC 3.x
40445	12	Fault Status Gas Bitmap 15	1837	Permanent_FS_Cam_Sync_Lost_Error	Shutdown w/Cooldown	PC 3.x
40445	13	Fault Status Gas Bitmap 15	1838	Partial_Engine_Overload_Shutdown_Error	Shutdown w/Cooldown	PC 3.x
40445	14	Fault Status Gas Bitmap 15	1839	Fuel_Supply_Pressure_High_Error	Warning	PC 3.x
40445	15	Fault Status Gas Bitmap 15	1841	Fuel_Supply_Pressure_Low_Error	Warning	PC 3.x
40446	0	Fault Status Gas Bitmap 16	1842	Radiator_Fan_Trip_Error	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40446	1	Fault Status Gas Bitmap 16	1858	Exhaust Aft Inlet O2 OOR High	Warning	PC 3.x
40446	2	Fault Status Gas Bitmap 16	1859	Exhaust Aft Inlet O2 OOR Low	Warning	PC 3.x
40446	3	Fault Status Gas Bitmap 16	1861	Exhaust Aft Inlet O2 Incorrect	Warning	PC 3.x
40446	4	Fault Status Gas Bitmap 16	1862	Exhaust Aft Out O2 OOR High	Warning	PC 3.x
40446	5	Fault Status Gas Bitmap 16	1863	Exhaust Aft Outlet O2 OOR Low	Warning	PC 3.x
40446	6	Fault Status Gas Bitmap 16	1864	Exhaust Aft Outlet O2 Incorrect	Warning	PC 3.x
40446	7	Fault Status Gas Bitmap 16	1985	Int Man 3 Tmp Moderate High	Warning	PC 3.x
40446	8	Fault Status Gas Bitmap 16	1986	Int Man 4 Tmp Moderate High	Warning	PC 3.x
40446	9	Fault Status Gas Bitmap 16	2111	Coolant_Inlet_Temperature_(LT)_High_Error	Warning	PC 3.x
40446	10	Fault Status Gas Bitmap 16	2112	Coolant_Inlet_Temperature_(LT)_Low_Error	Warning	PC 3.x
40446	11	Fault Status Gas Bitmap 16	2113	CIT_(LT)_High_Warning_Error	Warning	PC 3.x
40446	12	Fault Status Gas Bitmap 16	2114	CIT_(LT)_High_Serious_Error	Shutdown w/Cooldown	PC 3.x
40446	13	Fault Status Gas Bitmap 16	2115	LT_Coolant_Pressure_High_Error	Warning	PC 3.x
40446	14	Fault Status Gas Bitmap 16	2116	LT_Coolant_Pressure_Low_Error	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40446	15	Fault Status Gas Bitmap 16	2117	LCP_(LT)_Low_Warning_Error	Warning	PC 3.x
40447	0	Fault Status Gas Bitmap 17	2121	Exhaust_Temp_1_(A1)_High_Warning_Error	Warning	PC 3.x
40447	1	Fault Status Gas Bitmap 17	2122	Exhaust_Temp_3_(A2)_High_Warning_Error	Warning	PC 3.x
40447	2	Fault Status Gas Bitmap 17	2123	Exhaust_Temp_5_(A3)_High_Warning_Error	Warning	PC 3.x
40447	3	Fault Status Gas Bitmap 17	2124	Exhaust_Temp_7_(A4)_High_Warning_Error	Warning	PC 3.x
40447	4	Fault Status Gas Bitmap 17	2125	Exhaust_Temp_9_(A5)_High_Warning_Error	Warning	PC 3.x
40447	5	Fault Status Gas Bitmap 17	2126	Exhaust_Temp_11_(A6)_High_Warning_Error	Warning	PC 3.x
40447	6	Fault Status Gas Bitmap 17	2127	Exhaust_Temp_13_(A7)_High_Warning_Error	Warning	PC 3.x
40447	7	Fault Status Gas Bitmap 17	2128	Exhaust_Temp_15_(A8)_High_Warning_Error	Warning	PC 3.x
40447	8	Fault Status Gas Bitmap 17	2129	Exhaust_Temp_17_(A9)_High_Warning_Error	Warning	PC 3.x
40447	9	Fault Status Gas Bitmap 17	2131	Exhaust_Temp_2_(B1)_High_Warning_Error	Warning	PC 3.x
40447	10	Fault Status Gas Bitmap 17	2132	Exhaust_Temp_4_(B2)_High_Warning_Error	Warning	PC 3.x
40447	11	Fault Status Gas Bitmap 17	2133	Exhaust_Temp_6_(B3)_High_Warning_Error	Warning	PC 3.x
40447	12	Fault Status Gas Bitmap 17	2134	Exhaust_Temp_8_(B4)_High_Warning_Error	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40447	13	Fault Status Gas Bitmap 17	2135	Exhaust_Temp_10_(B5)_High_Warning_Error	Warning	PC 3.x
40447	14	Fault Status Gas Bitmap 17	2136	Exhaust_Temp_12_(B6)_High_Warning_Error	Warning	PC 3.x
40447	15	Fault Status Gas Bitmap 17	2137	Exhaust_Temp_14_(B7)_High_Warning_Error	Warning	PC 3.x
40448	0	Fault Status Gas Bitmap 18	2138	Exhaust_Temp_16_(B8)_High_Warning_Error	Warning	PC 3.x
40448	1	Fault Status Gas Bitmap 18	2139	Exhaust_Temp_18_(B9)_High_Warning_Error	Warning	PC 3.x
40448	2	Fault Status Gas Bitmap 18	2141	Start_Air_Pressure_High_Error	Warning	PC 3.x
40448	3	Fault Status Gas Bitmap 18	2142	Start_Air_Pressure_Low_Error	Warning	PC 3.x
40448	4	Fault Status Gas Bitmap 18	2143	SAP_Overpressure_Error	Warning	PC 3.x
40448	5	Fault Status Gas Bitmap 18	2144	Exhaust Temp 16 (B8) High Serious Error	Shutdown w/Cooldown	PC 3.x
40448	6	Fault Status Gas Bitmap 18	2145	Exhaust Temp 18 (B9) High Serious Error	Shutdown w/Cooldown	PC 3.x
40448	7	Fault Status Gas Bitmap 18	2146	EGT 17 (A9) OOR Low	Warning	PC 3.x
40448	8	Fault Status Gas Bitmap 18	2147	EGT 18 (B9) OOR Low	Warning	PC 3.x
40448	9	Fault Status Gas Bitmap 18	2154	Oil_Filter_Outlet_Pressure_High_Error	Warning	PC 3.x
40448	10	Fault Status Gas Bitmap 18	2155	Oil_Filter_Outlet_Pressure_Low_Error	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40448	11	Fault Status Gas Bitmap 18	2157	Int Man 2 Tmp Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40448	12	Fault Status Gas Bitmap 18	2158	Int Man 3 Tmp Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40448	13	Fault Status Gas Bitmap 18	2159	Int Man 4 Tmp Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40448	14	Fault Status Gas Bitmap 18	2188	Exhaust O2 OOR High	Warning	PC 3.x
40448	15	Fault Status Gas Bitmap 18	2191	ST_Throttle_Press_Err_Status	Warning	PC 3.x
40449	0	Fault Status Gas Bitmap 19	2192	Exhaust O2 OOR Low	Warning	PC 3.x
40449	1	Fault Status Gas Bitmap 19	2217	RAM_Image_Word_Error	Warning	PC 3.x
40449	2	Fault Status Gas Bitmap 19	2219	Exhaust O2 Moderate High	Warning	PC 3.x
40449	3	Fault Status Gas Bitmap 19	2221	Exhaust O2 Moderate Low	Warning	PC 3.x
40449	4	Fault Status Gas Bitmap 19	2281	Knock 11 (A6) Moderate High	Shutdown w/Cooldown	PC 3.x
40449	5	Fault Status Gas Bitmap 19	2282	Knock 11 (A6) Critical High	Shutdown w/Cooldown	PC 3.x
40449	6	Fault Status Gas Bitmap 19	2298	Fuel Shutoff 2 OOR Low	Warning	PC 3.x
40449	7	Fault Status Gas Bitmap 19	2315	Red Lamp OOR High	Warning	PC 3.x
40449	8	Fault Status Gas Bitmap 19	2316	Amber Lamp OOR High	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40449	9	Fault Status Gas Bitmap 19	2317	Amber Lamp OOR Low	Warning	PC 3.x
40449	10	Fault Status Gas Bitmap 19	2427	Fuel_Outlet_Pressure_High_Error	Warning	PC 3.x
40449	11	Fault Status Gas Bitmap 19	2428	Fuel_Outlet_Pressure_Low_Error	Warning	PC 3.x
40449	12	Fault Status Gas Bitmap 19	2453	Total Real Power Circuit OORH	Warning	PC 3.x
40449	13	Fault Status Gas Bitmap 19	2454	Total Real Power Circuit OORL	Warning	PC 3.x
40449	14	Fault Status Gas Bitmap 19	2455	Speed_Bias_Low_Error	Warning	PC 3.x
40449	15	Fault Status Gas Bitmap 19	2456	Speed_Bias_High_Error	Warning	PC 3.x
40450	0	Fault Status Gas Bitmap 20	2457	Max_Total_Misfire_Error	Shutdown w/Cooldown	PC 3.x
40450	1	Fault Status Gas Bitmap 20	2458	Cylinder_2_(B1)_Total_Misfire_Error	Warning	PC 3.x
40450	2	Fault Status Gas Bitmap 20	2459	Cylinder_4_(B2)_Total_Misfire_Error	Warning	PC 3.x
40450	3	Fault Status Gas Bitmap 20	2461	Cylinder_6_(B3)_Total_Misfire_Error	Warning	PC 3.x
40450	4	Fault Status Gas Bitmap 20	2462	Cylinder_8_(B4)_Total_Misfire_Error	Warning	PC 3.x
40450	5	Fault Status Gas Bitmap 20	2463	Cylinder_10_(B5)_Total_Misfire_Error	Warning	PC 3.x
40450	6	Fault Status Gas Bitmap 20	2464	Cylinder_12_(B6)_Total_Misfire_Error	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40450	7	Fault Status Gas Bitmap 20	2465	Cylinder_14_(B7)_Total_Misfire_Error	Warning	PC 3.x
40450	8	Fault Status Gas Bitmap 20	2466	Cylinder_16_(B8)_Total_Misfire_Error	Warning	PC 3.x
40450	9	Fault Status Gas Bitmap 20	2467	Cylinder_18_(B9)_Total_Misfire_Error	Warning	PC 3.x
40450	10	Fault Status Gas Bitmap 20	2469	Cylinder_1_(A1)_Total_Misfire_Error	Warning	PC 3.x
40450	11	Fault Status Gas Bitmap 20	2471	Cylinder_3_(A2)_Total_Misfire_Error	Warning	PC 3.x
40450	12	Fault Status Gas Bitmap 20	2472	Cylinder_5_(A3)_Total_Misfire_Error	Warning	PC 3.x
40450	13	Fault Status Gas Bitmap 20	2473	Cylinder_7_(A4)_Total_Misfire_Error	Warning	PC 3.x
40450	14	Fault Status Gas Bitmap 20	2475	Cylinder_9_(A5)_Total_Misfire_Error	Warning	PC 3.x
40450	15	Fault Status Gas Bitmap 20	2476	Cylinder_11_(A6)_Total_Misfire_Error	Warning	PC 3.x
40451	0	Fault Status Gas Bitmap 21	2477	Cylinder_13_(A7)_Total_Misfire_Error	Warning	PC 3.x
40451	1	Fault Status Gas Bitmap 21	2478	Cylinder_15_(A8)_Total_Misfire_Error	Warning	PC 3.x
40451	2	Fault Status Gas Bitmap 21	2479	Cylinder_17_(A9)_Total_Misfire_Error	Warning	PC 3.x
40451	3	Fault Status Gas Bitmap 21	2482	Start_Before_Ready_Error	Shutdown w/Cooldown	PC 3.x
40451	4	Fault Status Gas Bitmap 21	2483	Continuous_Starter_Failure_Error	Shutdown w/Cooldown	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40451	5	Fault Status Gas Bitmap 21	2484	Exhaust Temperature 1 (A1) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40451	6	Fault Status Gas Bitmap 21	2485	Exhaust Temperature 3 (A2) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40451	7	Fault Status Gas Bitmap 21	2486	Exhaust Temperature 5 (A3) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40451	8	Fault Status Gas Bitmap 21	2487	Exhaust Temperature 7 (A4) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40451	9	Fault Status Gas Bitmap 21	2488	Exhaust Temperature 9 (A5) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40451	10	Fault Status Gas Bitmap 21	2489	Exhaust Temperature 11 (A6) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40451	11	Fault Status Gas Bitmap 21	2491	Exhaust Temperature 13 (A7) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40451	12	Fault Status Gas Bitmap 21	2492	Exhaust Temperature 15 (A8) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40451	13	Fault Status Gas Bitmap 21	2493	Exhaust Temperature 17 (A9) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40451	14	Fault Status Gas Bitmap 21	2494	Exhaust Temperature 2 (B1) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40451	15	Fault Status Gas Bitmap 21	2495	Exhaust Temperature 4 (B2) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40452	0	Fault Status Gas Bitmap 22	2496	Exhaust Temperature 6 (B3) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40452	1	Fault Status Gas Bitmap 22	2497	Exhaust Temperature 8 (B4) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40452	2	Fault Status Gas Bitmap 22	2498	Exhaust Temperature 10 (B5) Abnormal Rate	Shutdown w/Cooldown	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40452	3	Fault Status Gas Bitmap 22	2499	Exhaust Temperature 12 (B6) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40452	4	Fault Status Gas Bitmap 22	2511	Exhaust Temperature 14 (B7) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40452	5	Fault Status Gas Bitmap 22	2512	Exhaust Temperature 16 (B8) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40452	6	Fault Status Gas Bitmap 22	2513	Exhaust Temperature 18 (B9) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40452	7	Fault Status Gas Bitmap 22	2517	Compressor_Outlet_Pressure_High_Error	Warning	PC 3.x
40452	8	Fault Status Gas Bitmap 22	2518	Compressor_Outlet_Pressure_Low_Error	Warning	PC 3.x
40452	9	Fault Status Gas Bitmap 22	2521	Bank_Id_Error	Shutdown w/Cooldown	PC 3.x
40452	10	Fault Status Gas Bitmap 22	2522	Continuous_Light_Knock_Error_1_(A1)	Shutdown w/Cooldown	PC 3.x
40452	11	Fault Status Gas Bitmap 22	2523	Continuous_Light_Knock_Error_2_(B1)	Shutdown w/Cooldown	PC 3.x
40452	12	Fault Status Gas Bitmap 22	2524	Continuous_Light_Knock_Error_3_(A2)	Shutdown w/Cooldown	PC 3.x
40452	13	Fault Status Gas Bitmap 22	2525	Continuous_Light_Knock_Error_4_(B2)	Shutdown w/Cooldown	PC 3.x
40452	14	Fault Status Gas Bitmap 22	2526	Continuous_Light_Knock_Error_5_(A3)	Shutdown w/Cooldown	PC 3.x
40452	15	Fault Status Gas Bitmap 22	2527	Continuous_Light_Knock_Error_6_(B3)	Shutdown w/Cooldown	PC 3.x
40453	0	Fault Status Gas Bitmap 23	2528	Continuous_Light_Knock_Error_7_(A4)	Shutdown w/Cooldown	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40453	1	Fault Status Gas Bitmap 23	2529	Continuous_Light_Knock_Error_8_(B4)	Shutdown w/Cooldown	PC 3.x
40453	2	Fault Status Gas Bitmap 23	2531	Continuous_Light_Knock_Error_9_(A5)	Shutdown w/Cooldown	PC 3.x
40453	3	Fault Status Gas Bitmap 23	2532	Continuous_Light_Knock_Error_10_(B5)	Shutdown w/Cooldown	PC 3.x
40453	4	Fault Status Gas Bitmap 23	2544	ECM_Overtemp_Error	Shutdown w/Cooldown	PC 3.x
40453	5	Fault Status Gas Bitmap 23	2567	DG_Air_Compressor_Trip_Error	Warning	PC 3.x
40453	6	Fault Status Gas Bitmap 23	2643	Throttle Pos 2 Feedback OOR High	Warning	PC 3.x
40453	7	Fault Status Gas Bitmap 23	2644	Throttle Pos 2 Feedback OOR Low	Warning	PC 3.x
40453	9	Fault Status Gas Bitmap 23	2724	Gas Supply Pr Moderate High	Warning	PC 3.x
40453	10	Fault Status Gas Bitmap 23	2725	Gas Supply Pr Moderate Low	Warning	PC 3.x
40453	11	Fault Status Gas Bitmap 23	2737	Exh Gas Tmp Critical High	Shutdown w/Cooldown	PC 3.x
40453	12	Fault Status Gas Bitmap 23	2766	Bank_A_CCD_Failed_Error	Shutdown w/Cooldown	PC 3.x
40453	13	Fault Status Gas Bitmap 23	2767	Bank_B_CCD_Failed_Error	Shutdown w/Cooldown	PC 3.x
40453	14	Fault Status Gas Bitmap 23	2768	CAN Parent Communication Incorrect	Shutdown w/Cooldown	PC 3.x
40453	15	Fault Status Gas Bitmap 23	2769	CAN Child Com Incorrect	Shutdown w/Cooldown	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40454	0	Fault Status Gas Bitmap 24	2789	COT_Low_Error	Warning	PC 3.x
40454	1	Fault Status Gas Bitmap 24	2793	COT_Low_Serious_Error	Shutdown w/Cooldown	PC 3.x
40454	2	Fault Status Gas Bitmap 24	2794	Ign Shutd Relay OOR High	Warning	PC 3.x
40454	3	Fault Status Gas Bitmap 24	2795	Ign Shutd Relay OOR Low	Warning	PC 3.x
40454	4	Fault Status Gas Bitmap 24	2796	Partial_Engine_Overload_Warning_Error	Warning	PC 3.x
40454	5	Fault Status Gas Bitmap 24	2797	Inlet Gas Diff Pressure OOR High	Warning	PC 3.x
40454	6	Fault Status Gas Bitmap 24	2798	Inlet Gas Diff Pressure OOR Low	Warning	PC 3.x
40454	7	Fault Status Gas Bitmap 24	2799	IMOP_Compressor_Outlet_Pressure_Delta_Error	Shutdown w/Cooldown	PC 3.x
40454	8	Fault Status Gas Bitmap 24	2811	IMOP_Compressor_Outlet_Pressure_Maximum_Error	Shutdown w/Cooldown	PC 3.x
40454	9	Fault Status Gas Bitmap 24	2837	Exhaust_Temp_1_(A1)_Deviation_Error	Warning	PC 3.x
40454	10	Fault Status Gas Bitmap 24	2838	Exhaust_Temp_3_(A2)_Deviation_Error	Warning	PC 3.x
40454	11	Fault Status Gas Bitmap 24	2839	Exhaust_Temp_5_(A3)_Deviation_Error	Warning	PC 3.x
40454	12	Fault Status Gas Bitmap 24	2841	Exhaust_Temp_7_(A4)_Deviation_Error	Warning	PC 3.x
40454	13	Fault Status Gas Bitmap 24	2842	Exhaust_Temp_9_(A5)_Deviation_Error	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40454	14	Fault Status Gas Bitmap 24	2843	Exhaust_Temp_11_(A6)_Deviation_Error	Warning	PC 3.x
40454	15	Fault Status Gas Bitmap 24	2844	Exhaust_Temp_13_(A7)_Deviation_Error	Warning	PC 3.x
40455	0	Fault Status Gas Bitmap 25	2845	Exhaust_Temp_15_(A8)_Deviation_Error	Warning	PC 3.x
40455	1	Fault Status Gas Bitmap 25	2846	Exhaust_Temp_17_(A9)_Deviation_Error	Warning	PC 3.x
40455	2	Fault Status Gas Bitmap 25	2847	Exhaust_Temp_2_(B1)_Deviation_Error	Warning	PC 3.x
40455	3	Fault Status Gas Bitmap 25	2848	Exhaust_Temp_4_(B2)_Deviation_Error	Warning	PC 3.x
40455	4	Fault Status Gas Bitmap 25	2849	Exhaust_Temp_6_(B3)_Deviation_Error	Warning	PC 3.x
40455	5	Fault Status Gas Bitmap 25	2851	Exhaust_Temp_8_(B4)_Deviation_Error	Warning	PC 3.x
40455	6	Fault Status Gas Bitmap 25	2852	Exhaust_Temp_10_(B5)_Deviation_Error	Warning	PC 3.x
40455	7	Fault Status Gas Bitmap 25	2853	Exhaust_Temp_12_(B6)_Deviation_Error	Warning	PC 3.x
40455	8	Fault Status Gas Bitmap 25	2854	Exhaust_Temp_14_(B7)_Deviation_Error	Warning	PC 3.x
40455	9	Fault Status Gas Bitmap 25	2855	Exhaust_Temp_16_(B8)_Deviation_Error	Warning	PC 3.x
40455	10	Fault Status Gas Bitmap 25	2856	Exhaust_Temp_18_(B9)_Deviation_Error	Warning	PC 3.x
40455	11	Fault Status Gas Bitmap 25	2857	Turbo_1_Overspeed_Critical_Error	Shutdown w/Cooldown	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40455	12	Fault Status Gas Bitmap 25	2858	Turbo_2_Overspeed_Critical_Error	Shutdown w/Cooldown	PC 3.x
40455	13	Fault Status Gas Bitmap 25	2859	Alt Heater Ctrl OOR High	Warning	PC 3.x
40455	14	Fault Status Gas Bitmap 25	2861	Alt Heater Ctrl OOR Low	Warning	PC 3.x
40455	15	Fault Status Gas Bitmap 25	2862	Gen Alternator 1st Start Cond Exists	Warning	PC 3.x
40456	0	Fault Status Gas Bitmap 26	2863	Genset to Engine Com Incorrect	Shutdown w/Cooldown	PC 3.x
40456	1	Fault Status Gas Bitmap 26	2864	FSO_NON_High_Control_Error	Shutdown w/Cooldown	PC 3.x
40456	2	Fault Status Gas Bitmap 26	3364	Power Conservation Control Cond Exists	Warning	PC 3.x
40456	3	Fault Status Gas Bitmap 26	2866	FCV_Position_High_Error	Warning	PC 3.x
40456	4	Fault Status Gas Bitmap 26	2867	FCV_Position_Low_Error	Warning	PC 3.x
40456	5	Fault Status Gas Bitmap 26	2868	Engine_Heater_Over-Temperature_Alarm_Error	Warning	PC 3.x
40456	6	Fault Status Gas Bitmap 26	2869	HT Cool Temp Driver OOR High	Warning	PC 3.x
40456	7	Fault Status Gas Bitmap 26	2871	HT Cool Temp Driver OOR Low	Warning	PC 3.x
40456	8	Fault Status Gas Bitmap 26	2872	HT Cool Temp Driver Cond Exists	Warning	PC 3.x
40456	9	Fault Status Gas Bitmap 26	2873	LT Cool Temp Driver OOR High	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40456	10	Fault Status Gas Bitmap 26	2874	LT Cool Temp Driver OOR Low	Warning	PC 3.x
40456	11	Fault Status Gas Bitmap 26	2875	LT Cool Temp Driver Cond Exists	Warning	PC 3.x
40456	12	Fault Status Gas Bitmap 26	2876	Comp_Surge_Shutdown_Error	Shutdown w/Cooldown	PC 3.x
40456	13	Fault Status Gas Bitmap 26	2877	Comp_Surge_Derate_Error	Warning	PC 3.x
40456	14	Fault Status Gas Bitmap 26	2994	MC68302_Error	Warning	PC 3.x
40456	15	Fault Status Gas Bitmap 26	2995	Int Man Pressure 1 Critical High	Shutdown w/Cooldown	PC 3.x
40457	0	Fault Status Gas Bitmap 27	2996	Int Man Pressure 1 Moderate High	Warning	PC 3.x
40457	1	Fault Status Gas Bitmap 27	2997	Exhaust O2 Critical Low	Shutdown w/Cooldown	PC 3.x
40457	2	Fault Status Gas Bitmap 27	3111	Excessive_Mech_Vibration_1_(A1)	Shutdown w/Cooldown	PC 3.x
40457	3	Fault Status Gas Bitmap 27	3112	Excessive_Mech_Vibration_2_(B1)	Shutdown w/Cooldown	PC 3.x
40457	4	Fault Status Gas Bitmap 27	3113	Excessive_Mech_Vibration_3_(A2)	Shutdown w/Cooldown	PC 3.x
40457	5	Fault Status Gas Bitmap 27	3114	Excessive_Mech_Vibration_4_(B2)	Shutdown w/Cooldown	PC 3.x
40457	6	Fault Status Gas Bitmap 27	3115	Excessive_Mech_Vibration_5_(A3)	Shutdown w/Cooldown	PC 3.x
40457	7	Fault Status Gas Bitmap 27	3116	Excessive_Mech_Vibration_6_(B3)	Shutdown w/Cooldown	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40457	8	Fault Status Gas Bitmap 27	3117	Excessive_Mech_Vibration_7_(A4)	Shutdown w/Cooldown	PC 3.x
40457	9	Fault Status Gas Bitmap 27	3118	Excessive_Mech_Vibration_8_(B4)	Shutdown w/Cooldown	PC 3.x
40457	10	Fault Status Gas Bitmap 27	3119	Excessive_Mech_Vibration_9_(A5)	Shutdown w/Cooldown	PC 3.x
40457	11	Fault Status Gas Bitmap 27	3121	Excessive_Mech_Vibration_10_(B5)	Shutdown w/Cooldown	PC 3.x
40457	12	Fault Status Gas Bitmap 27	3122	Excessive_Mech_Vibration_11_(A6)	Shutdown w/Cooldown	PC 3.x
40457	13	Fault Status Gas Bitmap 27	3123	Excessive_Mech_Vibration_12_(B6)	Shutdown w/Cooldown	PC 3.x
40457	14	Fault Status Gas Bitmap 27	3124	Excessive_Mech_Vibration_13_(A7)	Shutdown w/Cooldown	PC 3.x
40457	15	Fault Status Gas Bitmap 27	3125	Excessive_Mech_Vibration_14_(B7)	Shutdown w/Cooldown	PC 3.x
40458	0	Fault Status Gas Bitmap 28	3126	Excessive_Mech_Vibration_15_(A8)	Shutdown w/Cooldown	PC 3.x
40458	1	Fault Status Gas Bitmap 28	3127	Excessive_Mech_Vibration_16_(B8)	Shutdown w/Cooldown	PC 3.x
40458	2	Fault Status Gas Bitmap 28	3128	Excessive_Mech_Vibration_17_(A9)	Shutdown w/Cooldown	PC 3.x
40458	3	Fault Status Gas Bitmap 28	3129	Excessive_Mech_Vibration_18_(B9)	Shutdown w/Cooldown	PC 3.x
40458	4	Fault Status Gas Bitmap 28	1275	Knock Cyl 10 (B5) OORL	Warning	PC 3.x
40458	5	Fault Status Gas Bitmap 28	1277	Knock Cyl 11 (A6) OORL	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40458	6	Fault Status Gas Bitmap 28	1282	Knock Cyl 12 (B6) OORL	Warning	PC 3.x
40458	7	Fault Status Gas Bitmap 28	1287	Knock Cyl 13 (A7) OORL	Warning	PC 3.x
40458	8	Fault Status Gas Bitmap 28	1292	Knock Cyl 14 (B7) OORL	Warning	PC 3.x
40458	9	Fault Status Gas Bitmap 28	1297	Knock Cyl 15 (A8) OORL	Warning	PC 3.x
40458	10	Fault Status Gas Bitmap 28	1584	Knock Cyl 16 (B8) OORL	Warning	PC 3.x
40458	11	Fault Status Gas Bitmap 28	1589	Knock Cyl 17 (A9) OORL	Warning	PC 3.x
40458	12	Fault Status Gas Bitmap 28	1338	Knock Cyl 18 (B9) OORL	Warning	PC 3.x
40459	0	Fault Status Gas Bitmap 29	189	HT Coolant Temperature Root Cause Unknown	Shutdown w/Cooldown	PC 3.x
40459	1	Fault Status Gas Bitmap 29	229	HT Coolant Pressure Incorrect	Warning	PC 3.x
40459	2	Fault Status Gas Bitmap 29	334	HT Coolant Temperature Incorrect	Warning	PC 3.x
40459	4	Fault Status Gas Bitmap 29	831	Spark Plug 1 (A1) OORL	Warning	PC 3.x
40459	5	Fault Status Gas Bitmap 29	832	Spark Plug 2 (B1) OORL	Warning	PC 3.x
40459	6	Fault Status Gas Bitmap 29	833	Spark Plug 3 (A2) OORL	Warning	PC 3.x
40459	7	Fault Status Gas Bitmap 29	834	Spark Plug 4 (B2) OORL	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40459	8	Fault Status Gas Bitmap 29	835	Spark Plug 5 (A3) OORL	Warning	PC 3.x
40459	9	Fault Status Gas Bitmap 29	836	Spark Plug 6 (B3) OORL	Warning	PC 3.x
40459	10	Fault Status Gas Bitmap 29	837	Spark Plug 7 (A4) OORL	Warning	PC 3.x
40459	11	Fault Status Gas Bitmap 29	838	Spark Plug 8 (B4) OORL	Warning	PC 3.x
40459	12	Fault Status Gas Bitmap 29	839	Spark Plug 9 (A5) OORL	Warning	PC 3.x
40459	13	Fault Status Gas Bitmap 29	841	Spark Plug 10 (B5) OORL	Warning	PC 3.x
40459	14	Fault Status Gas Bitmap 29	842	Spark Plug 11 (A6) OORL	Warning	PC 3.x
40459	15	Fault Status Gas Bitmap 29	843	Spark Plug 12 (B6) OORL	Warning	PC 3.x
40460	0	Fault Status Gas Bitmap 30	844	Spark Plug 13 (A7) OORL	Warning	PC 3.x
40460	1	Fault Status Gas Bitmap 30	845	Spark Plug 14 (B7) OORL	Warning	PC 3.x
40460	2	Fault Status Gas Bitmap 30	846	Spark Plug 15 (A8) OORL	Warning	PC 3.x
40460	3	Fault Status Gas Bitmap 30	847	Spark Plug 16 (B8) OORL	Warning	PC 3.x
40460	4	Fault Status Gas Bitmap 30	848	Spark Plug 17 (A9) OORL	Warning	PC 3.x
40460	5	Fault Status Gas Bitmap 30	849	Spark Plug 18 (B9) OORL	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40460	7	Fault Status Gas Bitmap 30	891	Spark Plug 1 (A1) Root Cause Unknown	Warning	PC 3.x
40460	8	Fault Status Gas Bitmap 30	892	Spark Plug 2 (B1) Root Cause Unknown	Warning	PC 3.x
40460	9	Fault Status Gas Bitmap 30	893	Spark Plug 3 (A2) Root Cause Unknown	Warning	PC 3.x
40460	10	Fault Status Gas Bitmap 30	894	Spark Plug 4 (B2) Root Cause Unknown	Warning	PC 3.x
40460	11	Fault Status Gas Bitmap 30	895	Spark Plug 5 (A3) Root Cause Unknown	Warning	PC 3.x
40460	12	Fault Status Gas Bitmap 30	896	Spark Plug 6 (B3) Root Cause Unknown	Warning	PC 3.x
40460	13	Fault Status Gas Bitmap 30	897	Spark Plug 7 (A4) Root Cause Unknown	Warning	PC 3.x
40460	14	Fault Status Gas Bitmap 30	898	Spark Plug 8 (B4) Root Cause Unknown	Warning	PC 3.x
40460	15	Fault Status Gas Bitmap 30	899	Spark Plug 9 (A5) Root Cause Unknown	Warning	PC 3.x
40461	0	Fault Status Gas Bitmap 31	911	Spark Plug 10 (B5) Root Cause Unknown	Warning	PC 3.x
40461	1	Fault Status Gas Bitmap 31	912	Spark Plug 11 (A6) Root Cause Unknown	Warning	PC 3.x
40461	2	Fault Status Gas Bitmap 31	913	Spark Plug 12 (B6) Root Cause Unknown	Warning	PC 3.x
40461	3	Fault Status Gas Bitmap 31	914	Spark Plug 13 (A7) Root Cause Unknown	Warning	PC 3.x
40461	4	Fault Status Gas Bitmap 31	915	Spark Plug 14 (B7) Root Cause Unknown	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40461	5	Fault Status Gas Bitmap 31	916	Spark Plug 15 (A8) Root Cause Unknown	Warning	PC 3.x
40461	6	Fault Status Gas Bitmap 31	917	Spark Plug 16 (B8) Root Cause Unknown	Warning	PC 3.x
40461	7	Fault Status Gas Bitmap 31	918	Spark Plug 17 (A9) Root Cause Unknown	Warning	PC 3.x
40461	8	Fault Status Gas Bitmap 31	919	Spark Plug 18 (B9) Root Cause Unknown	Warning	PC 3.x
40461	10	Fault Status Gas Bitmap 31	1276	Knock Cyl 10 (B5) OORH	Warning	PC 3.x
40461	11	Fault Status Gas Bitmap 31	1278	Knock Cyl 11 (A6) OORH	Warning	PC 3.x
40461	12	Fault Status Gas Bitmap 31	1279	Knock 12 (B6) High Warning	Warning	PC 3.x
40461	13	Fault Status Gas Bitmap 31	1283	Knock Cyl 12 (B6) OORH	Warning	PC 3.x
40461	14	Fault Status Gas Bitmap 31	1284	Knock 13 (A7) High Warning	Warning	PC 3.x
40461	15	Fault Status Gas Bitmap 31	1288	Knock Cyl 13 (A7) OORH	Warning	PC 3.x
40462	0	Fault Status Gas Bitmap 32	1289	Knock 14 (B7) High Warning	Warning	PC 3.x
40462	1	Fault Status Gas Bitmap 32	1293	Knock Cyl 14 (B7) OORH	Warning	PC 3.x
40462	2	Fault Status Gas Bitmap 32	1294	Knock 15 (A8) High Warning	Warning	PC 3.x
40462	3	Fault Status Gas Bitmap 32	1298	Knock Cyl 15 (A8) OORH	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40462	4	Fault Status Gas Bitmap 32	1299	Knock 16 (B8) High Warning	Warning	PC 3.x
40462	6	Fault Status Gas Bitmap 32	1339	Knock Cyl 18 (B9) OORH	Warning	PC 3.x
40462	7	Fault Status Gas Bitmap 32	1352	Knock 20 (B10) High Warning	Warning	PC 3.x
40462	8	Fault Status Gas Bitmap 32	1353	Continuous_Light_Knock_Error_20_(B10)	Shutdown w/Cooldown	PC 3.x
40462	9	Fault Status Gas Bitmap 32	1354	Heavy_Knock_Error_20_(B10)	Shutdown w/Cooldown	PC 3.x
40462	10	Fault Status Gas Bitmap 32	1355	Knock Cyl 20 (B10) OORL	Warning	PC 3.x
40462	11	Fault Status Gas Bitmap 32	1356	Knock Cyl 20 (B10) OORH	Warning	PC 3.x
40462	12	Fault Status Gas Bitmap 32	1572	Continuous_Light_Knock_Error_19_(A10)	Shutdown w/Cooldown	PC 3.x
40462	13	Fault Status Gas Bitmap 32	1574	Heavy_Knock_Error_19_(A10)	Shutdown w/Cooldown	PC 3.x
40462	14	Fault Status Gas Bitmap 32	1575	Knock Cyl 19 (A10) OORL	Warning	PC 3.x
40462	15	Fault Status Gas Bitmap 32	1576	Knock Cyl 19 (A10) OORH	Warning	PC 3.x
40463	0	Fault Status Gas Bitmap 33	1585	Knock Cyl 16 (B8) OORH	Warning	PC 3.x
40463	1	Fault Status Gas Bitmap 33	1586	Knock 17 (A9) High Warning	Warning	PC 3.x
40463	2	Fault Status Gas Bitmap 33	1591	Knock Cyl 17 (A9) OORH	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40463	3	Fault Status Gas Bitmap 33	1592	Knock 18 (B9) High Warning	Warning	PC 3.x
40463	4	Fault Status Gas Bitmap 33	1594	Knock 19 (A10) High Warning	Warning	PC 3.x
40463	6	Fault Status Gas Bitmap 33	2193	HT Coolant Level Moderate High	Warning	PC 3.x
40463	7	Fault Status Gas Bitmap 33	2231	Knock Cyl 1 (A1) OORH	Warning	PC 3.x
40463	8	Fault Status Gas Bitmap 33	2232	Knock Cyl 2 (B1) OORH	Warning	PC 3.x
40463	9	Fault Status Gas Bitmap 33	2233	Knock Cyl 3 (A2) OORH	Warning	PC 3.x
40463	10	Fault Status Gas Bitmap 33	2234	Knock Cyl 4 (B2) OORH	Warning	PC 3.x
40463	11	Fault Status Gas Bitmap 33	2235	Knock Cyl 5 (A3) OORH	Warning	PC 3.x
40463	12	Fault Status Gas Bitmap 33	2236	Knock Cyl 6 (B3) OORH	Warning	PC 3.x
40463	13	Fault Status Gas Bitmap 33	2237	Knock Cyl 7 (A4) OORH	Warning	PC 3.x
40463	14	Fault Status Gas Bitmap 33	2238	Knock Cyl 8 (B4) OORH	Warning	PC 3.x
40463	15	Fault Status Gas Bitmap 33	2239	Knock Cyl 9 (A5) OORH	Warning	PC 3.x
40464	0	Fault Status Gas Bitmap 34	2279	Knock 11 (A6) High Warning	Warning	PC 3.x
40464	1	Fault Status Gas Bitmap 34	2431	Knock 1 (A1) High Warning	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40464	2	Fault Status Gas Bitmap 34	2432	Knock 2 (B1) High Warning	Warning	PC 3.x
40464	3	Fault Status Gas Bitmap 34	2433	Knock 3 (A2) High Warning	Warning	PC 3.x
40464	4	Fault Status Gas Bitmap 34	2434	Knock 4 (B2) High Warning	Warning	PC 3.x
40464	5	Fault Status Gas Bitmap 34	2435	Knock 5 (A3) High Warning	Warning	PC 3.x
40464	6	Fault Status Gas Bitmap 34	2436	Knock 6 (B3) High Warning	Warning	PC 3.x
40464	7	Fault Status Gas Bitmap 34	2437	Knock 7 (A4) High Warning	Warning	PC 3.x
40464	8	Fault Status Gas Bitmap 34	2438	Knock 8 (B4) High Warning	Warning	PC 3.x
40464	9	Fault Status Gas Bitmap 34	2439	Knock 9 (A5) High Warning	Warning	PC 3.x
40464	10	Fault Status Gas Bitmap 34	2441	Knock 10 (B5) High Warning	Warning	PC 3.x
40464	11	Fault Status Gas Bitmap 34	2514	Exhaust Temperature 19 (A10) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40464	12	Fault Status Gas Bitmap 34	2515	Exhaust Temperature 20 (B10) Abnormal Rate	Shutdown w/Cooldown	PC 3.x
40464	13	Fault Status Gas Bitmap 34	2553	Engine Oil Level Low Warning Error	Warning	PC 3.x
40464	14	Fault Status Gas Bitmap 34	2568	Gas Supply Pressure Critical High	Shutdown w/Cooldown	PC 3.x
40464	15	Fault Status Gas Bitmap 34	2569	Gas Supply Pressure Critical Low	Shutdown w/Cooldown	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40465	0	Fault Status Gas Bitmap 35	2586	Spark Plug 1 (A1) High Warning	NONE	PC 3.x
40465	1	Fault Status Gas Bitmap 35	2587	Spark Plug 2 (B1) High Warning	NONE	PC 3.x
40465	2	Fault Status Gas Bitmap 35	2588	Spark Plug 3 (A2) High Warning	NONE	PC 3.x
40465	3	Fault Status Gas Bitmap 35	2589	Spark Plug 4 (B2) High Warning	NONE	PC 3.x
40465	4	Fault Status Gas Bitmap 35	2591	Spark Plug 5 (A3) High Warning	NONE	PC 3.x
40465	5	Fault Status Gas Bitmap 35	2592	Spark Plug 6 (B3) High Warning	NONE	PC 3.x
40465	6	Fault Status Gas Bitmap 35	2593	Spark Plug 1 (A1) Low Warning	NONE	PC 3.x
40465	7	Fault Status Gas Bitmap 35	2594	Spark Plug 2 (B1) Low Warning	NONE	PC 3.x
40465	8	Fault Status Gas Bitmap 35	2595	Spark Plug 3 (A2) Low Warning	NONE	PC 3.x
40465	9	Fault Status Gas Bitmap 35	2596	Spark Plug 4 (B2) Low Warning	NONE	PC 3.x
40465	10	Fault Status Gas Bitmap 35	2597	Spark Plug 5 (A3) Low Warning	NONE	PC 3.x
40465	11	Fault Status Gas Bitmap 35	2598	Spark Plug 6 (B3) Low Warning	NONE	PC 3.x
40465	12	Fault Status Gas Bitmap 35	2646	HT Coolant Temperature Condition Exists	Warning	PC 3.x
40466	0	Fault Status Gas Bitmap 36	3262	Spark Plug 7 (A4) High Warning	NONE	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40466	1	Fault Status Gas Bitmap 36	3263	Spark Plug 7 (A4) Low Warning	NONE	PC 3.x
40466	2	Fault Status Gas Bitmap 36	3264	Spark Plug 8 (B4) High Warning	NONE	PC 3.x
40466	3	Fault Status Gas Bitmap 36	3265	Spark Plug 8 (B4) Low Warning	NONE	PC 3.x
40466	4	Fault Status Gas Bitmap 36	3266	Spark Plug 9 (A5) High Warning	NONE	PC 3.x
40466	5	Fault Status Gas Bitmap 36	3267	Spark Plug 9 (A5) Low Warning	NONE	PC 3.x
40466	6	Fault Status Gas Bitmap 36	3268	Spark Plug 10 (B5) High Warning	NONE	PC 3.x
40466	7	Fault Status Gas Bitmap 36	3269	Spark Plug 10 (B5) Low Warning	NONE	PC 3.x
40466	8	Fault Status Gas Bitmap 36	3271	Spark Plug 11 (A6) High Warning	NONE	PC 3.x
40466	9	Fault Status Gas Bitmap 36	3272	Spark Plug 11 (A6) Low Warning	NONE	PC 3.x
40466	10	Fault Status Gas Bitmap 36	3273	Spark Plug 12 (B6) High Warning	NONE	PC 3.x
40466	11	Fault Status Gas Bitmap 36	3274	Spark Plug 12 (B6) Low Warning	NONE	PC 3.x
40466	12	Fault Status Gas Bitmap 36	3275	Spark Plug 13 (A7) High Warning	NONE	PC 3.x
40466	13	Fault Status Gas Bitmap 36	3276	Spark Plug 13 (A7) Low Warning	NONE	PC 3.x
40466	14	Fault Status Gas Bitmap 36	3277	Spark Plug 14 (B7) High Warning	NONE	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40466	15	Fault Status Gas Bitmap 36	3278	Spark Plug 14 (B7) Low Warning	NONE	PC 3.x
40467	0	Fault Status Gas Bitmap 37	3279	Spark Plug 15 (A8) High Warning	NONE	PC 3.x
40467	1	Fault Status Gas Bitmap 37	3281	Spark Plug 15 (A8) Low Warning	NONE	PC 3.x
40467	2	Fault Status Gas Bitmap 37	3282	Spark Plug 16 (B8) High Warning	NONE	PC 3.x
40467	3	Fault Status Gas Bitmap 37	3283	Spark Plug 16 (B8) Low Warning	NONE	PC 3.x
40467	4	Fault Status Gas Bitmap 37	3284	Spark Plug 17 (A9) High Warning	NONE	PC 3.x
40467	5	Fault Status Gas Bitmap 37	3285	Spark Plug 17 (A9) Low Warning	NONE	PC 3.x
40467	6	Fault Status Gas Bitmap 37	3286	Spark Plug 18 (B9) High Warning	NONE	PC 3.x
40467	7	Fault Status Gas Bitmap 37	3287	Spark Plug 18 (B9) Low Warning	NONE	PC 3.x
40467	8	Fault Status Gas Bitmap 37	3288	Exhaust Aft Outlet Oxygen Relay OORH	Warning	PC 3.x
40467	9	Fault Status Gas Bitmap 37	3289	Exhaust Aft Outlet Oxygen Relay OORL	Warning	PC 3.x
40467	10	Fault Status Gas Bitmap 37	3291	Exhaust Aft Inlet Oxygen Relay OORH	Warning	PC 3.x
40467	11	Fault Status Gas Bitmap 37	3292	Exhaust Aft Inlet Oxygen Relay OORL	Warning	PC 3.x
40467	12	Fault Status Gas Bitmap 37	3293	Exhaust Oxygen Relay OORH	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40467	13	Fault Status Gas Bitmap 37	3294	Exhaust Oxygen Relay OORL	Warning	PC 3.x
40468	3	Fault Status Gas Bitmap 38	3365	External Air Pressure Low Warning Error	Warning	PC 3.x
40468	4	Fault Status Gas Bitmap 38	3384	Manifold_Absolute_Pressure_2_High_Error	Warning	PC 3.x
40468	5	Fault Status Gas Bitmap 38	3391	Manifold_Absolute_Pressure_2_Low_Error	Warning	PC 3.x
40468	6	Fault Status Gas Bitmap 38	3392	Int Man Pressure 2 Critical High	Shutdown w/Cooldown	PC 3.x
40468	7	Fault Status Gas Bitmap 38	3393	Int Man Pressure 2 Moderate High	Warning	PC 3.x
40468	9	Fault Status Gas Bitmap 38	3397	Low Gearbox Oil Pressure – Condition Exists	Shutdown	PC 3.x
40468	10	Fault Status Gas Bitmap 38	3398	High Gearbox Oil Temperature – Condition Exists	Shutdown w/Cooldown	PC 3.x
40468	11	Fault Status Gas Bitmap 38	3399	Differential Fault – Condition Exists	Shutdown	PC 3.x
40468	12	Fault Status Gas Bitmap 38	3411	DC Power Supply Fault – Condition Exists	Warning	PC 3.x
40468	13	Fault Status Gas Bitmap 38	3412	GIB Isolator Open Fault – Condition Exists	Warning	PC 3.x
40468	14	Fault Status Gas Bitmap 38	3413	Radiator Fan Trip Fault – Condition Exists	Warning	PC 3.x
40468	15	Fault Status Gas Bitmap 38	3414	Ventilator Fan Trip Fault – Condition Exists	Warning	PC 3.x
40469	0	Fault Status Gas Bitmap 39	3415	Louvres Closed Fault – Condition Exists	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40469	1	Fault Status Gas Bitmap 39	3416	Start System Fault – Condition Exists	Warning	PC 3.x
40469	2	Fault Status Gas Bitmap 39	3417	Alternator Heater Trip Fault – Condition Exists	Warning	PC 3.x
40469	4	Fault Status Gas Bitmap 39	9971	ECM Derate Fault	NONE	PC 3.x
40469	5	Fault Status Gas Bitmap 39	3479	Start–Inhibit Shutdown Fault	Shutdown	PC 3.x
40469	6	Fault Status Gas Bitmap 39	3481	Start–Inhibit Warning Fault Event	Warning	PC 3.x
40469	7	Fault Status Gas Bitmap 39	3483	High Alternator Temperature 1 Shutdown Fault	Shutdown	PC 3.x
40469	8	Fault Status Gas Bitmap 39	3484	High Alternator Temperature 2 Shutdown Fault	Shutdown	PC 3.x
40469	9	Fault Status Gas Bitmap 39	3485	High Alternator Temperature 3 Shutdown Fault	Shutdown	PC 3.x
40469	10	Fault Status Gas Bitmap 39	3486	High Drive End Bearing Temperature Shutdown Fault	Shutdown	PC 3.x
40469	11	Fault Status Gas Bitmap 39	3487	High Non–Drive End Bearing Temp Shutdown Fault	Shutdown	PC 3.x
40469	12	Fault Status Gas Bitmap 39	3482	Off Load Running Fault	Shutdown	PC 3.x
40470	0	Fault Status Gas Bitmap 40	3491	Oil Filter Restriction High	Shutdown w/Cooldown	PC 3.x
40470	1	Fault Status Gas Bitmap 40	2313	Fuel Control Valve Error	Warning	PC 3.x
40470	2	Fault Status Gas Bitmap 40	3475	Engine Electronic Fuel Valve #2 OORH	Warning	PC 3.x

Addr.	Bit#	Name	Fault Code	Event Name	Response	Control
40470	3	Fault Status Gas Bitmap 40	3476	Engine Electronic Fuel Valve #2 OORL	Warning	PC 3.x
40470	4	Fault Status Gas Bitmap 40	2812	Throttle Control Actuator Error	Shutdown w/Cooldown	PC 3.x
40470	5	Fault Status Gas Bitmap 40	3489	Compressor Bypass Actuator Error	Warning	PC 3.x
40470	6	Fault Status Gas Bitmap 40	3458	Knock Engine Derate	Warning	PC 3.x
40470	8	Fault Status Gas Bitmap 40	3499	Throttle Actuator 2- Special Instruction	Shutdown w/Cooldown	PC 3.x
40470	9	Fault Status Gas Bitmap 40	3511	Throttle Actuator 2- Shorted High	Shutdown w/Cooldown	PC 3.x
40470	10	Fault Status Gas Bitmap 40	3512	Throttle Actuator 2- Shorted Low	Shutdown w/Cooldown	PC 3.x
40470	11	Fault Status Gas Bitmap 40	2752	Throttle Actuator - Shorted High	Shutdown w/Cooldown	PC 3.x
40470	12	Fault Status Gas Bitmap 40	3514	Throttle Actuator - Shorted Low	Shutdown w/Cooldown	PC 3.x
40470	13	Fault Status Gas Bitmap 40	3515	Throttle Actuator - Special instruction	Shutdown w/Cooldown	PC 3.x
40470	14	Fault Status Gas Bitmap 40	3521	Throttle Actuator - Temperature low	Warning	PC 3.x
40470	15	Fault Status Gas Bitmap 40	3522	Throttle Actuator 2- Temp low	Warning	PC 3.x



THIS PAGE LEFT INTENTIONALLY BLANK



4. NFPA 110 & Extended Annunciation Bitmap

Table 4-1 NFPA110 bitmap (See Section 1 Reg 40016, Section 2 Reg 40716, 40717 and Section 5)

BIT	DESCRIPTION
0 (MSB)	Common Alarm
1	Genset Supplying Load
2	Genset Running
3	Not in Auto
4	High Battery Voltage
5	Low Battery Voltage
6	Charger AC Failure
7	Fail to Start
8	Low Coolant Temperature
9	Pre-high Engine Temperature
10	High Engine Temperature
11	Pre-low Oil Pressure
12	Low Oil Pressure
13	Overspeed
14	Low Coolant Level
15 (LSB)	Low Fuel Level

Table 4-2 Extended Annunciation Bitmap (See Section 1 Reg. 40017 and Section 5)

BIT	DESCRIPTION
0 (MSB)	Check Genset
1	Ground Fault
2	High AC Voltage
3	Low AC Voltage
4	Under Frequency
5	Overload
6	Overcurrent
7	Short Circuit
8	Reverse KW
9	Reverse KVAR
10	Fail to Sync
11	Fail to Close
12	Load Demand
13	Genset Circuit Breaker Tripped
14	Utility Circuit Breaker Tripped
15 (LSB)	Emergency Stop

Table 4-3 NFPA110 bitmap (See Section 6)

BIT	DESCRIPTION
0 (MSB)	Source 1 Connected
1	Source 2 Connected
2	NA
3	Not in Auto
4	NA
5	NA
6	Charger AC Failure
7	NA
8	NA
9	NA
10	NA
11	NA
12	NA
13	NA
14	NA
15 (LSB)	NA

Table 4-4 Extended Annunciation Bitmap (See Section 6)

BIT	DESCRIPTION
0 (MSB)	Source 1 Available
1	Source 2 Available
2	Source 1 Connected
3	Source 2 Connected
4	ATS Common Alarm
5	Not In Auto
6	Test / Exercise In Progress
7	Low Battery Voltage
8	Load Shed
9	Transfer Inhibit
10	Retransfer Inhibit
11	Fail To Close
12	Fail To Disconnect
13	Fail To Synchronize
14	Bypass to Source 1
15 (LSB)	Bypass to Source 2



THIS PAGE LEFT INTENTIONALLY BLANK



5. DMC 1000 Modbus Parametric Data

Addr.	System Name	Access	Specifications	Description	Function	
42001	MB Logical Read Address	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: .000 Upper Limit: 65535.000 Default: 0	Logical address to be read via Modbus	Communications
42002	MB Logical Read Data	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Logical data to be read via Modbus	Communications
42009	Device Type	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Hard coded device type id = 52 (0x0034)	Communications
42010	Software Version	Read Only	Multiplier: 0.000100000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Software version number	Controller Information
42012	Current Fault Status	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	The most recently occurring fault which is still active	Fault and Event Info
42018	Genset L1N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default	Generator set L1N voltage	Voltage
42019	Genset L2N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default	Generator set L2N voltage	Voltage
42020	Genset L3N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default	Generator set L3N voltage	Voltage
42021	Genset LN Average Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default	Generator set LN average voltage	Voltage

Addr.	System Name	Access	Specifications	Description	Function	
42022	Genset L1L2 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default:	Generator set L1L2 voltage	Voltage
42023	Genset L2L3 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default:	Generator set L2L3 voltage	Voltage
42024	Genset L3L1 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default:	Generator set L3L1 voltage	Voltage
42025	Genset LL Average Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default:	Generator set LL average voltage	Voltage
42026	Genset L1 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Upper Limit: Default	Generator set L1 current	Current
42027	Genset L2 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Upper Limit: Default	Generator set L2 current	Current
42028	Genset L3 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Upper Limit: Default	Generator set L3 current	Current
42029	Genset Average Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Upper Limit: Default	Generator set average current	Current
42030	Genset L1 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Generator set L1 kW	Current
42031	Genset L2 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Generator set L2 kW	Current

Addr.	System Name	Access	Specifications	Description	Function
42032	Genset L3 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Generator set L3 kW Power
42033	Genset Total kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Generator set total kW Power
42034	Genset L1 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default:	Generator set L1 kVAR Power
42035	Genset L2 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default:	Generator set L2 kVAR Power
42036	Genset L3 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default:	Generator set L3 kVAR Power
42037	Genset Total kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default:	Generator set total kVAR Power
42038	Genset Total Power Factor	Read Only	Multiplier: 0.010000000000 Offset: 0 Size (bits): 8 Sign: S	Unit: Lower Limit: Upper Limit: Default:	Generator set total power factor Power
42039	Genset L1 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: Upper Limit: Default:	Generator set L1 kVA Power
42040	Genset L2 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: Upper Limit: Default:	Generator Set L2 kVA Power
42041	Genset L3 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: Upper Limit: Default:	Generator set L3 kVA Power

Addr.	System Name	Access	Specifications	Description	Function	
42042	Genset Total kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Generator set total kVA	Power
42043	MB Genset Frequency	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: Hz Upper Limit: Hz Default:	Generator set line frequency scaled by 10 = 1Hz for Modbus	Communications
42044	Genset Total Negative kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Generator set total negative kWh accumulation	Energy
42046	Genset Total Positive kWh	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Generator set total positive kWh accumulation	Energy
42048	Genset Total Net kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Generator set total net kWh accumulation	Energy
42050	Genset Total Negative kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Generator set total negative kVARh accumulation	Energy
42052	Genset Total Positive kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Generator set total positive kVARh accumulation	Energy
42054	Genset Total Net kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Generator set total net kVARh accumulation	Energy
40056	Genset Total kVAh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVAh Lower Limit: kVAh Upper Limit: kVAh Default:	Generator set total kVAh accumulation	Energy

Addr.	System Name	Access	Specifications	Description	Function	
42058	Genset Available Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Upper Limit: Default:	Calculated Amps which represent 100% generator set bus current -- used by barograph	Current
42059	Genset L1 Current Percent	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Generator set L1 current as percent of generator set total current capacity--used by barograph	Current
42060	Genset L2 Current Percent	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Generator set L2 current as percent of generator set total current capacity--used by barograph	Current
42061	Genset L3 Current Percent	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Generator set L3 current as percent of generator set total current capacity--used by barograph	Current
42062	Genset Total kW Percent	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: Upper Limit: Default:	Generator set total kW as percent of total generator set capacity -- used by barograph	Power
42063	Genset Frequency Percent	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Generator set frequency as percent of system frequency -- used by barograph	Frequency
42064	Genset L1L2 Voltage%	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Generator set L1L2 voltage%	Voltage
42065	Genset L2L3 Voltage%	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Generator set L2L3 voltage%	Voltage

Addr.	System Name	Access	Specifications	Description	Function	
42066	Genset L3L1 Voltage%	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Generator set L3L1 voltage%	Voltage
42118	Utility L1N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default: 0	Utility L1N voltage	Voltage
42119	Utility L2N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default: 0	Utility L2N voltage	Voltage
42120	Utility L3N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default: 0	Utility L3N voltage	Voltage
42121	Utility LN Average Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default: 0	Utility LN average voltage	Voltage
42122	Utility L1L2 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default: 0	Utility L1L2 voltage	Voltage
42123	Utility L2L3 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default: 0	Utility L2L3 voltage	Voltage
42124	Utility L3L1 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default: 0	Utility L3L1 voltage	Voltage
42125	Utility LL Average Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default: 0	Utility LL average voltage	Voltage
42126	Utility L1 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Upper Limit: Default:	Utility L1 current	Current

Addr.	System Name	Access	Specifications	Description	Function
42127	Utility L2 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Utility L2 current	Current
42128	Utility L3 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Utility L3 current	Current
42129	Utility Average Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Utility average current	Current
42130	Utility L1 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Utility L1 kW	Power
42131	Utility L2 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Utility L2 kW	Power
42132	Utility L3 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Utility L3 kW	Power
42133	Utility Total kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Utility total kW	Power
42134	Utility L1 kVARt	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Utility L1 kVAR	Power
42135	Utility L2 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Utility L2 kVAR	Power
42136	Utility L3 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Utility L3 kVAR	Power

Addr.	System Name	Access	Specifications	Description	Function
42137	Utility Total kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default:	Utility total kVAR Power
42138	Utility Total Power Factor	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 8 Sign: S	Unit: Lower Limit: Upper Limit: Default:	Utility total power factor Power
42139	Utility L1 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: Upper Limit: Default:	Utility L1 kVA Power
42140	Utility L2 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: Upper Limit: Default:	Utility L2 kVA Power
42141	Utility L3 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: Upper Limit: Default:	Utility L3 kVA Power
42142	Utility Total kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: Upper Limit: Default:	Utility total kVA Power
42143	MB Utility Frequency	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: Upper Limit: Default:	Utility line frequency scaled by 10 = 1Hz for Modbus Communications
42144	Utility Total Negative kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kWh Lower Limit: Upper Limit: Default:	Utility total negative kWh accumulation Energy
42146	Utility Total Positive kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kWh Lower Limit: Upper Limit: Default:	Utility total positive kWh accumulation Energy
42148	Utility Total Net kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kWh Lower Limit: Upper Limit: Default:	Utility total net kWh accumulation Energy

Addr.	System Name	Access	Specifications	Description	Function	
42150	Utility Total Negative kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: Upper Limit: Default:	Utility total negative kVARh accumulation	Energy
42152	Utility Total Positive kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: Upper Limit: Default:	Utility total positive kVARh accumulation	Energy
42154	Utility Total Net kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVARh Lower Limit: Upper Limit: Default:	Utility total net kVARh accumulation	Energy
42156	Utility Total kVAh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: Upper Limit: Default:	Utility total kVAh accumulation	Energy
42158	System Total kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Sum of generator set bus and utility bus kW	Power
42159	System Total kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default:	Sum of generator set bus and utility bus kVAR	Power
42160	System Total Power Factor	Read Only	Multiplier: 0.010000000000 Offset: 0 Size (bits): 8 Sign: S	Unit: Lower Limit: Upper Limit: Default:	System total power factor (totalized value of utility bus plus generator set bus)	Power
42161	System Total kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: Upper Limit: Default:	Sum of generator set bus and utility bus kVA	Power
42162	Utility L1 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	barograph	Current

Addr.	System Name	Access	Specifications	Description	Function
42163	Utility L2 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	barograph Current
42164	Utility L3 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	barograph Current
42165	Utility Total kW Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: Upper Limit: Default:	Utility total kW as percent of total utility capacity -- used by barograph Power
42166	Utility Frequency Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Utility frequency as percent of System Frequency -- used by barograph Frequency
42167	Utility L1L2 Voltage%	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Utility L1L2 voltage% Voltage
42168	Utility L2L3 Voltage%	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Utility L2L3 voltage% Voltage
42169	Utility L3L1 Voltage%	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Utility L3L1 voltage% Voltage
42200	Total Number of Gensets	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Number of generator sets with non-zero ratings entered System Information
42201	Total System Capacity	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Sum of the generator set kW ratings System Information

Addr.	System Name	Access	Specifications	Description	Function	
42202	Total Online Capacity	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Sum of the generator set kW ratings for generator sets which are online	System Information
42203	Programmed Transition Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: Upper Limit: Default:	Countdown value of the programmed transition timer	PTC Timers
42204	Transfer Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: Upper Limit: Default: 0	Countdown value of the transfer timer	PTC Timers
42205	Retransfer Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: Upper Limit: Default:	Countdown value of the retransfer timer	PTC Timers
42206	Maximum Parallel Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: Upper Limit: Default:	Countdown value of the maximum parallel timer	PTC Timers
42207	kW Load Reference	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	kW control reference value for utility paralleling	Master Load Control
42212	Active Transition Timer	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: Upper Limit: Default:	Countdown timer value of active timer	PTC Timers
42213	Hardware Version	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Indicates the hardware version of the board	Discrete Inputs
42214	Controller On Time	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: seconds Lower Limit: 0.000 Upper Limit: 4294967295.000 Default: 0.000	Amount of time in seconds controller has been powered	Controller Information
42220	kVAR Load Reference	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default:	kVAR control reference value for extended paralleling	Master Load Control

Addr.	System Name	Access	Specifications	Description	Function	
42221	kVAR Load Setpoint Engr Units Display Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: Upper Limit: Default	Engineering units value for the kVAR load setpoint analog input	Analog Inputs
42222	kW Load Setpoint Engr Units Display Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: Upper Limit: Default:	Engineering units value for the kW load setpoint analog input	Analog Inputs
42223	Power Factor Setpoint	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 8 Sign: S	Unit: Lower Limit: Upper Limit: Default:	Power factor setpoint analog input value (uses kVAR load setpoint analog input)	Analog Inputs
42226	Sync Phase Difference	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: degrees Lower Limit: Upper Limit: Default:	Utility to generator set L1 voltage phase angle	Phase
42250	Current Add Level	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Indicates the next level to add	Load Add Shed Control
42251	Current Shed Level	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: Upper Limit: Default	Indicates the next level to shed	Load Add Shed Control
42291	Battery Voltage Engr Units Display Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: Upper Limit: Default	Engineering units value for the battery voltage analog input	Analog Inputs
42292	kVAR Master Load Control Output Predictor Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: VDC Lower Limit: Upper Limit: Default	Voltage level commanded to kVAR master load control analog output	Analog Outputs
42293	kW Master Load Control Output Predictor Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: VDC Lower Limit: Upper Limit: Default	Voltage level commanded to kW master load control analog output	Analog Outputs

Addr.	System Name	Access	Specifications	Description	Function	
42294	Master Frequency Bias Output Predictor Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: VDC Lower Limit: Upper Limit: Default	Voltage level commanded to master frequency bias analog output	Analog Outputs
42295	Master Voltage Bias Output Predictor Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: VDC Lower Limit: Upper Limit: Default:	Voltage level commanded to master voltage bias analog output	Analog Outputs
42305	Genset 01 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 1000.000	Sets gen1 kW rating	System Information
42306	Genset 02 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen2 kW rating	System Information
42307	Genset 03 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen3 kW rating	System Information
42308	Genset 04 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen4 kW rating	System Information
42309	Genset 05 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen5 kW rating	System Information
42310	Genset 06 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen6 kW rating	System Information

Addr.	System Name	Access	Specifications	Description	Function	
42311	Genset 07 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen7 kW rating	System Information
42312	Genset 08 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen8 kW rating	System Information
42313	Genset 09 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen9 kW rating	System Information
42314	Genset 10 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen10 kW rating	System Information
42315	Genset 11 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen11 kW rating	System Information
42316	Genset 12 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen12 kW rating	System Information
42317	Programmed Transition Delay (TDPT)	Read/Write	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 60 seconds Default: 3.000	Sets the programmed transition time delay	PTC Timers
42318	Transfer Delay (TDNE)	Read/Write	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 120 seconds Default: 10.000	Sets the transfer time delay	PTC Timers

Addr.	System Name	Access	Specifications	Description	Function	
42319	Retransfer Delay (TDEN)	Read/Write	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 1800 seconds Default: 600.000	Sets the retransfer time delay	PTC Timers
42320	Maximum Parallel Time (TDMP)	Read/Write	Multiplier: 0.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit seconds Lower Limit: 0.000 seconds Upper Limit: 1800 seconds Default: 20.000	Sets the maximum parallel time for soft load transfers	PTC Timers
42321	Genset Bus %kW Setpoint	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: -5.000 % Upper Limit: 105.000 % Default: 80.000	Sets %kW generator set output level for open loop base load extended paralleling	Master Load Control
42322	Genset Nominal Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: 110.000 Volts Upper Limit: 45000.000 Volts Default: 480.000	Generator set nominal voltage	AC Setup
42323	Utility Nominal Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: 110.000 Volts Upper Limit: 45000.000 Volts Default: 480.000	Utility nominal voltage	AC Setup
42324	Genset Center Frequency	Read/Write	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: 45.000 Hz Upper Limit: 65.000 Hz Default: 60.000	Sets the center frequency for the generator set frequency sensor bandwidth settings	PTC Sensors
42325	Utility Center Frequency	Read/Write	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: 45.000 Hz Upper Limit: 65.000 Hz Default: 60.000	Sets the center frequency for the utility frequency sensor bandwidth settings	PTC Sensors
42327	System Frequency	Read/Write	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: 45.000 Hz Upper Limit: 65.000 Hz Default: 60.000	Use to define the system nominal frequency	System Information

Addr.	System Name	Access	Specifications	Description	Function	
42330	Genset Bus kW Setpoint	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32767.000 kW Default: 0.000	Sets the base load kW setpoint in closed loop extended paralleling	Master Load Control
42331	Genset Bus kVAR Setpoint	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: 0.000 kVAR Upper Limit: 32767 kVAR Default: 0.000	Sets the base load kVAR setpoint in closed loop extended paralleling	Master Load Control
42332	Genset Bus %kVAR Setpoint	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: -5.000 % Upper Limit: 105.000 % Default: 0.000	Sets %kVAR generator set output level for open loop base load extended paralleling	Master Load Control
42333	Genset Bus Power Factor Setpoint	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 8 Sign: S	Unit: Lower Limit: 0.700 Upper Limit: 1.000 Default: 1.000	Sets the desired generator set bus power factor in closed loop extended paralleling	Master Load Control
42334	Genset Unloaded Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000 kW Upper Limit: 32767 kW Default: 50.000	Setpoint for generator set unloaded level	Master Load Control
42337	Utility Bus kW Setpoint	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000 kW Upper Limit: 32767 kW Default: 100.000	Sets the peak shave kW setpoint in closed loop extended paralleling	Master Load Control
42338	Utility Bus kW Constraint Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000 kW Upper Limit: 32767.000 kW Default: 100.000	Sets the utility kW constraint level for base load extended paralleling	Master Load Control
42339	Utility Bus kVAR Setpoint	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: 32768.000 kVAR Upper Limit: 32767.000 kVAR Default: 100.000	Sets the peak shave kVAR setpoint in closed loop extended paralleling	Master Load Control

Addr.	System Name	Access	Specifications	Description	Function	
42340	Utility Bus Power Factor Setpoint	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 8 Sign: S	Unit: Lower Limit: 0.700 Upper Limit: 1.000 Default: 1.000	Sets the desired utility bus power factor in closed loop extended paralleling	Master Load Control
42341	Utility Un-loaded Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000 kW Upper Limit: 32767.000 kVAR Default: 50.000	Setpoint for utility unloaded level	Master Load Control
42348	Extended Parallel Ramp Load Time	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 10.000 seconds Upper Limit: 900.000 seconds Default: 60.000	Sets ramp load time for extended paralleling	Master Load Control
42351	Fail To Synchronize Time	Read/Write	Multiplier: .200000000000 Offset: 0 Size (bits):16 Sign: U	Unit: seconds Lower Limit: 10.000 seconds Upper Limit: 900.000 seconds Default: 120.000	Sets the fail to synchronize diagnostic time delay	Master Sync Control
42354	Slip Frequency	Read/Write	Multiplier: .001000000000 Offset: 0 Size (bits):16 Sign: S	Unit: Hz Lower Limit: -3.000 Hz Upper Limit: 3.000 Hz Default: 0.100	Sets the synchronizer slip frequency (used when sync method is slip)	Master Sync Control
42355	Start Time Delay (TDES)	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits):16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 3600.000 seconds Default: 0.000	Sets the generator sets start time delay	PTC Operating Mode
42356	Stop Time Delay (TDEC)	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits):16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 3600.000 seconds Default: 0.000	Sets the generator sets stop time delay	PTC Operating Mode
42364	Genset Bus Load Add Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 60.000 seconds Default: 1.000	Indicates delay between add levels when all generator sets are online and no utility	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function	
42365	Utility Bus Load Add Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 60.000 seconds Default: 1.000	Indicates delay between add levels when on utility	Load Add Shed Control
42366	Load Shed Delay	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: seconds Lower Limit: 1.000 seconds Upper Limit: 10.000 seconds Default: 1.000	Indicates delay between shed levels when on generator sets	Load Add Shed Control
42373	Load 1 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 1.000 Upper Limit: 6.000 Default: 1.000	Indicates which add level load 1 is assigned to	Load Add Shed Control
42374	Load 2 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 1.000 Upper Limit: 6.000 Default: 2.000	Indicates which add level load 2 is assigned to	Load Add Shed Control
42375	Load 3 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 1.000 Upper Limit: 6.000 Default: 3.000	Indicates which add level load 3 is assigned to	Load Add Shed Control
42376	Load 4 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 1.000 Upper Limit: 6.000 Default: 4.000	Indicates which add level load 4 is assigned to	Load Add Shed Control
42377	Load 5 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 1.000 Upper Limit: 6.000 Default: 5.000	Indicates which add level load 5 is assigned to	Load Add Shed Control
42378	Load 6 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 1.000 Upper Limit: 6.000 Default: 6.000	Indicates which add level load 6 is assigned to	Load Add Shed Control
42379	Load 1 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 5.000 Default: 0.000	Indicates which shed level load 1 is assigned to	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42380	Load 2 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 5.000 Default: 5.000	Indicates which shed level load 2 is assigned to	Load Add Shed Control
42381	Load 3 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 5.000 Default: 4.000	Indicates which shed level load 3 is assigned to	Load Add Shed Control
42382	Load 4 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 5.000 Default: 3.000	Indicates which shed level load 4 is assigned to	Load Add Shed Control
42383	Load 5 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 5.000 Default: 2.000	Indicates which shed level load 5 is assigned to	Load Add Shed Control
42384	Load 6 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 5.000 Default: 1.000	Indicates which shed level load 6 is assigned to	Load Add Shed Control
42386	Genset Bus %kW Overload Threshold	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: % Lower Limit: 80.000 % Upper Limit: 140.000 % Default: 105.000	Use to set the %kW threshold for gen bus overload condition	System Information
42387	Genset Bus kW Overload Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: second Lower Limit: 0.000 second Upper Limit: 120.000 second Default: 60.000	Sets the delay time for overload based on kW	System Information
42388	Genset Bus Underfrequency Overload Threshold	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: 0.100 Hz Upper Limit: 10.000 Hz Default: 3.000	Use to set the underfrequency offset threshold for gen bus overload condition	System Information
42389	Genset Bus Underfrequency Overload Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: second Lower Limit: 0.000 Hz Upper Limit: 20.000 Hz Default: 3.000	Sets the delay time for overload based on frequency	System Information

Addr.	System Name	Access	Specifications	Description	Function	
42395	Load Demand Initial Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: minute Lower Limit: 1.000 minute Upper Limit: 60.000 minute Default: 5.000	Sets the initial delay time before load demand will operate	Load Demand Control
42396	Load Demand Restart Percent	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: % Lower Limit: 20 % Upper Limit: 100 % Default: 80.000	Sets the load demand restart threshold (make larger than shutdown percent)	Load Demand Control
42397	Load Demand Run Hours Differential	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: Hours Lower Limit: 1.000 Hours Upper Limit: 500 Hours Default: 50.000	Sets run hours differential for restarting a generator set stopped due to load demand	Load Demand Control
42398	Load Demand Shutdown Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: minute Lower Limit: 1.000 minute Upper Limit: 60.000 minute Default: 5.000	Sets the delay time between stopping generator sets due to load demand	Load Demand Control
42399	Load Demand Shutdown Percent	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: % Lower Limit: 20 % Upper Limit: 100 % Default: 60.000	Sets the load demand shutdown threshold (make smaller than restart percent)	Load Demand Control
42400	Genset Fail Time Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 10.000 seconds Upper Limit: 900.000 seconds Default: 60.000	Sets how long to wait for a generator set to come online before declaring it failed	Load Demand Control
42401	Util CB Fail to Close Delay	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.100 seconds Upper Limit: 1.000 seconds Default: 0.26	Sets the utility breaker fail to close time delay	Breaker Control
42402	Util CB Fail to Open Delay	Read/Write	Multiplier: .200000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: seconds Lower Limit: 0.200 seconds Upper Limit: 5.000 seconds Default: 1	Sets the utility breaker fail to open time delay	Breaker Control

Addr.	System Name	Access	Specifications	Description	Function	
42403	Util CB Re-charge Delay	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 60 seconds Default: 10.000	Sets the time to allow for utility breaker recharge	Breaker Control
42404	Gen CB Fail to Close Delay	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.100 seconds Upper Limit: 1.000 seconds Default: 0.260	Sets the generator set breaker fail to close time delay	Breaker Control
42405	Gen CB Fail to Open Delay	Read/Write	Multiplier: 0.200000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: seconds Lower Limit: 0.200 seconds Upper Limit: 5.000 seconds Default: 1.000	Sets the generator set breaker fail to open time delay	Breaker Control
42406	Gen CB Re-charge Delay	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 60.000 seconds Default: 10.000	Sets the time to allow for generator set breaker recharge	Breaker Control
42407	Permissive Phase Window	Read/Write	Multiplier: 0.010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: degrees Lower Limit: 0.100 degrees Upper Limit: 20.000 degrees Default: 10.000	Sets the permissive +/- phase angle window for the sync check function	Master Sync Control
42408	Permissive Voltage Window	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: 0.5000 % Upper Limit: 10.000 % Default: 5.000	Sets the permissive +/- voltage acceptance window for the sync check function	Master Sync Control
42409	Permissive Window Time	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.500 seconds Upper Limit: 5.000 seconds Default: 0.500	Sets the permissive acceptance window dwell time for the sync check function	Master Sync Control
42410	Permissive Frequency Window	Read/Write	Multiplier: .001000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: Hz Lower Limit: 0.001 Hz Upper Limit: 1.000 Hz Default: 1.000	Sets the maximum frequency difference allowed for permissive close	Master Sync Control

Addr.	System Name	Access	Specifications	Description	Function	
42412	Sync Phase Offset	Read/Write	Multiplier: 0.010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: degrees Lower Limit: -50.000 degrees Upper Limit: 50.000 degrees Default: 0.000	Sets a sync phase offset to accommodate sync across transformer with phase shift	Master Sync Control
42414	kW Kp	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 1000.000 Default: 60.000	Proportional gain for kW closed loop control in extended paralleling	Master Load Control
42415	kW KI	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 255.000 Default: 60.000	Integral gain for kW closed loop control in extended paralleling	Master Load Control
42416	kVAR Kp	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 1000.000 Default: 120.000	Proportional gain for kVAR closed loop control in extended paralleling	Master Load Control
42417	kVAR KI	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 255.000 Default: 50.000	Integral gain for kVAR closed loop control in extended paralleling	Master Load Control
42418	Scheduler Program Select	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 1.000 Upper Limit: 12.000 Default: 1.000	Selects which scheduler program to view or edit	System Scheduler
42423	Scheduler Program x Start Hour	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: hour Lower Limit: 0.000 hour Upper Limit: 23.000 hour Default: 0.000	Use to adjust start hour for the selected program	System Scheduler
42424	Scheduler Program x Start Minute	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: minute Lower Limit: 0.000 minute Upper Limit: 59.000 minute Default: 0.000	Use to adjust start minute for the selected program	System Scheduler
42425	Scheduler Program x Duration Hours	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: hour Lower Limit: 0.000 hour Upper Limit: 23.000 hour Default: 0.000	Use to adjust duration hours for the selected program	System Scheduler

Addr.	System Name	Access	Specifications	Description	Function	
42426	Scheduler Program x Duration Minutes	Read / Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: minute Lower Limit: 0.000 minute Upper Limit: 59.000 minute Default: 0.000	Use to adjust duration minutes for the selected program	System Scheduler
42427	Scheduler Exception Select	Read/ Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 1.000 Upper Limit: 6.000 Default: 1.000	Selects which scheduler exception to view or edit	System Scheduler
42430	Scheduler Exception x Month	Read/ Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: month Lower Limit: 1.000 month Upper Limit: 12.000 month Default: 1.000	Use to adjust the month of the selected exception	System Scheduler
42431	Scheduler Exception x Date	Read/ Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: date Lower Limit: 1.000 date Upper Limit: 31.000 date Default: 1.000	Use to adjust the date of the selected exception	System Scheduler
42432	Scheduler Exception x Hour	Read/ Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: hour Lower Limit: 0.000 hour Upper Limit: 23.000 hour Default: 0.000	Use to adjust the start hour of the selected exception	System Scheduler
42433	Scheduler Exception x Minute	Read/ Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: minute Lower Limit: 0.000 minute Upper Limit: 59.000 minute Default: 0.000	Use to adjust the start minute of the selected exception	System Scheduler
42434	Scheduler Exception x Duration Days	Read/ Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: days Lower Limit: 0.000 days Upper Limit: 44.000 days Default: 0.000	Use to adjust the duration days of the selected exception	System Scheduler
42435	Scheduler Exception x Duration Hours	Read/ Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: hour Lower Limit: 0.000 hour Upper Limit: 23 hour Default: 0.000	Use to adjust the duration hours of the selected exception	System Scheduler

Addr.	System Name	Access	Specifications	Description	Function	
42436	Scheduler Exception x Duration Minutes	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: minute Lower Limit: 0.000 minute Upper Limit: 59.000 minute Default: 0.000	Use to adjust the duration minutes of the selected exception	System Scheduler
42440	Genset PT Primary Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: 110.000 Volts Upper Limit: 45000.000 Volts Default: 480	Generator Set PT primary voltage	AC Setup
42441	Genset PT Secondary Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: 110.000 Volts Upper Limit: 500 Volts Default: 120	Generator set PT secondary voltage	AC Setup
42442	Genset CT Primary Current	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amp Lower Limit: 5.000 Amp Upper Limit: 10000.000 Amp Default: 100	Generator set CT primary current	AC Setup
42445	Utility PT Primary Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: 110.000 Volts Upper Limit: 45000.000 Volts Default: 480	Utility PT primary voltage	AC Setup
42446	Utility PT Secondary Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: 110.000 Volts Upper Limit: 500.000 Volts Default: 120	Utility PT secondary voltage	AC Setup
42447	Utility CT Primary Current	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: 5.000 Amps Upper Limit: 10000.00 Amps Default: 100	Utility primary current	AC Setup
42449	Load Add Shed Required Online Capacity	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.000 kW Default: 0	Generator set kW capacity that must be online to start timed load add; 0 disables this	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function	
42450	Load Demand Minimum On-line Capacity	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32767.000 kW Default: 0	Sets how much capacity must always be online regardless of what the load is	Load Demand Control
42451	Load Demand Restart Delay	Read/Write	Multiplier: 0.100000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 25.000 seconds Default: 1	Sets generator restart delay time to avoid nuisance restarts due to load transients	Load Demand Control
42452	Utility Available Current	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: 1.000 Amps Upper Limit: 32000.000 Amps Default: 1000	barograph	AC Setup
42453	Total Utility Capacity	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 1.000 kW Upper Limit: 32000.00 kW Default: 1000	Use to set how kW = 100% utility kW -- Used by barograph	AC Setup
42455	24 V High Battery Voltage Threshold	Read/Write	Multiplier: 0.010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: 28.000 VDC Upper Limit: 34.000 VDC Default: 32	Sets 24V high battery voltage fault threshold	Battery Voltage Protection
42456	24 V Low Battery Voltage Threshold	Read/Write	Multiplier: 0.010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: 22.000 VDC Upper Limit: 26.000 VDC Default: 24	Sets 24V low battery voltage fault threshold	Battery Voltage Protection
42457	12 V High Battery Voltage Threshold	Read/Write	Multiplier: 0.010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: 14.000 VDC Upper Limit: 17.000 VDC Default: 16	Sets 12V high battery voltage fault threshold	Battery Voltage Protection
42458	12 V Low Battery Voltage Threshold	Read/Write	Multiplier: 0.010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: 11.000 VDC Upper Limit: 13.000 VDC Default: 12	Sets 12V low battery voltage fault threshold	Battery Voltage Protection

Addr.	System Name	Access	Specifications	Description	Function	
42459	High Battery Voltage Set time	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: second Lower Limit: 2 second Upper Limit: 60 second Default: 60	Sets high battery voltage set time	Battery Voltage Protection
42460	Low Battery Voltage Set Time	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: second Lower Limit: 2 second Upper Limit: 60 second Default: 60	Sets low battery voltage set time	Battery Voltage Protection
42462	Genset Online Capacity Sensor Threshold	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.000 kW Default: 0	Sets the online kW threshold at which generator set bus is available for loading	PTC Sensors
42500	Fault Status BitMap 1	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Bitmapped state of utility and other faults – 32 bits	Fault and Event Info
42502	Fault Status BitMap 2	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Bitmapped state of generator set and other faults – 32 bits	Fault and Event Info
42504	Event Status BitMap 1	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Bitmapped state of events – 32 bits	Fault and Event Info
42506	Genset Metering Fault Status	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Bitmapped word with status of generator set AC metering out of range conditions	AC Interrupt Service
42507	Utility Metering Fault Status	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Bitmapped word with status of utility AC metering out of range conditions	AC Interrupt Service
42704	Gen1 Online Time	Read Only	Multiplier: 0.000277778 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: 0.000 Hours Upper Limit: 1193046.000 Hours Default: 0	Total online time for Gen1	System Information

Addr.	System Name	Access	Specifications	Description	Function
42706	Gen2 Online Time	Read Only	Multiplier: 0.000277778 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: 0.000 Hours Upper Limit: 1193046.000 Hours Default: 0	Total online time for Gen2 System Information
42708	Gen3 Online Time	Read Only	Multiplier: 0.000277778 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: 0.000 Hours Upper Limit: 1193046.000 Hours Default: 0	Total online time for Gen3 System Information
42710	Gen4 Online Time	Read Only	Multiplier: 0.000277778 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: 0.000 Hours Upper Limit: 1193046.000 Hours Default: 0	Total online time for Gen4 System Information
42717	Total Number of Gensets Online	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Indicates how many of the defined Gen1 thru Gen4 generator sets are online System Information
42718	Total Spare Online Capacity	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Difference between online capacity (4 generator sets) and Genset Bus Total kW System Information
42719	Next Gen Restart Threshold	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Indicates kW threshold for gen bus at which the next generator set will restart Load Demand Control
42720	Next Gen Shutdown Threshold	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Indicates kW threshold for gen bus at which the next generator set will load demand stop Load Demand Control
42727	Genset Bus kW Overload Threshold	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Calculated kW overload threshold based on online capacity and % setting System Information
42732	Modbus Bus Message Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Modbus bus message count Communications

Addr.	System Name	Access	Specifications		Description	Function
42733	Modbus CRC Error Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Modbus CRC error count	Communications
42734	Modbus Exception Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Modbus exception count	Communications
42735	Modbus No Response Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Modbus no response count	Communications
42736	Modbus Slave Message Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Modbus slave message count	Communications
42739	Clock Year	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: year Lower Limit: .000 year Upper Limit: 99.000 year Default:	Use to set or read current year	Real Time Clock
42740	Clock Month	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: month Lower Limit: 1.000 month Upper Limit: 12.000 month Default:	Use to set or read current month	Real Time Clock
42741	Clock Date	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: date Lower Limit: 1.000 date Upper Limit: 31.000 date Default:	Use to set or read current date	Real Time Clock
42742	Clock Hour	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: hour Lower Limit: .000 hour Upper Limit: 23.000 hour Default:	Use to set or read current hour	Real Time Clock
42743	Clock Minute	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: minute Lower Limit: .000 minute Upper Limit: 59.000 minute Default:	Use to set or read current minute	Real Time Clock

Addr.	System Name	Access	Specifications	Description	Function	
42744	Clock Second	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: seconds Lower Limit: .000 seconds Upper Limit: 59.000 seconds Default:	Use to set or read current seconds	Real Time Clock
42746	Start Timer	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: Upper Limit: Default:	Countdown timer value for generator set start timer	PTC Operating Mode
42747	Stop Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: Upper Limit: Default:	Countdown timer value for generator set stop timer	PTC Operating Mode
42748	Low Battery Voltage Threshold	Read Only	Multiplier: 0.010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: Upper Limit: Default:	Battery voltage with respect to the set low battery threshold	Battery Voltage Protection
42749	High Battery Voltage Threshold	Read Only	Multiplier: 0.010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: Upper Limit: Default:	Battery voltage with respect to set high battery threshold	Battery Voltage Protection



THIS PAGE LEFT INTENTIONALLY BLANK



6 DMC 10000 Modbus Enumerated Data

Addr.	System Name	Access	Specifications	Description	Function	
42004	Save Adjustments	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Save Trims Default: Do Nothing	Use to save adjustments directly in non-volatile memory	Controller Information
42011	Genset Run Sequence State	Read Only	Size (bits): 8 Number of Fields: 4	0: Time Delay Start 1: Time Delay Stop 2: Stop 3: Run Default:	Indicates state of the generator set run sequence	PTC Operating Mode
42017	Genset Bus Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Unavailable 1: Dead 2: Live Default:	Energization status of the generator set bus	PTC Sensors
42117	Utility Bus Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Unavailable 1: Dead 2: Live Default:	Energization status of the utility bus	PTC Sensors
42208	Utility Unload Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Not Unloaded 2: Unloaded Default:	Indicates utility unloaded status	Master Load Control
42209	Genset Unload Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Not Unloaded 2: Unloaded Default:	Indicates generator set unloaded status	Master Load Control
42210	System State	Read / Write	Size (bits): 8 Number of Fields: 18	0: Not Available 1: TD Start 2: TD Stop 3: TD Programmed Transition 4: TD Transfer 5: TD Retranfer 6: Synchronizing 7: Sync Check OK 8: Inhibit 9: Unassigned 10: Ramp Unload 11: Ramp Load 12: Manual 13: Utility Failure 14: Test 15: Standby 16: Factory Test 17: Extended Parallel Default: Not Available	Indicates what state the control is currently in	System Information

Addr.	System Name	Access	Specifications		Description	Function
42211	PTC Operating Mode	Read Only	Size (bits): 8 Number of Fields: 6	0: Manual 1: Normal 2: Normal Override 3: Test 4: Utility Fail 5: Extended Parallel Default:	Indicates the current PTC operating mode. Read/Write in Comp mode	PTC Operating Mode
42216	Genset Availability Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Available 2: Unknown Default:	Indicates availability of generator set for loading as determined by generator set sensors	Availability
42217	Utility Availability Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Available 2: Unknown Default:	Indicates availability of utility for loading as determined by utility sensors	Availability
42218	Gen CB Position Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Open 1: Closed 2: Not Available Default:	Generator set breaker position	Breaker Control
42219	Util CB Position Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Open 1: Closed 2: Not Available Default:	Utility breaker position	Breaker Control
42224	PTC State	Read Only	Size (bits): 8 Number of Fields: 5	0: Not Enabled 1: No Source Connected 2: Utility Connected 3: Genset Connected 4: Paralleled Default:	Indicates the connected state of the power transfer control Read/Write in Comp.	PTC State Machine
42225	Sync Check Close Allowed	Read Only	Size (bits): 8 Number of Fields: 2	0: Not Allowed 1: Allowed Default:	Indicates whether any sync check conditions for have been met	Master Sync Control
42227	Synchronizer Status	Read Only	Size (bits): 8 Number of Fields: 2	0: Synchronizer Off 1: Synchronizer On Default:	Indicates state of the synchronizer	Master Sync Control
42228	System Lock-out Status	Read Only	Size (bits): 8 Number of Fields: 2	0: Inactive 1: Active Default:	Faults have occurred which prevent normal system operation; reset faults	System Information

Addr.	System Name	Access	Specifications		Description	Function
42229	Breaker 1 Position	Read Only	Size (bits): 8 Number of Fields: 3	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 1	Load Add Shed Control
42230	Breaker 2 Position	Read Only	Size (bits): 8 Number of Fields: 3	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 2	Load Add Shed Control
42231	Breaker 3 Position	Read Only	Size (bits): 8 Number of Fields: 3	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 3	Load Add Shed Control
42232	Breaker 4 Position	Read Only	Size (bits): 8 Number of Fields: 3	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 4	Load Add Shed Control
42233	Breaker 5 Position	Read Only	Size (bits): 8 Number of Fields: 3	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 5	Load Add Shed Control
42234	Breaker 6 Position	Read Only	Size (bits): 8 Number of Fields: 3	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 6	Load Add Shed Control
42235	Breaker 1 Trip Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 1	Load Add Shed Control
42236	Breaker 2 Trip Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 2	Load Add Shed Control
42237	Breaker 3 Trip Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 3	Load Add Shed Control
42238	Breaker 4 Trip Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 4	Load Add Shed Control
42239	Breaker 5 Trip Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 5	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function	
42240	Breaker 6 Trip Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 6	Load Add Shed Control
42241	ATS 1 Position	Read Only	Size (bits): 8 Number of Fields: 5	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 1	Load Add Shed Control
42242	ATS 2 Position	Read Only	Size (bits): 8 Number of Fields: 5	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 3	Load Add Shed Control
42243	ATS 3 Position	Read Only	Size (bits): 8 Number of Fields: 5	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 3	Load Add Shed Control
42244	ATS 4 Position	Read Only	Size (bits):8 Number of Fields: 5	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 4	Load Add Shed Control
42245	ATS 5 Position	Read Only	Size (bits): 8 Number of Fields: 5	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 5	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42246	ATS 6 Position	Read Only	Size (bits): 8 Number of Fields: 5	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 6	Load Add Shed Control
42248	PCCNet Communications Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Failed 1: Good 2: Wait Default: Wait	Indicates status of PCCNet	Communications
42249	Expansion Board Communications	Read Only	Size (bits): 8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Indicates the status of the SID to expansion board connection	Communications
42252	Add Level 1 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 1	Load Add Shed Control
42253	Add Level 2 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 2	Load Add Shed Control
42254	Add Level 3 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 3	Load Add Shed Control
42255	Add Level 4 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 4	Load Add Shed Control
42256	Add Level 5 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 5	Load Add Shed Control
42257	Add Level 6 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 6	Load Add Shed Control
42258	Shed Level 1 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 1	Load Add Shed Control
42259	Shed Level 2 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 2	Load Add Shed Control
42260	Shed Level 3 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 3	Load Add Shed Control
42261	Shed Level 4 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 4	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42262	Shed Level 5 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 5	Load Add Shed Control
42263	Manual add Level 1 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 1	Load Add Shed Control
42264	Manual add Level 2 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 2	Load Add Shed Control
42265	Manual add Level 3 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 3	Load Add Shed Control
42266	Manual add Level 4 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 4	Load Add Shed Control
42267	Manual add Level 5 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 5	Load Add Shed Control
42268	Manual add Level 6 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 6	Load Add Shed Control
42269	Manual Shed Level 1	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 1	Load Add Shed Control
42270	Manual Shed Level 2	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 2	Load Add Shed Control
42271	Manual Shed Level 3	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 3	Load Add Shed Control
42272	Manual Shed Level 4	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 4	Load Add Shed Control
42273	Manual Shed Level 5	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 5	Load Add Shed Control
42274	Restore Shed Level 1 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 1 has been restored	Load Add Shed Control
42275	Restore Shed Level 2 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 2 has been restored	Load Add Shed Control
42276	Restore Shed Level 3 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 3 has been restored	Load Add Shed Control
42277	Restore Shed Level 4 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 4 has been restored	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function	
42278	Restore Shed Level 5 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 5 has been restored	Load Add Shed Control
42279	Add Load 1 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 1	Load Add Shed Control
42280	Add Load 2 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 2	Load Add Shed Control
42281	Add Load 3 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 3	Load Add Shed Control
42282	Add Load 4 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 4	Load Add Shed Control
42283	Add Load 5 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 5	Load Add Shed Control
42284	Add Load 6 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 6	Load Add Shed Control
42285	Shed Load 1 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 1	Load Add Shed Control
42286	Shed Load 2 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 2	Load Add Shed Control
42287	Shed Load 3 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 3	Load Add Shed Control
42288	Shed Load 4 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 4	Load Add Shed Control
42289	Shed Load 5 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 5	Load Add Shed Control
42290	Shed Load 6 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 6	Load Add Shed Control
42296	PTC Genset Operating Mode	Read Only	Size (bits):8 Number of Fields: 6	0: Manual 1: Normal 2: Normal Override 3: Test 4: Utility Fail 5: Extended Parallel Default:	Indicates the current operating mode of the generator sets	PTC Operating Mode

Addr.	System Name	Access	Specifications		Description	Function
42297	PTC Transfer Pair Operating Mode	Read Only	Size (bits):8 Number of Fields: 6	0: Manual 1: Normal 2: Normal Override 3: Test 4: Utility Fail 5: Extended Parallel Default:	Indicates the current operating mode of the transfer pair	PTC Operating Mode
42298	PTC Operating Transition Type	Read Only	Size (bits): 8 Number of Fields: 3	0: Open Transition 1: Hard Closed Transition 2: Soft Closed Transition Default:	Indicates the transition type currently applicable to the PTC function operation	PTC Operating Mode
42300	System Topology	Read / Write	Size (bits): 8 Number of Fields: 6	0: Master Synchronize Only 1: Isolated Bus w/out GM 2: Isolated Bus w/GM 3: Common Bus 4: Transfer Pair 5: Component Mode Default: Master Synchronize Only	Main setting: Sets system topology; control must be in manual to set	Application Configuration
42301	Transition Type	Read / Write	Size (bits):8 Number of Fields: 3	0: Open Transition 1: Hard Closed Transition 2: Soft Closed Transition Default: Open Transition	Sets the type of transition that will be used	Application Configuration
42302	Extended Parallel Enable	Read / Write	Size (bits): 8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Use to enable extended parallel operation	Application Configuration
42303	Load Demand Type	Read / Write	Size (bits): 8 Number of Fields: 3	0: None 1: Fixed Sequence 2: Run Hours Default: None	Sets load demand type	Load Demand Control
42304	Priority Control Method	Read / Write	Size (bits): 8 Number of Fields: 2	0: Manual 1: Automatic Default: Manual	Sets priority control method	Priority Control
42326	Test With Load Enable	Read / Write	Size (bits): 8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Use to enable or disable load transfer during a test	Application Configuration

Addr.	System Name	Access	Specifications	Description	Function	
42328	Genset Bus kW Setpoint Source	Read / Write	Size (bits):8 Number of Fields: 2	0: Internal 1: Analog Input Default: Internal	selects where the generator set kW setpoint will come from for extended paralleling	Master Load Control
42329	Genset Bus kVAR Setpoint Source	Read / Write	Size (bits):8 Number of Fields: 2	0: Internal 1: Analog Input Default: Internal	Selects where the generator set kVAR setpoint will come from extended paralleling	Master Load Control
42335	Utility Bus kW Setpoint Source	Read / Write	Size (bits):8 Number of Fields: 2	0: Internal 1: Analog Input Default: Internal	Selects where the utility kW setpoint will come from for extended paralleling	Master Load Control
42336	Utility Bus kVAR Setpoint Source	Read / Write	Size (bits):8 Number of Fields: 2	0: Internal 1: Analog Input Default: Internal	Selects where the utility kVAR setpoint will come from extended paralleling	Master Load Control
42342	Clear Fault History Table	Read / Write	Size (bits):8 Number of Fields: 2	0: Inactive 1: Active Default: Inactive	Use to completely clear the fault history table	Fault and Event Info
42343	Clear Occurrence Table	Read / Write	Size (bits):8 Number of Fields: 2	0: Inactive 1: Active Default: Inactive	Use to completely clear the counts in faults and events occurrence tables	Fault and Event Info
42344	Genset Reset All Energy Meters	Read / Write	Size (bits):8 Number of Fields: 2	0: Do Nothing 1: Clear Counters Default: Do Nothing	Use to permanently clear all generator set energy meter values	Energy
42345	Utility Reset All Energy Meters	Read / Write	Size (bits):8 Number of Fields: 2	0: Do Nothing 1: Clear Counters Default: Do Nothing	Use to permanently clear all utility energy meter values	Energy
42346	Extended Paralleling kW Load Control Type	Read / Write	Size (bits):8 Number of Fields: 4	0: Genset % Level (Open Loop) 1: Genset Bus kW (Closed Loop) 2: Genset Bus kW w/ Utility (open Loop) 3: Utility Bus kW (Closed Loop) Default: Genset Bus % Level (Open Loop)	Sets how and where the kW will be controlled for extended parallel operation	Master Load Control

Addr.	System Name	Access	Specifications	Description	Function	
42347	Extended Paralleling kVAR Load Control Type	Read / Write	Size (bits):8 Number of Fields: 7	0: Genset Controllers 1: Genset Bus % Level (Open Loop) 2: Genset Bus Power Factor 3: Genset Bus kVAR (Closed Loop) 4: Genset Bus Power Factor (Closed Loop) 5: Utility Bus kVAR (Closed Loop) 6:Utility Bus Power Factor(Closed Loop) Default: Genset Controllers	Sets how and where the kVAR will be controlled for extended parallel operation	Master Load Control
42349	Fail To Sync Lockout Enable	Read / Write	Size (bits):8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Enable if want synchronizing to stop if fail to sync occurs	Master Sync Control
42350	Fail to Sync Open Transition Retransfer Enable	Read / Write	Size (bits):16 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Use to enable or disable an open transition retransfer upon a fail to sync	PTC State Machine
42352	Gen CB Manual Control	Read / Write	Size (bits):8 Number of Fields: 3	0: Closed Requested 1: No Command 2: Open Command Default: No Command	In manual mode, can be used to semi-manually control the generator set breaker	Breaker Control
42353	Util CB Manual Control	Read / Write	Size (bits):8 Number of Fields: 3	0: Closed Requested 1: No Command 2: Open Command Default: No Command	In manual mode, can be used to semi-manually control the utility breaker	Breaker Control
42357	Synchronizer Polarity	Read / Write	Size (bits):8 Number of Fields: 2	0: Normal 1: Invert Default: Normal	Use to invert synchronizer polarity	Master Sync Control
42358	Synchronize Method	Read / Write	Size (bits):8 Number of Fields: 2	0: Phase Match 1: Slip Frequency Default: Phase Match	Sets the synchronizing method	Master Sync Control
42359	Port Protocol Selection	Read / Write	Size (bits): 8 Number of Fields: 2	0: PCCNet 1: MON Default: PCCNet	Allows protocol CT the PCCNet port to be changed to MON for troubleshooting	Communications
42360	System Scheduler Enable	Read / Write	Size (bits): 8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Use to enable or disable the system scheduler	System Scheduler

Addr.	System Name	Access	Specifications		Description	Function
42361	Load Add Shed Enable	Read / Write	Size (bits): 8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Use to enable or disable the load add shed feature	Load Add Shed Control
42362	Open Transition Retransfer Load Shed Enable	Read / Write	Size (bits): 8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Use to enable or disable the shedding of loads during open transition retransfer	Load Add Shed Control
42363	Auto/Manual Load Add Restore Mode	Read / Write	Size (bits): 8 Number of Fields: 2	0: Auto 1: Manual Default: Auto	Indicates automatic or manual load add restore operation	Load Add Shed Control
42367	Load 1 Device Type	Read / Write	Size (bits): 8 Number of Fields: 3	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connection to load 1 add shed control and status I/O	Load Add Shed Control
42368	Load 2 Device Type	Read / Write	Size (bits): 8 Number of Fields: 3	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connection to load 2 add shed control and status I/O	Load Add Shed Control
42369	Load 3 Device Type	Read / Write	Size (bits): 8 Number of Fields: 3	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connection to load 3 add shed control and status I/O	Load Add Shed Control
42370	Load 4 Device Type	Read / Write	Size (bits): 8 Number of Fields: 3	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connection to load 4 add shed control and status I/O	Load Add Shed Control
42371	Load 5 Device Type	Read / Write	Size (bits): 8 Number of Fields: 3	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connection to load 5 add shed control and status I/O	Load Add Shed Control
42372	Load 6 Device Type	Read / Write	Size (bits):8 Number of Fields: 3	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 6 add shed control and status I/O	Load Add Shed Control
42385	Genset Bus Overload Method	Read / Write	Size (bits):8 Number of Fields: 3	0: Both kW and Frequency 1: kW Only 2: Frequency Only Default: Both kW and Frequency	Use to choose method for determining generator bus overload condition	System Information

Addr.	System Name	Access	Specifications	Description	Function	
42390	Load Demand Enable	Read / Write	Size (bits):8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Use to enable or disable the load demand feature	Load Demand Control
42391	Load Demand GenA	Read / Write	Size (bits): 8 Number of Fields: 4	0: Gen1 1: Gen2 2: Gen3 3: Gen4 Default: Gen1	Sets GenA for fixed sequence load demand	Load Demand Control
42392	Load Demand GenB	Read / Write	Size (bits):8 Number of Fields: 4	0: Gen1 1: Gen2 2: Gen3 3: Gen4 Default: Gen2	Sets GenB for fixed sequence load demand	Load Demand Control
42393	Load Demand GenC	Read / Write	Size (bits):8 Number of Fields: 4	0: Gen1 1: Gen2 2: Gen3 3: Gen4 Default: Gen3	Sets GenC for fixed sequence load demand	Load Demand Control
42394	Load Demand GenD	Read / Write	Size (bits):8 Number of Fields: 4	0: Gen1 1: Gen2 2: Gen3 3: Gen4 Default: Gen4	Sets GenD (first to stop) for fixed sequence load demand	Load Demand Control
42413	System Phase Rotation	Read / Write	Size (bits):8 Number of Fields: 2	0: L1-L2-L3 1:L1-L3-L2 Default: L1-L2-L3	Defines what the system phase rotation sequence is	System Information
42419	Scheduler Program x Enable	Read / Write	Size (bits):8 Number of Fields: 2	0: Disable 1: Enable Default: Disable	Use to enable or disable the selected program	System Scheduler
42420	Scheduler Program x Repeat Interval	Read / Write	Size (bits):8 Number of Fields: 11	0: Once 1: Every Week 2: Every 2 Weeks 3: Every 3 Weeks 4: Every 4 Weeks 5: Every 5 Weeks 6: First Week of Month 7: Second Week of Month 8: Third Week of month 9: Forth Week of the Month 10: Last Week of the Month Default: Once	Use to adjust repeat interval for the selected program	System Scheduler

Addr.	System Name	Access	Specifications	Description	Function	
42421	Scheduler Program x Run Mode	Read / Write	Size (bits): 8 Number of Fields: 3	0: No Load 1: With Load 2: Extended Parallel Default: No Load	Use to adjust run mode for the selected program	System Scheduler
42422	Scheduler Program x Start Day	Read / Write	Size (bits): 8 Number of Fields: 7	0: Sunday 1: Monday 2: Tuesday 3: Wednesday 4: Thursday 5: Friday 6: Saturday Default: Sunday	Use to adjust start day of week for the selected program	System Scheduler
42428	Scheduler Exception x Enable	Read / Write	Size (bits): 8 Number of Fields: 2	0: Disable 1: Enable Default: Disable	Use to enable or disable the selected exception	System Scheduler
42429	Scheduler Exception x Repeat	Read / Write	Size (bits): 8 Number of Fields: 2	0: Once Only 1: Every Year Default: Once Only	Use to adjust the repeat setting of the selected exception	System Scheduler
42437	Daylight Saving Time Enable	Read / Write	Size (bits): 8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Enables the daylight savings time feature	Real Time Clock
42438	Load Demand Refresh Sequence Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Refresh Sequence Default: Do Nothing	Use to force a refresh of the active load demand sequence	Load Demand Control
42439	Genset Connection Type	Read / Write	Size (bits): 8 Number of Fields: 2	0: Wye 1: Delta Default: Wye	Delta or Wye for generator set connection	AC Setup
42443	Genset CT Secondary Current	Read / Write	Size (bits): 8 Number of Fields: 2	0: 1 Amp 1: 5 Amp Default: 5 Amp	Generator set CT secondary current	AC Setup
42444	Utility Connection Type	Read / Write	Size (bits): 8 Number of Fields: 2	0: Wye 1: Delta Default: Wye	Delta or Wye for utility connection	AC Setup
42448	Utility CT Secondary Current	Read / Write	Size (bits): 8 Number of Fields: 2	0: 1 Amp 1: 5 Amp Default: 5 Amp	Utility CT secondary current	AC Setup
42454	Nominal Battery Voltage	Read / Write	Size (bits): 8 Number of Fields: 2	0: 12V 1: 24V Default: 24V	DC voltage provided to the control	Battery Voltage Protection
42461	Genset Online Capacity Sensor Enable	Read / Write	Size (bits): 8 Number of Fields: 2	0: Disable 1: Enable Default: Disable	Use to enable or disable the generator set online capacity sensor	PTC Sensors

Addr.	System Name	Access	Specifications		Description	Function
42472	Gen Bus Base Load Status	Read Only	Size (bits):8 Number of Fields: 2	0: Inactive 1: Active Default:	Indicates that the generator bus is on base load extended paralleling	System Information
42473	Util Bus Peak Shave Status	Read Only	Size (bits): 8 Number of Fields: 2	0: Inactive 1: Active Default:	Indicates that the utility bus is on peak shave extended paralleling	System Information
42600	Extended Parallel Start Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Stop 1: Start Default: Stop	State of extended parallel start volatile input	Discrete Inputs
42601	Synchronizer Enable Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: inactive 1: Active Default: inactive	State of synchronizer enable volatile input	Discrete Inputs
42602	Utility Source Failure Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: inactive 1: Active Default: inactive	State of utility source failure volatile input	Discrete Inputs
42603	Transfer Inhibit Vol	Read / Write	Size (bits):16 Number of Fields: 2	0: No Inhibit 1: Inhibit Default: No Inhibit	State of transfer inhibit volatile input	Discrete Inputs
42604	Retranfer Inhibit Vol	Read / Write	Size (bits):8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default: No Inhibit	State of retransfer inhibit volatile input	Discrete Inputs
42605	Gen CB Inhibit Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default: No Inhibit	State of generator CB inhibit volatile input	Discrete Inputs
42606	Util CB Inhibit Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default: No Inhibit	State of utility CB inhibit volatile input	Discrete Inputs
42607	Auto/Manual Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Auto 1: Manual Default: Auto	State of auto/manual volatile input	Discrete Inputs
42608	Test Start Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Stop 1: Start Default: Stop	State of test start volatile input	Discrete Inputs
42609	Fault Reset Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Not Reset 1: Reset Default: Not Reset	State of fault reset volatile input	Discrete Inputs
42610	Override Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: No Override 1: Override Default: No Override	State of override volatile input	Discrete Inputs
42611	Extended Parallel Start Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Start 1: Stop Default:	State of extended parallel start input	Discrete Inputs

Addr.	System Name	Access	Specifications		Description	Function
42612	Synchronizer Enable Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Inactive 1: Active Default:	State of synchronizer enable input	Discrete Inputs
42613	Utility Source Failure Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Inactive 1: Active Default:	State of utility source failure input	Discrete Inputs
42614	Transfer Inhibit Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default:	State of transfer inhibit input	Discrete Inputs
42615	Retransfer Inhibit Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default:	State of retransfer inhibit input	Discrete Inputs
42616	Gen CB Inhibit Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default:	State of generator CB inhibit input	Discrete Inputs
42617	Util CB Inhibit Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default:	State of utility CB inhibit input	Discrete Inputs
42618	Auto/Manual Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Auto 1: Manual Default:	State of auto/manual input	Discrete Inputs
42619	Test Start Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Stop 1: Start Default:	State of test start input	Discrete Inputs
42620	Fault Reset Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: No Reset 1: Reset Default:	State of fault reset input	Discrete Inputs
42621	Override Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: No Override 1: Override Default:	State of override input	Discrete Inputs
42622	Master Inhibit	Read Only	Size (bits): 8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default:	Indicates state of master priority inhibit	Priority Control
42623	Gen CB Tripped Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Inactive 1: Active Default:	State of generator CB tripped input	Discrete Inputs
42624	Gen CB Tripped Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Inactive 1: Active Default: Inactive	State of generator CB tripped volatile input	Discrete Inputs
42625	Util CB Tripped Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Inactive 1: Active Default:	State of utility CB tripped input	Discrete Inputs
42626	Util Cb Tripped Vol	Read / Write	Size (bits): 8 Number of Fields: 4	0: Inactive 1: Active Default: Inactive	State of utility CB tripped volatile input	Discrete Inputs
42627	Genset Phase Rotation	Read Only	Size (bits): 8 Number of Fields: 2	0: L1-L2-L3 1: L1-L3-L2 Default:	Generator set phase rotation	Phase

Addr.	System Name	Access	Specifications	Description	Function	
42628	Utility Phase Rotation	Read Only	Size (bits): 8 Number of Fields: 2	0: L1-L2-L3 1: L1-L3-L2 Default:	Utility phase rotation	Phase
42629	Gen1 CB Position Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Breaker Open 1: Breaker Closed Default:	State of Gen1 CB position input	Discrete Inputs
42630	Gen1 CB Position Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen1 CB position volatile input	Discrete Inputs
42631	Gen2 CB Position Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Breaker Open 1: Breaker Closed Default:	State of Gen2 CB position input	Discrete Inputs
42632	Gen2 CB Position Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen2 CB position volatile input	Discrete Inputs
42633	Gen3 CB Position Sw	Read Only	Size (bits):16 Number of Fields: 2	0: Breaker Open 1: Breaker Closed Default:	State of Gen3 CB position input	Discrete Inputs
42634	Gen3 CB Position Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen3 CB position volatile input	Discrete Inputs
42635	Gen4 CB Position Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Breaker Open 1: Breaker Closed Default:	State of Gen4 CB position input	Discrete Inputs
42636	Gen4 CB Position Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen4 CB position volatile input	Discrete Inputs
42637	Network Master Inhibit	Read / Write	Size (bits): 8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default: No Inhibit	Use to manually inhibit the module	Priority Control
42700	Gen1 Availability State	Read Only	Size (bits): 8 Number of Fields: 5	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use – Indicates status of Gen1	Load Demand Control
42701	Gen2 Availability State	Read Only	Size (bits): 8 Number of Fields: 5	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use – Indicates status of Gen2	Load Demand Control


Addr.	System Name	Access	Specifications	Description	Function	
42702	Gen3 Availability State	Read Only	Size (bits): 8 Number of Fields: 5	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use – Indicates status of Gen3	Load Demand Control
42703	Gen4 Availability State	Read Only	Size (bits): 8 Number of Fields: 5	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use – Indicates status of Gen4	Load Demand Control
42712	GenA	Read Only	Size (bits): 8 Number of Fields: 4	0: Gen1 1: Gen2 2: Gen3 3: Gen4 Default:	Indicates which generator set is currently GenA for load demand	Load Demand Control
42713	GenB	Read Only	Size (bits): 8 Number of Fields: 4	0: Gen1 1: Gen2 1: Gen3 1: Gen4 Default:	Indicates which generator set is currently GenB for load demand	Load Demand Control
42714	GenC	Read Only	Size (bits): 8 Number of Fields: 4	0: Gen1 1: Gen2 1: Gen3 1: Gen4 Default:	Indicates which generator set is currently GenC for load demand	Load Demand Control
42715	GenD	Read Only	Size (bits): 8 Number of Fields: 4	0: Gen1 1: Gen2 1: Gen3 1: Gen4 Default:	Indicates which generator set is currently GenD (first to stop) for load demand	Load Demand Control
42716	Load Demand State	Read Only	Size (bits): 8 Number of Fields: 3	0: Off 1: Initial Delay Timing 2: Load Monitor Default:	Indicates operating state of the load demand control	Load Demand Control
42721	Next Gen To Restart	Read Only	Size (bits): 8 Number of Fields: 5	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: None Default:	Indicates which generator set is next to be re-started if load conditions are met	Load Demand Control
42722	Next Gen To Shutdown	Read Only	Size (bits): 8 Number of Fields: 5	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: None Default:	Indicates which generator set is next to be stopped if load conditions are met	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function	
42723	Load Demand Gen1 Driver Status	Read Only	Size (bits): 8 Number of Fields: 2	0: Run 1: Load Demand Stop Default:	Status of the load demand Gen1 driver output	Discrete Outputs
42724	Load Demand Gen2 Driver Status	Read Only	Size (bits): 8 Number of Fields: 2	0: Run 1: Load Demand Stop Default:	Status of the load demand Gen2 driver output	Discrete Outputs
42725	Load Demand Gen3 Driver Status	Read Only	Size (bits): 8 Number of Fields: 2	0: Run 1: Load Demand Stop Default:	Status of the load demand Gen3 driver output	Discrete Outputs
42726	Load Demand Gen4 Driver Status	Read Only	Size (bits): 8 Number of Fields: 2	0: Run 1: Load Demand Stop Default:	Status of the load demand Gen4 driver output	Discrete Outputs
42728	Genset Bus kW Overload Status	Read Only	Size (bits): 8 Number of Fields: 2	0: No Overload 1: Overload Default:	Indicates whether generator bus is overloaded based on kW	System Information
42729	Genset Bus Underfrequency Overload Status	Read Only	Size (bits): 8 Number of Fields: 2	0: No Overload 1: Overload Default:	Indicates whether generator bus is overloaded based on frequency	System Information
42730	Active Schedule	Read Only	Size (bits): 8 Number of Fields: 19	0: None 1: Program 1 2: Program 2 3: Program 3 4: Program 4 5: Program 5 6: Program 6 7: Program 7 8: Program 8 9: Program 9 10: Program 10 11: Program 11 12: Program 12 13: Exception 1 14: Exception 2 15: Exception 3 16: Exception 4 17: Exception 5 18: Exception 6 Default:	Indicates the currently active scheduler program or exception	System Scheduler

Addr.	System Name	Access	Specifications	Description	Function	
42731	Scheduler Run Command	Read Only	Size (bits): 8 Number of Fields: 4	0: Off 1: No Load 2: With Load 3: Extended Parallel Default:	Indicates current run command coming from the scheduler function	System Scheduler
42737	Modbus Clear Counters	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Clear Counters Default: Do Nothing	Clears all the Modbus counters	Communications
42738	Clock Mode	Read / Write	Size (bits): 8 Number of Fields: 3	0: Normal 1: Set Clock 2: Save Clock Default: Normal	Use to set clock and save setting	Real Time Clock
42745	Clock Day	Read Only	Size (bits): 8 Number of Fields: 7	0: Sunday 1: Monday 2: Tuesday 3: Wednesday 4: Thursday 5: Friday 6: Saturday Default:	Indicates day of week for current date	Real Time Clock



THIS PAGE LEFT INTENTIONALLY BLANK



7 DMC 10000 Modbus Bitmap Data


Note: Earlier versions of software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

Note: If an address or bit is not listed in this table, it is not used.

Addr.	Bit#	System Name	Fault Code	Event Name	Response
42500	0	Fault Status Bit-map 1	1455	Utility Main Breaker Position Contact Warning	Warning
42500	1	Fault Status Bit-map 1	2396	Utility Main Breaker Fail To Close Warning	Warning
42500	2	Fault Status Bit-map 1	2397	Utility Main Breaker Fail To Open Warning	Warning
42500	3	Fault Status Bit-map 1	1219	Utility Main Breaker Tripped Warning	Warning
42500	4	Fault Status Bit-map 1	1914	Utility Bus Phase Rotation Warning	Warning
42500	5	Fault Status Bit-map 1	1912	Utility Bus Loss Of Phase Warning	Warning
42500	6	Fault Status Bit-map 1	2331	Utility Bus Undervoltage Warning	Warning
42500	7	Fault Status Bit-map 1	2358	Utility Bus Overvoltage Warning	Warning
42500	8	Fault Status Bit-map 1	1223	Utility Bus Frequency Warning	Warning
42500	24	Fault Status Bit-map 1	2648	Remote I/O Communication Failure Warning	Warning
42500	25	Fault Status Bit-map 1	1689	Real Time Clock Power Interrupt Warning	Warning
42500	26	Fault Status Bit-map 1	1335	AC Metering Out Of Range Warning	Warning
42500	27	Fault Status Bit-map 1	1999	Maximum Parallel Time Warning	Warning
42500	28	Fault Status Bit-map 1	343	Hardware Failure Warning	Warning
42500	29	Fault Status Bit-map 1	1456	Synchronizer Output Limit Warning	Warning
42500	30	Fault Status Bit-map 1	2416	Calibration Checksum Warning	Warning
42500	31	Fault Status Bit-map 1	353	EEPROM Write Error Warning	Warning

Addr.	Bit#	System Name	Fault Code	Event Name	Response
42502	0	Fault Status Bit-map 2	1454	Genset Main Breaker Position Contact Warning	Warning
42502	1	Fault Status Bit-map 2	1452	Genset Main Breaker Fail To Close Warning	Warning
42502	2	Fault Status Bit-map 2	1453	Genset Main Breaker Tripped Warning	Warning
42502	3	Fault Status Bit-map 2	1328	Genset Bus Phase Rotation Warning	Warning
42502	4	Fault Status Bit-map 2	1915	Genset Bus Phase Rotation Warning	Warning
42502	5	Fault Status Bit-map 2	1913	Genset Bus Loss Of Phase Warning	Warning
42502	6	Fault Status Bit-map 2	1225	Genset Bus Undervoltage Warning	Warning
42502	7	Fault Status Bit-map 2	1224	Genset Bus Overvoltage Warning	Warning
42502	8	Fault Status Bit-map 2	1226	Genset Bus Frequency Warning	Warning
42502	24	Fault Status Bit-map 2	1541	Genset Failed To Come Online Warning	Warning
42502	25	Fault Status Bit-map 2	2647	Load Demand Setup Warning	Warning
42502	26	Fault Status Bit-map 2	1444	Genset Bus Overload Warning	Warning
42502	27	Fault Status Bit-map 2	1989	kW Load Control Output Limit Warning	Warning
42502	28	Fault Status Bit-map 2	1991	kVAR Load Control Output Limit Warning	Warning
42502	29	Fault Status Bit-map 2	1121	Fail To Disconnect Warning	Warning
42502	30	Fault Status Bit-map 2	1458	Synchronizer Phase Rotation Mismatch Warning	Warning
42502	31	Fault Status Bit-map 2	1457	Fail To Synchronizer Warning	Warning
42504	0	Event Status Bit-map 1	1222	Not in Automatic Event	Event
42504	1	Event Status Bit-map 1	1483	Common Warning Event	Event
42504	2	Event Status Bit-map 1	2965	Genset Bus Available Event	Event
42504	3	Event Status Bit-map 1	2328	Utility Bus Available Event	Event

Addr.	Bit#	System Name	Fault Code	Event Name	Response
42504	4	Event Status Bit-map 1	2333	Genset Bus Connected Event	Event
42504	5	Event Status Bit-map 1	2332	Utility Bus Connected Event	Event
42504	6	Event Status Bit-map 1	2971	Test / Extended Parallel Event	Event
42504	7	Event Status Bit-map 1	1916	Synchronized Event	Event
42504	8	Event Status Bit-map 1	1534	Load Control Output Event	Event





THIS PAGE LEFT INTENTIONALLY BLANK



8. DMC 1500 Communication Server 1

Modbus Address: 2 (Slave).

Note: If an address or bit is not listed in this table, it is not used.

Note: The external device can read 1–40 contiguous registers, write 1–40 contiguous registers, or read diagnostic counters.

Modbus Address	Bit #	Alarm Event
40001	0 (LSB)	Utility Main Breaker Position Contact Warning
40001	1	Utility Main Breaker Fail To Close Warning
40001	2	Utility Main Breaker Fail To Open Warning
40001	3	Utility Main Breaker Tripped Warning
40001	4	Utility Bus Phase Rotation Warning
40001	5	Utility Bus Loss of Phase Warning
40001	6	Utility Bus Undervoltage Warning
40001	7	Utility Bus Overvoltage Warning
40001	8	Utility Bus Frequency Warning
40001	9	Remote IO Comm Failure Warning
40001	10	Real Time Clock Power Interrupt Warning
40001	11	AC Metering Out Of Range Warning
40001	12	Maximum Parallel Time Warning
40001	13	Unused
40001	14	Synchronizer Output Limit Warning
40001	15 (MSB)	Calibration Checksum Warning MCM 3320

Modbus Address	Bit #	Alarm Event
40002	0 (LSB)	EEPROM Write Error Warning MCM 3320
40002	1	Genset Main Breaker Position Contact Warning
40002	2	Genset Main Breaker Fail to Close Warning
40002	3	Genset Main Breaker Fail to Open Warning
40002	4	Genset Main Breaker Tripped Warning
40002	5	Genset Bus Phase Rotation Warning
40002	6	Genset Bus Loss of Phase Warning
40002	7	Genset Bus Undervoltage Warning
40002	8	Genset Bus Overvoltage Warning
40002	9	Genset Bus Frequency Warning
40002	10	Low Battery Voltage Warning MCM 3320
40002	11	High Battery Voltage Warning MCM 3320
40002	12	Genset Failed to Come Online Warning
40002	13	Load Demand Setup Warning

Modbus Address	Bit #	Alarm Event
40002	14	Genset Bus Over Load Limit Warning
40002	15 (MSB)	kW Load Control Output Limit Warning

Modbus Address	Bit #	Alarm Event
40003	0 (LSB)	KVAR Load Control Output Limit Warning
40003	1	Fail to Disconnect Warning
40003	2	Synchronizer Phase Rotation Mismatch Warning
40003	3	Fail to Synchronize Warning
40003	4	Normal Operation Lockout
40003	5	Common Warning MCM 3320
40003	6	Common Server 1 to Network ATS Comm Failure
40003	7	Common Server 1 to MCM3320 Comm Failure
40003	8	Common Server 1 Battery Warning
40003	9	Common Server 1 Comm Server 2 Comm Failure
40003	10	Unused
40003	11	Unused
40003	12	Unused
40003	13	Unused
40003	14	Unused
40003	15 (MSB)	Unused

Modbus Address	Bit #	Alarm Event
40004	0 (LSB)	Feeder Breaker 1 Trip
40004	1	Feeder Breaker 2 Trip
40004	2	Feeder Breaker 3 Trip
40004	3	Feeder Breaker 4 Trip
40004	4	Feeder Breaker 5 Trip
40004	5	Feeder Breaker 6 Trip
40004	6	Feeder Breaker 7 Trip
40004	7	Feeder Breaker 8 Trip
40004	8	Feeder Breaker 9 Trip
40004	9	Feeder Breaker 10 Trip
40004	10	Unused
40004	11	Unused
40004	12	Unused
40004	13	Unused
40004	14	Unused
40004	15 (MSB)	Unused

Note: 40405 is unused.

Modbus Address	Bit #	Alarm Event
40006	0 (LSB)	System in Auto-Opened Transition
40006	1	System in Auto-Hard Closed Transition

Modbus Address	Bit #	Alarm Event
40006	2	System in Auto-Soft Closed Transition
40006	3	System Manual Mode Active
40006	4	System Automatic Mode Active
40006	5	Common Warning Event
40006	6	Genset Bus Available Event
40006	7	Utility Bus Available Event
40006	8	Genset Bus Connected Event
40006	9	Utility Bus Connected Event
40006	10	Synchronized Event
40006	11	Load Control Output Event
40006	12	Genset Source Unloaded Event
40006	13	Utility Source Unloaded Event
40006	14	Genset Bus Load Event
40006	15 (MSB)	Utility Bus Peak Shave Event

Modbus Address	Bit #	Alarm Event
40007	0 (LSB)	Extended Paralleling Enable
40007	1	Extended Paralleling Disable
40007	2	System in Extended Parallel
40007	3	System in Test with Load
40007	4	System in Test without Load
40007	5	System Test Off
40007	6	Load Demand Enable
40007	7	Load Demand Disable
40007	8	Extended Parallel Off
40007	9	Unused
40007	10	Unused
40007	11	Unused
40007	12	Unused
40007	13	Unused
40007	14	Unused
40007	15 (MSB)	Unused

Generator Set Bus Data

Generator Bus Data	MB Address	Data Type	Multiplier	Units
Generator Set L1N Volts	40009	16U	1	Volts
Generator Set L2N Volts	40010	16U	1	Volts
Generator Set L3N Volts	40011	16U	1	Volts
Generator Set LN Average Volt	40012	16U	1	Volts
Generator set L1L2 Volts	40013	16U	1	Volts
Generator Set L2L3 Volts	40014	16U	1	Volts
Generator Set L3L1 Volts	40015	16U	1	Volts
Generator Set LL Average Volts	40016	16U	1	Volts

Generator Bus Data	MB Address	Data Type	Multiplier	Units
Generator Set L1 Current	40017	16U	1	Amps
Generator Set L2 Current	40018	16U	1	Amps
Generator Set L3 Current	40019	16U	1	Amps
Generator Set Average Current	40020	16U	1	Amps
Generator Set L1 kW	40021	16S	1	kW
Generator Set L2 kW	40022	16S	1	kW
Generator Set L3 kW	40023	6S	1	kW
Generator Set Total kW	40024	16S	1	kW
Generator Set L1 kVAR	40025	16S	1	kVAR
Generator Set L2 kVAR	40026	16S	1	kVAR
Generator Set L3 kVAR	40027	16S	1	kVAR
Generator Set Total kVAR	40028	16S	1	kVAR
Generator Set Total Power Factor	40029	16S	0.01	
Generator Set L1 kVA	40030	16U	1	kVA
Generator Set L2 kVA	40031	16U	1	kVA
Generator Set L3 kVA	40032	16U	1	kVA
Generator Set Total kVA	40033	16U	1	kVA
MB Generator Set Frequency	40034	16U	0.1	Hz
Generator Set Total Negative kWh	40035	32U	1	kWh
	40036			
Generator Set Total Positive kWh	40037	32U	1	kWh
	40038			
Generator Set Total Net kWh	40039	32S	1	kWh
	40040			
Generator Set Total Negative kVARh	40041	32U	1	kVARh
	40042			
Generator Set Total Positive kVARh	40043	32U	1	kVARh
	40044			
Generator Set Total Net kVARh	40045	32S	1	kVARh
	40046			
Generator Set Total kVAh	40047	32U	1	kVAh
	40048			
Generator Set Available Current	40049	16U	1	Amps
Generator Set L1 Current Percent	40050	16U	0.1	%
Generator Set L2 Current Percent	40051	16U	0.1	%
Generator Set L3 Current Percent	40052	16U	0.1	%
Generator Set Total kW Percent	40053	16U	0.1	%
Generator Set Frequency Percent	40054	16S	0.1	%
Generator Set L1L2 Voltage Percent	40055	16U	0.1	%
Generator Set L2L3 Voltage Percent	40056	16U	0.1	%
Generator Set L3L1 Voltage Percent	40057	16U	0.1	%

Utility Bus Data

Utility Bus Data	MB Address	Data Type	Multiplier	Units
Utility L1N Voltage	40059	16U	1	Volts
Utility L2N Voltage	40060	16U	1	Volts
Utility L3N Voltage	40061	16U	1	Volts
Utility LN Average Voltage	40062	16U	1	Volts
Utility L1L2 Voltage	40063	16U	1	Volts
Utility L2L3 Voltage	40064	16U	1	Volts
Utility L3L1 Voltage	40065	16U	1	Volts
Utility LL Average Voltage	40066	16U	1	Volts
Utility L1 Current	40067	16U	1	Amps
Utility L2 Current	40068	16U	1	Amps
Utility L3 Current	40069	16U	1	Amps
Utility Average Current	40070	16U	1	Amps
Utility L1 kW	40071	16S	1	kW
Utility L2 kW	40072	16S	1	kW
Utility L3 kW	40073	16S	1	kW
Utility Total kW	40074	16S	1	kW
Utility L1 kVAR	40075	16S	1	kVAR
Utility L2 kVAR	40076	16S	1	kVAR
Utility L3 kVAR	40077	16S	1	kVAR
Utility Total kVAR	40078	16S	1	kVAR
Utility Total Power Factor	40079	16S	0.01	
Utility L1 kVA	40080	16U	1	kVA
Utility L2 kVA	40081	16U	1	kVA
Utility L3 kVA	40082	16U	1	kVA
Utility Total kVA	40083	16U	1	kVA
MB Utility Frequency	40084	16U	0.1	Hz
Utility Total Negative kWh	40085	32U	1	kWh
	40086			
Utility Total Positive kWh	40087	32U	1	kWh
	40088			
Utility Total Net kWh	40089	32S	1	kWh
	40090			
Utility Total Negative kVARh	40091	32U	1	kVARh
	40092			
Utility Total Positive kVARh	40093	32U	1	kVARh
	40094			
Utility Total Net kVARh	40095	32S	1	kVARh
	40096			
Utility Total kVAh	40097	32U	1	kVAh
	40098			
System Total kW	40099	16S	1	kW

Utility Bus Data	MB Address	Data Type	Multiplier	Units
System Total kVAR	40100	16S	0.01	kVAR
System Total Power Factor	40101	16S	1	
System Total kVA	40102	16U	1	KVA

ATS 1-5 DATA

ATS Raw Data	ATS 1	ATS 2	ATS 3	ATS 4	ATS 5	Multiplier	Units
Device Type	40257	40317	40377	40437	40513		
Mode (See table 6-2 page 339)	40258	40318	40378	40438	40514		
State (See Table 6-1 page 339)	40259	40319	40379	40439	40515		
Fault Code	40260	40320	40380	40440	40516		
Fault Type (See table 6-3 page 339)	40261	40321	40381	40441	40517		
Percent Amps	40262	40322	40382	40442	40518	0.5	%
Total kW	40263	40323	40383	40443	40519		
NFPA 110 (See Section 4 Table 4-1 page 323)	40264	40324	40384	40444	40520		
NFPA Extended(See Section 4 Table 4-2 page 323)	40265	40325	40385	40445	40521		
Frequency Load	40266	40326	40386	40446	40522	0.1	Hz
Total pf Load	40267	40327	40387	40447	40523	0.00005	pf
Total KVA Load	40268	40328	40388	40448	40524		KVA
Total kW Load	40269	40329	40389	40449	40525		kW
Total KVAR Load	40270	40330	40390	40450	40526		kVAR
Volts ab Load	40271	40331	40391	40451	40527		Volts
Volts bc Load	40272	40332	40392	40452	40528		Volts
Volts ca Load	40273	40333	40393	40453	40529		Volts
Volts a Load	40274	40334	40394	40454	40530		Volts
Volts b Load	40275	40335	40395	40455	40531		Volt
Volts c Load	40276	40336	40396	40456	40532		Volts
Amps a Load	40277	40337	40397	40457	40533		Amps
Amps b Load	40278	40338	40398	40458	40534		Amps
Amps c Load	40279	40339	40399	40459	40535		Amps
Percent Amps a Load	40280	40340	40400	40460	40536	0.5	%
Percent Amps b Load	40281	40341	40401	40461	40537	0.5	%
Percent Amps c Load	40282	40342	40402	40462	40538	0.5	%
Frequency SRC1	40283	40343	40403	40463	40539	0.1	Hz
Total pf SRC1	40284	40344	40404	40464	40540	0.00005	PF
Total KVA SRC1	40285	40345	40405	40465	40541		
Total kW SRC1	40286	40346	40406	40466	40542		
Total KVAR SRC1	40287	40347	40407	40467	40543		
Volts ab SRC1	40288	40348	40408	40468	40544		
Volts bc SRC1	40289	40349	40409	40469	40545		
Volts ca SRC1	40290	40350	40410	40470	40546		
Volts a SRC1	40291	40351	40411	40471	40547		

ATS Raw Data	ATS 1	ATS 2	ATS 3	ATS 4	ATS 5	Multiplier	Units
Volts b SRC1	40292	40352	40412	40472	40548		Volts
Volts c SRC1	40293	40353	40413	40473	40549		
Amps a SCR1	40294	40354	40414	40474	40550		Amps
Amps b SCR1	40295	40355	40415	40475	40551		
Amps c SRC1	40296	40356	40416	40476	40552		
Percent Amps a SCR1	40297	40357	40417	40477	40553	0.5	%
Percent Amps b SCR1	40298	40358	40418	40478	40554	0.5	%
Percent Amps c SCR1	40299	40359	40419	40479	40555	0.5	%
Frequency SRC2	40300	40360	40420	40480	40556	0.1	Hz
Total pf SRC2	40301	40361	40421	40481	40557	0.00005	pf
Total KVA SRC2	40302	40362	40422	40482	40558		KVA
Total kW SRC2	40303	40363	40423	40483	40559		kW
Total KVAR SRC2	40304	40364	40424	40484	40560		KVAR
Volts ab SRC2	40305	40365	40425	40485	40561		Volts
Volts bc SRC2	40306	40366	40426	40486	40562		Volts
Volts ca SRC2	40307	40367	40427	40487	40563		Volts
Volts a SRC2	40308	40368	40428	40488	40564		Volts
Volts b SRC2	40309	40369	40429	40489	40565		Volts
Volts c SRC2	40310	40370	40430	40490	40566		Volts
Amps a SRC2	40311	40371	40431	40491	40567		Amps
Amps b SRC2	40312	40372	40432	40492	40568		Amps
Amps c SRC2	40313	40373	40433	40493	40569		Amps
Percent Amps a SRC2	40314	40374	40434	40494	40570	0.5	%
Percent Amps b SRC2	40315	40375	40435	40495	40571	0.5	%
Percent Amps c SRC2	40316	40376	40436	40496	40572	0.5	%

Word Data (Reference Tables ATS 1-5 and 6-10)

Table 6-1

Digital	State
0	Neutral
1	Source 1 Connected
2	Source 2 Connected
3	Source 1 and 2 Connected

Table 6-2

Digital	Mode
0	Test
1	Utility / Genset
2	Utility / Utility
3	Genset / Genset

Table 6-3

Digital	Fault Type
0	No Faults
1	Warning

ATS 6-10 DATA

ATS Raw Data	ATS 6	ATS 7	ATS 8	ATS 9	ATS 10	Multiplier	Units
Device Type	40573	40633	40693	40769	40829		
Mode (See table 6-2 page 339)	40574	40634	40694	40770	40830		
State (See table 6-1 page 339)	40575	40635	40695	40771	40831		
Fault Code	40576	40636	40696	40772	40832		
Fault Type (See table 6-3 page 339)	40577	40637	40697	40773	40833		
Percent Amps	40578	40638	40698	40774	40834	0.5	%
Total kW	40579	40639	40699	40775	40835		
NFPA 110 (See Section 4 Table 4-1 page 323)	40580	40640	40700	40776	40836		
NFPA Extended(See Section 4 Table 4-2 page 323)	40581	40641	40701	40777	40837		
Frequency Load	40582	40642	40702	40778	40838	0.1	Hz
Total pf Load	40583	40643	40703	40779	40839	0.00005	PF
Total KVA Load	40584	40644	40704	40780	40840		KVA
Total kW Load	40585	40645	40705	40781	40841		kW
Total KVAR Load	40586	40646	40706	40782	40842		kVAR
Volts ab Load	40587	40647	40707	40783	40843		Volts
Volts bc Load	40588	40648	40708	40784	40844		Volts
Volts ca Load	40589	40649	40709	40785	40845		Volts
Volts a Load	40590	40650	40710	40786	40846		Volts
Volts b Load	40591	40651	40711	40787	40847		Volts
Volts c Load	40592	40652	40712	40788	40848		Volts
Amps a Load	40593	40653	40713	40789	40849		Amps
Amps b Load	40594	40654	40714	40790	40850		Amps
Amps c Load	40595	40655	40715	40791	40851		Amps
Percent Amps a Load	40596	40656	40716	40792	40852	0.5	%
Percent Amps b Load	40597	40657	40717	40793	40853	0.5	%
Percent Amps c Load	40598	40658	40718	40794	40854	0.5	%
Frequency SRC1	40599	40659	40719	40795	40855	0.1	Hz
Total pf SRC1	40600	40660	40720	40796	40856	0.00005	PF
Total KVA SRC1	40601	40661	40721	40797	40857		KVA
Total kW SRC1	40602	40662	40722	40798	40858		kW
Total KVAR SRC1	40603	40663	40723	40799	40859		kVAR
Volts bc SRC1	40604	40664	40724	40800	40860		Volts
Volts bc SRC1	40605	40665	40725	40801	40861		Volts
Volts ca SRC1	40606	40666	40726	40802	40862		Volts
Volts a SRC1	40607	40667	40727	40803	40863		Volts
Volts b SRC1	40608	40668	40728	40804	40864		Volts
Volts c SRC1	40609	40669	40729	40805	40865		Volts
Amps a SCR1	40610	40670	40730	40806	40866		Amps
Amps b SCR1	40611	40671	40731	40807	40867		Amps

ATS Raw Data	ATS 6	ATS 7	ATS 8	ATS 9	ATS 10	Multiplier	Units
Amps c SRC1	40612	40672	40732	40808	40868		Amps
Percent Amps a SCR1	40613	40673	40733	40709	40869	0.5	%
Percent Amps b SCR1	40614	40674	40734	40710	40870	0.5	%
Percent Amps c SCR1	40615	40675	40735	40811	40871	0.5	%
Frequency SRC2	40616	40676	40736	40812	40872	0.1	Hz
Total pf SRC2	40617	40677	40737	40813	40873	0.00005	pf
Total KVA SRC2	40618	40678	40738	40814	40874		KVA
Total kW SRC2	40619	40679	40739	40815	40875		kW
Total KVAR SRC2	40620	40680	40740	40816	40876		KVAR
Volts ab SRC2	40621	40681	40741	40817	40877		Volts
Volts bc SRC2	40622	40682	40742	40818	40878		Volts
Volts ca SRC2	40623	40683	40743	40819	40879		Volts
Volts a SRC2	40624	40684	40744	40820	40880		Volts
Volts b SRC2	40625	40685	40745	40821	40881		Volts
Volts c SRC2	40626	40686	40746	40822	40882		Volts
Amps a SRC2	40627	40687	40747	40823	40883		Amps
Amps b SRC2	40628	40688	40748	40824	40884		Amps
Amps c SRC2	40629	40689	40749	40825	40885		Amps
Percent Amps a SRC2	40630	40690	40750	40826	40886	0.5	%
Percent Amps b SRC2	40631	40691	40751	40827	40887	0.5	%
Percent Amps c SRC2	40632	40692	40752	40828	40888	0.5	%



THIS PAGE LEFT INTENTIONALLY BLANK



9. DMC 1500 Communication Server 2

Modbus Address: 1 (Slave).

Note: If an address or bit is not listed in this table, it is not used.

Note: The external device can read 1–40 contiguous registers, write 1–40 contiguous registers, or read diagnostic counters.

Modbus Address	Bit #	Alarm Event
40001	0 (LSB)	Neutral Earthing 1 Fail to Open Warning
40001	1	Neutral Earthing 2 Fail to Open Warning
40001	2	Neutral Earthing 3 Fail to Open Warning
40001	3	Neutral Earthing 4 Fail to Open Warning
40001	4	Neutral Earthing 5 Fail to Open Warning
40001	5	Neutral Earthing 6 Fail to Open Warning
40001	6	Neutral Earthing 7 Fail to Open Warning
40001	7	Neutral Earthing 8 Fail to Open Warning
40001	8	Neutral Earthing 1 Fail to Closed Warning
40001	9	Neutral Earthing 2 Fail to Closed Warning
40001	10	Neutral Earthing 3 Fail to Closed Warning
40001	11	Neutral Earthing 4 Fail to Closed Warning
40001	12	Neutral Earthing 5 Fail to Closed Warning
40001	13	Neutral Earthing 6 Fail to Closed Warning
40001	14	Neutral Earthing 7 Fail to Closed Warning
40001	15 (MSB)	Neutral Earthing 8 Fail to Closed Warning

Modbus Address	Bit #	Alarm Event
40002	0 (LSB)	Neutral Earthing 1 Tripped Warning
40002	1	Neutral Earthing 2 Tripped Warning
40002	2	Neutral Earthing 3 Tripped Warning
40002	3	Neutral Earthing 4 Tripped Warning
40002	4	Neutral Earthing 5 Tripped Warning
40002	5	Neutral Earthing 6 Tripped Warning
40002	6	Neutral Earthing 7 Tripped Warning
40002	7	Neutral Earthing 8 Tripped Warning
40002	8	Undergrounded Bus Warning
40002	9	Undergrounded Bus Failure – System Shutdown
40002	10	Multiple NECs Connected
40002	11	Multiple System Grounds Connected
40002	12	Unused
40002	13	Unused

Modbus Address	Bit #	Alarm Event
40002	14	Unused
40002	15 (MSB)	Unused

Modbus Address	Bit #	Alarm Event
40003	0 (LSB)	Station Battery Power Supply Fault
40003	1	UPS Fault
40003	2	On Station Battery Warning
40003	3	System Manual Mode Active
40003	4	Utility Failure
40003	5	Utility Out of Limits for Extended Parallel
40003	6	Common Server 2 Battery Warning
40003	7	System Emergency Stop
40003	8	Hardware Failure Warning MCM 3320
40003	9	Unused
40003	10	Unused
40003	11	Unused
40003	12	Unused
40003	13	Unused
40003	14	Unused
40003	15 (MSB)	Unused

Modbus Address	Bit #	Alarm Event
40004	0 (LSB)	Illegal Genset Node Address Assignment
40004	1	Unused
40004	2	Unused
40004	3	Comm Server 2 to Comm Server 1 Comm Failure
40004	4	Manufacturing Test Mode Active
40004	5	Unused
40004	6	Unused
40004	7	Unused
40004	8	Comm Server 2 to Genset 1 Comm Failure
40004	9	Comm Server 2 to Genset 2 Comm Failure
40004	10	Comm Server 2 to Genset 3 Comm Failure
40004	11	Comm Server 2 to Genset 4 Comm Failure
40004	12	Comm Server 2 to Genset 5 Comm Failure
40004	13	Comm Server 2 to Genset 6 Comm Failure
40004	14	Comm Server 2 to Genset 7 Comm Failure
40004	15 (MSB)	Comm Server 2 to Genset 8 Comm Failure

Note: 40005 is unused.

Modbus Address	Bit #	Alarm Event
40006	0 (LSB)	Gen 1 Breaker Closed
40006	1	Gen 2 Breaker Closed

Modbus Address	Bit #	Alarm Event
40006	2	Gen 3 Breaker Closed
40006	3	Gen 4 Breaker Closed
40006	4	Gen 5 Breaker Closed
40006	5	Gen 6 Breaker Closed
40006	6	Gen 7 Breaker Closed
40006	7	Gen 8 Breaker Closed
40006	8	Gen 1 Breaker Open
40006	9	Gen 2 Breaker Open
40006	10	Gen 3 Breaker Open
40006	11	Gen 4 Breaker Open
40006	12	Gen 5 Breaker Open
40006	13	Gen 6 Breaker Open
40006	14	Gen 7 Breaker Open
40006	15 (MSB)	Gen 8 Breaker Open

Modbus Address	Bit #	Alarm Event
40007	0 (LSB)	Gen 1 Running
40007	1	Gen 2 Running
40007	2	Gen 3 Running
40007	3	Gen 4 Running
40007	4	Gen 5 Running
40007	5	Gen 6 Running
40007	6	Gen 7 Running
40007	7	Gen 8 Running
40007	8	Gen 1 Fault
40007	9	Gen 2 Fault
40007	10	Gen 3 Fault
40007	11	Gen 4 Fault
40007	12	Gen 5 Fault
40007	13	Gen 6 Fault
40007	14	Gen 7 Fault
40007	15 (MSB)	Gen 8 Fault

Modbus Address	Bit #	Alarm Event
40008	0 (LSB)	Gen 1 Shut Down in Load Demand
40008	1	Gen 2 Shut Down in Load Demand
40008	2	Gen 3 Shut Down in Load Demand
40008	3	Gen 4 Shut Down in Load Demand
40008	4	Gen 5 Shut Down in Load Demand
40008	5	Gen 6 Shut Down in Load Demand
40008	6	Gen 7 Shut Down in Load Demand
40008	7	Gen 8 Shut Down in Load Demand
40008	8	Gen Start Signal On MCM 3320

Modbus Address	Bit #	Alarm Event
40008	9	Gen Start Signal Off MCM 3320
40008	10	Gen Main Breaker Closed
40008	11	Gen Main Breaker Opened
40008	12	Utility Main Breaker Closed
40008	13	Utility Main Breaker Opened
40008	14	Utility Failure
40008	15 (MSB)	Return to Utility

Modbus Address	Bit #	Alarm Event
40009	0 (LSB)	Remote Commands Enable
40009	1	Remote Commands Disable
40009	2	Remote Test On
40009	3	Remote Test Off
40009	4	Remote Extended Parallel On
40009	5	Remote Extended Parallel Off
40009	6	Remote Transfer Inhibit On
40009	7	Remote Transfer Inhibit Off
40009	8	Remote Retransfer Inhibit On
40009	9	Remote Retransfer Inhibit Off
40009	10	Auto Genset Start Inhibit in Manual Mode Enable
40009	11	Auto Genset Start Inhibit in Manual Mode Disable
40009	12	Unused
40009	13	Unused
40009	14	Unused
40009	15 (MSB)	Unused

Generator Raw Data Gen 1-5

Generator Raw Data	Gen 1	Gen 2	Gen 3	Gen 4	Gen 5	Multiplier	Units
Device Type	40011	40066	40121	40176	40257		
Control Switch (See table 6-7 page 338)	40012	40067	40122	40177	40258		
State (See table 6-1 page 338)	40013	40068	40123	40178	40259		
Fault Code	40014	40069	40124	40179	40260		
Fault Type (See table 6-6 page 338)	40015	40070	40125	40180	40261		
Percent kW Standby	40016	40071	40126	40181	40262	0.5	%
Total kW	40017	40072	40127	40182	40263		
NFPA 110 (See Section 4, Table 4-3 on page 323)	40018	40073	40128	40183	40264		
NFPA Extended (See Section 4, Table 4-4 on page 323)	40019	40074	40129	40184	40265		
Frequency	40020	40075	40130	40185	40266	0.1	Hz
Total pf	40021	40076	40131	40186	40267	0.00005	pf
Total KVA	40022	40077	40132	40187	40268		KVA
Total kW	40023	40078	40133	40188	40269		kW

Generator Raw Data	Gen 1	Gen 2	Gen 3	Gen 4	Gen 5	Multiplier	Units
Total KVAR	40024	40079	40134	40189	40270		kVAR
Volts ab	40025	40080	40135	40190	40271		Volts
Volts bc	40026	40081	40136	40191	40272		Volts
Volts ca	40027	40082	40137	40192	40273		Volts
Volts a	40028	40083	40138	40193	40274		Volts
Volts b	40029	40084	40139	40194	40275		Volt
Volts c	40030	40085	40140	40195	40276		Volts
Amps a	40031	40086	40141	40196	40277		Amps
Amps b	40032	40087	40142	40197	40278		Amps
Amps c	40033	40088	40143	40198	40279		Amps
Percent Amps a	40034	40089	40144	40199	40280	0.5	%
Percent Amps b	40035	40090	40145	40200	40281	0.5	%
Percent Amps c	40036	40091	40146	40201	40282	0.5	%
Battery Voltage	40037	40092	40147	40202	40283	0.1	Volts
Oil Pressure	40038	40093	40148	40203	40284	0.1	KPA
Oil Temp	40039	40094	40149	40204	40285	0.1	Deg K
Coolant Temp	40040	40095	40150	40205	40286	0.1	Deg K
Fuel Rate	40041	40096	40151	40206	40287	0.001	GPH
Engine RPM	40042	40097	40152	40207	40288		RPM
Engine Starts	40043	40098	40153	40208	40289		Starts
Engine Runtime High	40044	40099	40154	40209	40290		
Engine Runtime Low	40045	40100	40155	40210	40291	0.1	Sec
Total kWh High	40046	40101	40156	40211	40292		
Total kWh Low	40047	40102	40157	40212	40293		KWH
Total Fuel High	40048	40103	40158	40213	40294		
Total Fuel Low	40049	40104	40159	40214	40295	0.01	GAL
Bus Frequency	40050	40105	40160	40215	40296	0.1	Hz
Bus Volts ab	40051	40106	40161	40216	40297		Volts
Bus Volts bc	40052	40107	40162	40217	40298		Volts
Bus Volts ca	40053	40108	40163	40218	40299		Volts
Bus Volts a	40054	40109	40164	40219	40300		Volts
Bus Volts b	40055	40110	40165	40220	40301		Volts
Bus Volts c	40056	40111	40166	40221	40302		Volts
Customer Faults	40057	40112	40167	40222	40303		
Network Faults	40058	40113	40168	40223	40304		
Customer Faults	40059	40114	40169	40224	40305		
ES State (See Table 7-2 page 338)	40060	40115	40170	40225	40306		
Load Share State (See Table 7-3 page 338)	40061	40116	40171	40226	40307		
Load Govern State kW (See Table 7-7 page 338)	40062	40117	40172	40227	40308		
Load Govern State kVAR (See Table 7-5 Page 338)	40063	40118	40173	40228	40309		

**Word Data (Reference the ATS 6-1 and 6-10 tables
in Section 5)**

Table 7-1

Digital	State
0	Stopped
1	Start Pending
2	Warm-up at Idle
3	Running
4	Cooldown at Rated
5	Cooldown at idle

Table 7-2

Digital	ES State
0	Standby
1	Dead Bus Close
2	Synchronizing
3	Load Share
4	Load Govern

Table 7-3

Digital	Load Share State
0	Not in Load Share
1	Track Load
2	Ramp Load
3	Ramp Unload
4	Load Demand Shutdown

Table 7-4

Digital	Load Govern State kW
0	NA
1	Ramp Load
2	Track Target Load
3	Ramp Unload
4	Ramp Unload Done

Table 7-5

Digital	Load Govern State kVAR
0	NA
1	Ramp Load
2	Track Target Load
3	Ramp Unload
4	Ramp Unload Done

Table 7-6

Digital	Fault Type
0	Normal
1	Warning
2	Derate
3	Shutdown with Cooldown
4	Shutdown

Table 7-7

Digital	Control Switch
0	Off
1	Manual
2	Automatic

Generator Raw Data Gen 6-8

Generator Raw Data	Gen 6	Gen 7	Gen 8	Multiplier	Units
Device Type	40312	40367	40422		
Control Switch (See Table 7-7 page 338)	40313	40368	40423		
State (See Table 7-1 page 338)	40314	40369	40424		
Fault Code	40315	40370	40425		
Fault Type (See Table 7-6 page 338)	40316	40371	40426		
Percent kW Standby	40317	40372	40427	0.5	%
Total kW	40318	40373	40428		
NFPA 110 (See Section 4, Table 4-3 on page 323)	40319	40374	40429		
NFPA Extended (See Section 4, Table 4-4 on page 323)	40320	40375	40430		
Frequency	40321	40376	40431	0.1	Hz
Total pf	40322	40377	40432	0.00005	PF
Total KVA	40323	40378	40433		KVA
Total kW	40324	40379	40434		kW
Total KVAR	40325	40380	40435		kVAR
Volts ab	40326	40381	40436		Volts
Volts bc	40327	40382	40437		Volts
Volts ca	40328	40383	40438		Volts
Volts a	40329	40384	40439		Volts
Volts b	40330	40385	40440		Volts
Volts c	40331	40386	40441		Volts
Amps a	40332	40387	40442		Amps
Amps b	40333	40388	40443		Amps
Amps c	40334	40389	40444		Amps
Percent Amps a	40335	40390	40445	0.5	%
Percent Amps b	40336	40391	40446	0.5	%
Percent Amps c	40337	40392	40447	0.5	%
Battery Voltage	40338	40393	40448	0.1	Volts
Oil Pressure	40339	40394	40449	0.1	KPA
Oil Temp	40340	40395	40450	0.1	Deg K
Coolant Temp	40341	40396	40451	0.1	Deg K
Fuel Rate	40342	40397	40452	0.001	GPH
Engine RPM	40343	40398	40453		RPM
Engine Starts	40344	40399	40454		Starts
Engine Runtime High	40345	40400	40455		
Engine Runtime Low	40346	40401	40456	0.1	Sec
Total kWh High	40347	40402	40457		
Total kWh Low	40348	40403	40458		KWH
Total Fuel High	40349	40404	40459		
Total Fuel Low	40350	40405	40460	0.01	GAL
Bus Frequency	40351	40406	40461	0.1	Hz

Generator Raw Data	Gen 6	Gen 7	Gen 8	Multiplier	Units
Bus Volts ab	40352	40407	40462		Volts
Bus Volts bc	40353	40408	40463		Volts
Bus Volts ca	40354	40409	40464		Volts
Bus Volts a	40355	40410	40465		Volts
Bus Volts b	40356	40411	40466		Volts
Bus Volts c	40357	40412	40467		Volts
Customer Faults	40358	40413	40468		
Network Faults	40359	40414	40469		
Customer Faults	40360	40415	40470		
ES State (See Table 7-2 page 338)	40361	40416	40471		
Load Share State (See Table 7-3 page 338)	40362	40417	40472		
Load Govern State kW (See Table 7-4 page 338)	40363	40418	40473		
Load Govern State kVAR (See Table 7-5 page 338)	40364	40419	40474		

10. MCM3320 Modbus Register Map

Modbus Communications

This section defines the Modbus communications interface. Serial communications use an RTU (Remote Terminal Unit) two-wire RS485, master/slave multi-drop network configuration described in the Modbus Protocol Reference Guide. The controller is defined as a slave.

Reference Documents

1. Modicon “Modbus Protocol Reference Guide PI-MBUS-300 Rev. G” describes the serial transmission modes.
2. “Modbus Over Serial Line Specification and Implementation Guide v1.0” describes the lower levels of modbus protocol.
3. “Modbus Application Protocol Specification v1.1a” describes the application layer of the modbus protocol.

Serial Port Configuration

The port communications occur, by default, at a baud rate of 19200 using eight data bits, one stop-bit with even parity, and are configurable via MON and PCCnet logically.

Device Addresses

The PLC is the master device in the modbus network. The modbus node address is configurable and is set to node 1 by default.

Power-Up Time

The MCM3320 is capable of supporting communication transactions within 10 seconds following initial power-up.

Response Time

The controller responds within 100 ms of a request for information the master.

Data Formatting

The format for each register is defined in the modbus register table.

All data parameters are transmitted as registers. All registers are two 8 bit bytes in length (16 bits per register). If a register requires more than 16 bits, then, the subsequent registers are also used. Therefore, with a 32 bit register X and X+1, the X register contains the upper 16 bits of data and the X+1 register contains the lower 16 bits. A register with 1 bit of data uses the least significant bit of a 16 bit register.

For all discrete data referenced a by bit number, the least significant bit for the register is numbered as “0” and the most significant bit as “15”. For all fault status and event status, a “1” indicates the fault or event is active and a “0” indicates inactive.

Modbus Activity LED

The modbus activity LED is on when either the control is receiving a modbus packet or sending a modbus packet. It is also on when a protocol timer is in timer mode. This precedes a protocol switch on the SCI1 port. Otherwise, the LED is off.

Supported Functions

The controller is only capable of processing the following modbus data and control function queries from the master:

- Read holding registers (Function Code 03)
- Preset single register (Function Code 06)
- Diagnostics (Function Code 08)
- Preset multiple registers (Function Code 16)

The control responds to any query containing a function code, other than codes 03, 06, 08 and 16 #by sending an exception response with the exception code set to “01” (Illegal Function).

The control responds to any read of a single address that is not specified in this specification by sending an exception response with the exception code set to “02” (Illegal Address).

The control responds to any read of a block of 2 or more addresses containing an address that is not specified in this specification by returning data of 0xFF for that address.

The control responds to Preset Single Register and Preset

Multiple Register functions when the data is out of bounds by sending an exception response with the exception code set to "03" (Illegal Data Value).

Holding Register Function

The control provides the ability to read all read only and read/write registers in the Modbus Registers Table via the Holding Register function. From 1 to 40 contiguous registers can be read at a time. If an attempt is made to read a register that's not available, then an error is returned and none of the data will be returned.

Preset Single/Preset Multiple Registers Function

The control provides the ability to write to (preset) Read/Write registers in the modbus registers table via both the present single register (Function Code 06) and the preset multiple registers (Function Code 16). A write to a single register can be performed by the master using the modbus data and control function query preset single register (Function Code 06). For writes requiring writes to 1 to 40 contiguous registers, the master uses the modbus data and control function query called preset multiple registers (Function Code 16). If a write attempt is made and any of the data is invalid or if an attempt is made to write to a register that's not available, then an error is returned and none of the data will be written.

Diagnostic Counters

The following diagnostic counters is also available via the modbus diagnostic function (Function Code 08). The following parameters are updated and available via MON and modbus logical access. A single logical is also available to clear all counters.

- Bus Message Count – Total Modbus packets on bus
- CRC Errors Count – Total Modbus packets received with a bad CRC
- Exception Count – Total Modbus packets received where an exception was sent back
- No Response Count – Total Modbus packets received where no response sent back
- Slave Message Count – Total Modbus packets on bus addressed to this node

Register Maps

Addresses were assigned to maintain compatibility with the existing Modlon gateway where applicable. The following conventions are followed:

- 40xxx – Genset control registers
- 41xxx – Transfer switch control register
- 42xxx – Master control registers (MCM3320)
- 4x0xx – General data registers (volts, current, etc.) primarily for genset bus
- 4x1xx – General data registers (volts, current, etc.) primarily for utility bus
- 4x2xx – Configuration and status registers – Block 1
- 4x3xx – Settings – Block 1
- 4x4xx – Settings – Block 2
- 4x5xx – Bitmap
- 4x6xx – Switch I/O
- 4x7xx – Configuration and status registers – Block 2

Application Layer

The application layer processes the packet. Four functions are supported: Read Hold Registers, Set Single Register, Modbus Loopback, and Set Multiple Registers. If the request packet specifies an unsupported function, then an illegal function response is returned. See the "Modbus Application Protocol Specification" to see how the request and response packets are formatted and how each function processes the data.

Read Hold Registers

Given a starting address and the quantity of registers desired, this function gets the data, formats it if required, and writes it to the TX buffer. If any register in the range is not supported, then an error is returned.

Set Single Register

Given a register address and data, this function verifies that the data is within range; then if OK, writes the data.

Modbus Loopback

This function performs Modbus diagnostic functionality. Some of the functionality defined here is also

available via MON and PCCnet logicals. See the “Diagnostic Counters” section of this document for details. The Loopback function supports:

- 0x00 Return Query Data
- 0x01 Restart
- 0x04 Force Listen Only Mode
- 0x0A Clear Counter
- 0x0B Return Bus Message Count
- 0x0C Return Bus Communication Error Count (bad CRC)
- 0x0D Return Bus Exception Error Count
- 0x0E Return Slave Message Count

0x0F Return Slave No Response Count

Set Multiple Registers

Given a starting address, the quantity of registers, and two bytes of data for each register, this function verifies that all the data is within range; then if OK, writes all data. If any register in the range is not supported or any of the data is out of range then an error is returned and no data is written. A 32-bit parameter is written using “Write Multiple Register” (Command Code 16) only. Using “Write Single Register” (Command Code 06) returns an exception code 2 – Illegal Address. If both registers are not in the same block, the control sends an exception code 2–Illegal Address.

Modbus Register Table

Note: For bitmapped quantities, refer to table in section 8 on page 425. For 32 bit quantities, the register address listed (X) is the high 16 bit. The low 16 bits are at register X+1. If an address or bit is not listed in this table, it is not used.

Addr.	System Name	Access	Specifications	Description	Function	
42001	MB logical Read Address	Read / Write	Multiplier: 1.000000000000 Offset: 0 Size (bits):16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 0	Logical address to be read via modbus	Communications
42002	MB Logical Read Data	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Logical data to be read via modbus	Communications
42004	Save Adjustments	Read / Write	0: Do Nothing 1: Save Trims Default: Do Nothing		Use to save adjustments directly in non-volatile memory	Controller Information
42009	Device Type	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits):16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Hard coded device type id= 52 (0x0034)	Communications
42010	Software Version	Read Only	Multiplier: .000100000000 Offset: 0 Size (bits):16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Software version number	Controller Information
42011	Genset Run Sequence State	Read Only	0: Time Delay Start 1: Time Delay Stop 2: Stop 3: Run Default:		Indicates state of the generator set run sequence	PTC Operating Mode

Addr.	System Name	Access	Specifications	Description	Function	
42012	Current Fault Status	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits):16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	The most recently occurring fault which is still active	Fault and Event Information
42017	Genset Bus Status	Read Only	0: Unavailable 1: Dead 2: Live Default:		Energization status of generator Set bus	PTC Sensors
42018	Genset L1N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default	Generator set L1N voltage	Voltage
42019	Genset L2N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Generator set L2N voltage	Voltage
42020	Genset L3N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Generator set L3N voltage	Voltage
42021	Genset LN Average Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Generator set LN average voltage	Voltage
42022	Genset L1L2 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Generator set L1L2 voltage	Voltage
42023	Genset L2L3 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default	Generator set L2L3 voltage	Voltage
42024	Genset L3L1 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default	Generator set L3L1 voltage.	Voltage
42025	Genset LL Average Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default	Generator set LL Average voltage	Voltage

Addr.	System Name	Access	Specifications	Description	Function
42026	Genset L1 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default	Generator set L1 current Current
42027	Genset L2 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default	Generator set L2 current Current
42028	Genset L3 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default:	Generator set L3 current Current
42029	Genset Average Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default:	Generator set average current Current
42030	Genset L1 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Generator set L1 kW Power
42031	Genset L2 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Generator set L2 kW Power
42032	Genset L3 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Generator set L3 kW Power
42033	Genset Total kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Generator set total kW Power
42034	Genset L1 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Generator set L1 kVAR Power
42035	Genset L2 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Generator set L2 kVAR Power

Addr.	System Name	Access	Specifications	Description	Function	
42036	Genset L3 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Generator set L3 kVAR	Power
42037	Genset Total kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Generator set total kVAR	Power
42038	Genset Total Power Factor	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: NA Lower Limit: Upper Limit: Default:	Generator set L1 power factor	Power
42039	Genset L1 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Generator set L1 kVA	Power
42040	Genset L2 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Generator set L2 kVA	Power
42041	Genset L3 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Generator set L3 kVA	Power
42042	Genset Total kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Generator set total kVA	Power
42043	MB Genset Frequency	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: Hz Upper Limit: Hz Default:	Generator set line frequency scaled by 10 = 1Hz for modbus	Communica- tions
42044	Genset Total Negative kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Generator set total negative kWh accumulation	Energy
42046	Genset Total Positive kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Generator set total positive kWh accumulation	Energy

Addr.	System Name	Access	Specifications	Description	Function	
42048	Genset Total Net kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Generator set total net kWh accumulation	Energy
42050	Genset Total Negative kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Generator set total negative kVARh accumulation	Energy
40052	Genset Total Positive kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Generator set total positive kVARh accumulation	Energy
42054	Genset Total Net kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Generator set total net kVARh accumulation	Energy
42056	Genset Total kVAh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Generator set total kVAh accumulation	Energy
42058	Genset Available Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default:	Calculated amps which represent 100-% generator set bus current – used by bargraph	Current
42059	Genset L1 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: % Upper Limit: % Default:	Generator set L1 current as percent of generator Set total current capacity – used by bargraph	Current
42060	Genset L2 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Generator set L2 current as percent of generator Set total current capacity – used by bargraph	Current
42061	Genset L3 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Generator set L3 current as percent of generator Set total current capacity – used by bargraph	Current

Addr.	System Name	Access	Specifications	Description	Function	
42062	Genset Total kW Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: % Upper Limit: % Default:	Generator set kW as percent of total generator set capacity – used by bargraph	Power
42063	Genset Frequency Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Generator set frequency as percent of system frequency – used by bargraph	Frequency
42064	Genset L1L2 Voltage%	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Generator set L1L2 voltage%	Voltage
42065	Genset L2L3 Voltage%	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Generator set L2L3 voltage %	Voltage
42066	Genset L3L1 Voltage%	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Generator set L3L1 voltage%	Voltage
42070	Genset Total kW_32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Generator set total kW in 32 bit	Power
42072	Genset Total kVAR_32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Generator set total kVAR in 32 bit	Power
42074	Genset Total kVA_32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Generator set total kVA in 32 bit	Power
42117	Utility Bus Status	Read Only	0: Unavailable 1: Dead 2: Live Default:		Energization status of the utility bus	PTC Sensors
42118	Utility L1N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign:U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Utility L1N voltage	Voltage

Addr.	System Name	Access	Specifications	Description	Function	
42119	Utility L2N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Utility L2N voltage	Voltage
42120	Utility L3N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Utility L3N voltage	Voltage
42121	Utility LN Average Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Utility LN average voltage	Voltage
42122	Utility L1L2 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Utility L1L2 voltage	Voltage
42123	Utility L2L3 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Utility L2L3 voltage	Voltage
42124	Utility L3L1 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Utility L3L1 voltage	Voltage
42125	Utility LL Average Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Utility LL average voltage	Voltage
42126	Utility L1 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default:	Utility L1 current	Current
42127	Utility L2 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default:	Utility L2 current	Current
42128	Utility L3 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default:	Utility L3 current	Current

Addr.	System Name	Access	Specifications	Description	Function
42129	Utility Average Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default:	Utility average current Current
42130	Utility L1 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Utility L1 kW Power
42131	Utility L2 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Utility L2 kW Power
42132	Utility L3 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Utility L3 kW Power
42133	Utility Total kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Utility total kW Power
42134	Utility L1 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Utility L1 kVAR Power
42135	Utility L2 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Utility L2 kVAR Power
42136	Utility L3 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Utility L3 kVAR Power
42137	Utility Total kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Utility total kVAR Power
42138	Utility Total Power Factor	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: NA Lower Limit: Upper Limit: Default:	Utility L1 power factor Power

Addr.	System Name	Access	Specifications	Description	Function
42139	Utility L1 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Utility L1 kVA Power
42140	Utility L2 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Utility L2 kVA Power
42141	Utility L3 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Utility L3 kVA Power
42142	Utility Total kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Utility total kVA Power
42143	MB Utility Frequency	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: Hz Upper Limit: Hz Default:	Utility line frequency scaled by 10 = 1Hz for modbus Communications
42144	Utility Total Negative kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Utility total negative kWh accumulation Energy
42146	Utility Total Positive kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Utility total positive kWh accumulation Energy
42148	Utility Total Net kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Utility total net kWh accumulation Energy
42150	Utility Total Negative	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Utility total negative kVARh accumulation Energy
42152	Utility Total Positive kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Utility total positive kVARh accumulation Energy

Addr.	System Name	Access	Specifications	Description	Function	
42154	Utility Total Net kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Utility total net kVARh accumulation	Energy
42156	Utility Total kVAh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVAh Lower Limit: kVAh Upper Limit: kVAh Default:	Utility total kVARh accumulation	Energy
42158	System Total kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Sum of generator set bus and utility bus kW	Power
42159	System Total kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Sum of generator set bus and utility bus kVAR	Power
42160	System Total Power Factor	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: NA Lower Limit: Upper Limit: Default:	System total power factor (totalized value of utility bus plus generator set bus)	Power
42161	System Total kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Sum of generator set bus and utility bus kVA	Power
42162	Utility L1 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Utility L1 current as % of utility total current capacity – used by bargraph	Current
42163	Utility L2 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Utility L2 current as % of utility total current capacity – used by bargraph	Current
42164	Utility L3 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Utility L3 current as as % of utility total current capacity – used by bargraph	Current

Addr.	System Name	Access	Specifications	Description	Function	
42165	Utility Total kW Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: % Upper Limit: % Default:	Utility total kW as percent of total utility capacity – used by bargraph	Power
42166	Utility Frequency Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Utility frequency as percent of system frequency – used by bargraph	Frequency
42167	Utility L1L2 Voltage %	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Utility L1L2 voltage %	Voltage
42168	Utility L2L3 Voltage %	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Utility L2L3 voltage %	Voltage
42169	Utility L3L1 Voltage %	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Utility L3L1 voltage %	Voltage
42170	Utility Total kW _32 bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Utility total kW	Power
42172	Utility total kVAR_32 bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Utility total kVAR in 32 bit	Power
42174	Utility total kVA_32 bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Utility total kVA in 32 bit	Power
42176	System Total kW_32 bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Sum of generator bus and utility bus kW in 32 bit	Power
42178	System Total kVAR_32 bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Sum of generator bus and utility bus kVAR in 32 bit	Power

Addr.	System Name	Access	Specifications	Description	Function	
42180	System Total kVA_32 bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Sum of generator set and utility bus kVA in 32 bit	Power
42200	Total Number of Gensets	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Number of generator sets with non-zero rating entered	System Information
42201	Total System Capacity	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Sum of the generator set kW ratings	System Information
42202	Total Online Capacity	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Sum of the generator set kW ratings for generator sets which are Online	System Information
42203	Programmed Transition Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: seconds Upper Limit: seconds Default:	Countdown value of the programmed transition timer	PTC Timers
42204	Transfer Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: seconds Upper Limit: seconds Default:	Countdown value of the transfer timer	PTC Timers
42205	Retransfer Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: seconds Upper Limit: seconds Default:	Countdown value of the retransfer timer	PTC Timers
42206	Maximum Parallel Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: seconds Upper Limit: seconds Default:	Countdown value of the maximum parallel timer	PTC Timers
42207	kW Reference	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	kW Control reference value for utility paralleling	Master Load Control
42208	Utility Unloaded Status	Read Only	0: Not Available 1: Not Unloaded 2: Unloaded Default:		Indicates utility unloaded status	Master Load Control

Addr.	System Name	Access	Specifications	Description	Function	
42209	Genset Un-loaded Status	Read Only	0: Not Available 1: Not Unloaded 2: Unloaded Default:	Indicates generator set unloaded status	Master Load Control	
42210	System State	Read Only	0: Not Available 1: TD Start 2: TD Stop 3: TD Programmed Transition 4: TD Transfer 5: TD Retransfer 6: Synchronizing 7: Sync Check OK 8: Inhibit 9: Unassigned 10: Ramp Upload 11: Ramp Load 12: Manual 13: Utility Failure 14: Test 15: Standby 16: Factory Test 17: Extended Parallel Default: Not Available	Indicates what state the control is currently IN	System Information	
42211	PTC Operating Mode	Read Only	0: Manual 1: Normal 2: Normal Override 3: Test 4: Utility Fail 5: Extended Parallel Default:	Indicates the Current PTC Operating mode. Read/Write on comp mode.	PTC Operating Mode	
42212	Active Transition Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: seconds Upper Limit: seconds Default:	Countdown timer value of active timer	PTC Timers
42213	Hardware Version	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Indicates the hardware version of the board	Discrete Inputs
42214	Controller On Time	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: seconds Lower Limit: .000 sec. Upper Limit: 4294967295.000 sec Default: 0	Amount of time in seconds the controller has been powered	Controller Information

Addr.	System Name	Access	Specifications	Description	Function	
42216	Genset Availability Status	Read Only	0: Not Available 1: Available 2: Unknown Default:	Indicates availability of generator set for Loading, as determined by the generator set sensors	PTC Availability	
42217	Utility Availability Status	Read Only	0: Not Available 1: Available 2: Unknown Default:	Indicates availability of utility for loading as determined by the utility sensors	PTC Availability	
42218	Gen CB Position Status	Read Only	0: Open 1: Closed 2: Not Available Default:	Generator set breaker position	Breaker Control	
42219	Util CB Position Status	Read Only	0: Open 1: Closed 2: Not Available Default:	Utility breaker position	Breaker Control	
42220	kVAR Load Reference	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	kVAR control reference value for extended paralleling	Master Load Control
42221	kVAR Load Setpoint Engr Units Display Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Engineering units value for the kVAR load setpoint analog input	Analog Inputs
42222	kW Load Setpoint Engr Units Display Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: % Upper Limit: % Default:	Engineering units value for the kW load setpoint analog input	Analog Inputs
42223	Power Factor Setpoint	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: NA Lower Limit: Upper Limit: Default:	Power factor setpoint analog input value (uses kVAR load setpoint analog input)	Analog Inputs
42224	PTC State	Read Only	0: Not Enabled 1: No Source Connected 2: Utility Connected 3: Genset Connected 4: Paralleled Default:	Indicates the connected state of power transfer control. read / write in comp.	PTC State Machine	

Addr.	System Name	Access	Specifications	Description	Function	
42225	Sync Check Close Allowed	Read Only	0: Not Allowed 1: Allowed Default:	Indicates whether any sync check conditions have been met	Master Sync Control	
42226	Sync Phase Difference	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: degrees Lower Limit: degrees Upper Limit: degrees Default:	Utility to generator set L1 voltage phase angle	Phase
42227	Synchronizer Status	Read Only	0: Synchronizer Off 1: Synchronizer On Default:	Indicates state of the synchronizer	Master Sync Control	
42228	System Lock-out Status	Read Only	0: Inactive 1: Active Default:	Faults have occurred which prevent normal system operation; reset faults	System Information	
42229	Breaker 1 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates the position status of breaker 1	Load Add Shed Control	
42230	Breaker 2 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates the position status of breaker 2	Load Add Shed Control	
42231	Breaker 3 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates the position status of breaker 3	Load Add Shed Control	
42232	Breaker 4 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates the position status of breaker 4	Load Add Shed Control	
42233	Breaker 5 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates the position status of breaker 5	Load Add Shed Control	
42234	Breaker 6 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates the position status of breaker 6	Load Add Shed Control	
42235	Breaker 1 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 1	Load Add Shed Control	
42236	Breaker 2 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 2	Load Add Shed Control	

Addr.	System Name	Access	Specifications	Description	Function
42237	Breaker 3 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 3	Load Add Shed Control
42238	Breaker 4 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 4	Load Add Shed Control
42239	Breaker 5 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 5	Load Add Shed Control
42240	Breaker 6 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 6	Load Add Shed Control
42241	ATS 1 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 1	Load Add Shed Control
42242	ATS 2 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 2	Load Add Shed Control
42243	ATS 3 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 3	Load Add Shed Control
42244	ATS 4 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 4	Load Add Shed Control
42245	ATS 5 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 5	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function	
42246	Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 6	Load Add Shed Control	
42247	SID1 Status	Read Only	0: Missing 1: Good 2: Connecting 3: No EXP Board 4: Not Applicable Default:	Indicates status of SID1 (AUX 101 / 102 module 1)	Communications	
42248	SID0 Status	Read Only	0: Missing 1: Good 2: Connecting 3: No EXP Board 4: Not Applicable Default:	Indicates status of SID0 (AUX 101 / 102 module 0)	Communications	
42249	Expansion Board Communications	Read Only	0: Disable 1: Enable Default: Disable	Indicates the status of SID0 to expansion board connection	Communications	
42250	Current Add Level	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Indicates the next level to add	Load Add Shed Control
42251	Current Shed Level	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Indicates the next level to shed	Load Add Shed Control
42252	Add Level 1 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 1	Load Add Shed Control	
42253	Add Level 2 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 2	Load Add Shed Control	
42254	Add Level 3 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 3	Load Add Shed Control	
42255	Add Level 4 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 4	Load Add Shed Control	
42256	Add Level 5 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 5	Load Add Shed Control	

Addr.	System Name	Access	Specifications	Description	Function
42257	Add Level 6 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 6	Load Add Shed Control
42258	Shed Level 1 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of shed level 1	Load Add Shed Control
42259	Shed Level 2 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of shed level 2	Load Add Shed Control
42260	Shed Level 3 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of shed level 3	Load Add Shed Control
42261	Shed Level 4 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of shed level 4	Load Add Shed Control
42262	Shed Level 5 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of shed level 5	Load Add Shed Control
42263	Manual Add Level 1 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add level 1	Load Add Shed Control
42264	Manual Add Level 2 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add level 2	Load Add Shed Control
42265	Manual Add Level 3 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add level 3	Load Add Shed Control
42266	Manual Add Level 4 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add level 4	Load Add Shed Control
42267	Manual Add Level 5 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add level 5	Load Add Shed Control
42268	Manual Add Level 6 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add level 6	Load Add Shed Control
42269	Manual Shed Level 1 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to shed loads assigned to level 1	Load Add Shed Control
42270	Manual Shed Level 2 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to shed loads assigned to level 2	Load Add Shed Control
42271	Manual Shed Level 3 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to shed loads assigned to level 3	Load Add Shed Control
42272	Manual Shed Level 4 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to shed loads assigned to level 4	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42273	Manual Shed Level 5 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator Input to Shed Loads Assigned to Level 5	Load Add Shed Control
42274	Restored Shed Level 1 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates if shed level 1 has been restored	Load Add Shed Control
42275	Restored Shed Level 2 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates if shed level 2 has been restored	Load Add Shed Control
42276	Restored Shed Level 3 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates if shed level 3 has been restored	Load Add Shed Control
42277	Restored Shed Level 4 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates if shed level 4 has been restored	Load Add Shed Control
42278	Restored Shed Level 5 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates if shed level 5 has been restored	Load Add Shed Control
42279	Add Load 1 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 1	Load Add Shed Control
42280	Add Load 2 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 2	Load Add Shed Control
42281	Add Load 3 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 3	Load Add Shed Control
42282	Add Load 4 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 4.	Load Add Shed Control
42283	Add Load 5 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 5	Load Add Shed Control
42284	Add Load 6 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 6	Load Add Shed Control
42285	Shed Load 1 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates shed command for load 1	Load Add Shed Control
42286	Shed Load 2 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates shed command for load 2	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function	
42287	Shed Load 3 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates shed command for load 3	Load Add Shed Control	
42288	Shed Load 4 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates Shed Command for Load 4	Load Add Shed Control	
42289	Shed Load 5 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates shed command for load 5	Load Add Shed Control	
42290	Shed Load 6 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates shed command for load 6	Load Add Shed Control	
42291	Battery Voltage Engr Units Display Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: VDC Upper Limit: VDC Default	Engineering units value for the battery voltage analog input	Analog Inputs
42292	kVAR Master Load Control Output Predictor Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: VDC Lower Limit: VDC Upper Limit: VDC Default	Voltage level commanded to kVAR master load control analog output	Analog Inputs
42293	kW Master Load Control Output Predictor Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: VDC Lower Limit: VDC Upper Limit: VDC Default	Voltage level commanded to kW master load control analog output	Analog Inputs
42294	Master Frequency Bias Output Predictor Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: VDC Lower Limit: VDC Upper Limit: VDC Default	Voltage level commanded to master frequency bias analog output	Analog Inputs
42295	Master Voltage Bias Output Predictor Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: VDC Lower Limit: VDC Upper Limit: VDC Default	Voltage level commanded to master voltage bias analog output	Analog Inputs
42296	PTC Genset Operating Mode	Read Only	0: Manual 1: Normal 2: Normal Override 3: Test 4: Utility Fail 5: Extended Parallel Default	Indicates the current operating mode of the generator set	PTC Genset Operating Mode	

Addr.	System Name	Access	Specifications	Description	Function	
42297	PTC Transfer Pair Operating Mode	Read Only	0: Manual 1: Normal 2: Normal Override 3: Test 4: Utility Fail 5: Extended Parallel Default:	Indicates the current operating mode of the transfer pair	PTC Genset Operating Mode	
42298	PTC Operating Transition Type	Read Only	0: Open Transition 1: Hard Closed Transition 2: Soft Closed Transition Default:	Indicates the transition type currently applicable to the PTC function operation	PTC Genset Operating Mode	
42299	Expansion Board Communications 1	Read Only	0: Disabled 1: Enabled Default: Disabled	Indicates the status of the SID1 to expansion board connection	Communications	
42300	System Topology	Read/Write	0: Master Synchronize Only 1: Isolated Bus w/ out GM 2: Isolated Bus w/GM 3: Common Bus 4: Transfer Pair 5: Component Mode Default: Master Synchronize Only	Main setting: sets system topology; control must be in manual to set	Application Configuration	
42301	Transition Type	Read/Write	0: Open Transition 1: Hard Closed Transition 2: Soft Closed Transition Default: Open Transition	Sets the type of transition that will be used	Application Configuration	
42302	Extended Parallel Enable	Read/Write	0: Disabled 1: Enabled Default: Disabled	Use to enable extended parallel operation	Application Configuration	
42303	Load Demand Type	Read/Write	0: None 1: Fixed Sequence 2: Run Hours Default: None	Sets the load demand type	Load Demand Control	
42304	Priority Control Method	Read/Write	0: Manual 1: Automatic Default: Manual	Set the priority control method	Priority Control	
42305	Genset 01 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 1000	Sets generator 1 kW rating	System Information
42306	Genset 02 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 2 kW rating	System Information

Addr.	System Name	Access	Specifications	Description	Function	
42307	Genset 03 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 3 kW rating	System Information
42308	Genset 04 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 4 kW rating	PC 3.x
42309	Genset 05 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 5 kW rating	System Information
42310	Genset 06 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 6 kW rating	System Information
42311	Genset 07 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 7 kW rating	System Information
42312	Genset 08 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 8 kW rating	System Information
42313	Genset 09 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 9 kW rating	System Information
42314	Genset 10 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 10 kW rating	System Information
42315	Genset 11 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 11 kW rating	System Information

Addr.	System Name	Access	Specifications	Description	Function	
42316	Genset 12 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 12 kW rating	System Infor- mation
42317	Programmed Transition Delay (TDPT)	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Seconds Lower Limit: .000 Seconds Upper Limit: 60.000 Seconds Default: 3	Set the pro- grammed transi- tion time delay	PTC Timers
42318	Transfer Delay (TDNE)	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Seconds Lower Limit: .000 Seconds Upper Limit: 120.000 Seconds Default: 10	Sets the transfer time delay	PTC Timers
42319	Retransfer Delay (TDEN)	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Seconds Lower Limit: .000 Seconds Upper Limit: 1800.000 Seconds Default: 600	Sets the transfer time delay	PTC Timers
42320	Maximum Parallel Time (TDMP)	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Seconds Lower Limit: .000 Seconds Upper Limit: 1800.000 Seconds Default: 20	Sets the maxi- mum parallel time for soft load transfers	PTC Timers
42321	Genset Bus %kW Setpoint	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: -5.000% Upper Limit: 105.000% Default: 80	Generator set nominal voltage	Master Load Control
42322	Genset Nominal Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: 100.000 Volts Upper Limit: 45000.000 Volts Default: 480	Generator set nominal voltage	AC Setup
42323	Utility Nominal Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: 100.000 Volts Upper Limit: 45000.000 Volts Default: 480	Utility nominal voltage	AC Setup

Addr.	System Name	Access	Specifications	Description	Function	
42324	Genset Center Frequency	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: 45.000 Hz Upper Limit: 65.000 Hz Default: 60	Sets the center frequency sensor bandwidth settings	PTC Sensors
42325	Utility Center Frequency	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: 45.000 Hz Upper Limit: 65.000 Hz Default: 60	Sets the center frequency sensor bandwidth settings	PTC Sensors
42326	test With Load Enable	Read/Write	0: Disable 1: Enable Default: Disable		Use to enable or disable load transfer during a Test	Application Configuration
42327	System Frequency	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: 45.000 Hz Upper Limit: 65.000 Hz Default: 60	Use to define the system nominal frequency	System Information
42328	Genset Bus kW Setpoint Source	Read/Write	0: Internal 1: Analog Input Default Internal		Selects where the generator set kW setpoint will come from for extended paralleling	Master Load Control
42329	Genset Bus kVAR Setpoint Source	Read/Write	0: Internal 1: Analog Input Default Internal		Selects where the generator set kVAR setpoint will come from for extended paralleling	Master Load Control
42330	Genset Bus kW Setpoint	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32767.000 kW Default: 0	Set the base load kW setpoint in closed loop extended paralleling	Master Load Control
42331	Genset Bus kVAR Setpoint	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: .000 kVAR Upper Limit: 32767.000 kVAR Default: 0	Sets the base load kVAR setpoint in closed loop extended paralleling	Master Load Control

Addr.	System Name	Access	Specifications	Description	Function	
42332	Genset Bus % kVAR Setpoint	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: -5.000% Upper Limit: 105.000% Default: 0	Sets % kVAR generator output level for open loop base load extended paralleling	Master Load Control
42333	Genset Bus Power Factor Setpoint	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: NA Lower Limit: .700 Upper Limit: 1.000 Default: 1.00	Sets the desired generator set bus power factor in closed loop extended paralleling	Master Load Control
42334	Genset Un-loaded Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000kW Upper Limit: 32767.000 kW Default: 50	Setpoint for generator set unloaded level	Master Load Control
42335	Utility Bus kW Setpoint Source	Read/Write	0: Internal 1: Analog Input Default: Internal	Selects where the utility kW setpoint will come from for extended paralleling	Master Load Control	
42336	Utility Bus kVAR Setpoint Source	Read/Write	0: Internal 1: Analog Input Default: Internal	Selects where the utility kVAR setpoint will come from for extended paralleling	Master Load Control	
42337	Utility Bus kW Setpoint	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000kW Upper Limit: 32767.000 kW Default: 100	Sets the peak Shave kW setpoint in closed loop extended paralleling	Master Load Control
42338	Utility Bus kW Constraint Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000kW Upper Limit: 32767.000 kW Default: 100	Sets the utility kW constraint level for base load extended paralleling	Master Load Control
42339	Utility Bus kVAR Setpoint	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000 kVAR Upper Limit: 32767.000 kVAR Default: 100	Sets the peak shave kVAR setpoint in closed loop extended paralleling	Master Load Control

Addr.	System Name	Access	Specifications		Description	Function
42340	Utility Bus Power Factor Setpoint	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: NA Lower Limit: .700 Upper Limit: 1.000 Default: 1.00	Sets the desired utility bus power factor in loop extended paralleling	Master Load Control
42341	Utility Unloaded Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000kW Upper Limit: 32767.000 kW Default: 50	Setpoint for utility unloaded level	Master Load Control
42342	Clear Fault History Table	Read/Write	0: Inactive 1: Active Default: Inactive		Use to completely clear the fault history table	Fault and Event Info
42343	Clear Occurrence Tables	Read/Write	0: Inactive 1: Active Default: Inactive		Use to completely clear the counters in faults and events occurrence tables	Fault and Event Info
42344	Genset Reset All Energy Meters	Read/Write	0: Do Nothing 1: Clear Counters Default: Do Nothing		Use to permanently clear all generator set energy meter values	Energy
42345	Utility Reset All Energy Meters	Read/Write	0: Do Nothing 1: Clear Counters Default: Do Nothing		Use to permanently clear all utility energy meter values	Energy
42346	Extended Paralleling kW Load Control Type	Read/Write	0: Genset Bus % Level (Open Loop) 1: Genset Bus kW (Closed Loop) 2: Genset Bus kW w/ Utility Constraint (Closed Loop) 3: Utility Bus kW (Closed Loop) Default: Genset Bus % Level (Open Loop)		Sets how and where the kW will be controlled for extended parallel operation	Master Load Control
42347	Extended Paralleling kVAR Load Control Type	Read/Write	0: Genset Controllers 1: Genset Bus % Level (Open Loop) 2: Genset Bus Power Factor (Open Loop) 3: Genset Bus kVAR (Closed Loop) 4: Genset Bus Power Factor (Closed Loop) 5: Utility Bus kVAR (Closed Loop) 6: Utility Bus Power Factor (Closed Loop) Default: Genset Controllers		Sets how and where the kVAR will be controlled for extended parallel operation	Master Load Control
42348	Extended Parallel Ramp Load Time	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 10.000 seconds Upper Limit: 900.000 seconds Default:60	Set ramp load time for extended paralleling	Master Load Control

Addr.	System Name	Access	Specifications	Description	Function	
42349	Fail To Sync Lockout Enable	Read/Write	0:Disabled 1:Enabled Default:Disable	Enable if want synchronizing to stop if fail to sync occurs	Master Sync Control	
42350	Fail To Sync Open Transition Retransfer Enable	Read/Write	0:Disabled 1:Enabled Default:Disable	Use to enable or disable an open transition retransfer upon fail to sync	PTC State Machine	
42351	Fail To Synchronize Time	Read/Write	Multiplier: .200000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 10.000 seconds Upper Limit: 900.000 seconds Default:120	Set the fill to synchronize diagnostic time delay	Master Sync Control
42352	Gen CB Manual Control	Read/Write	0: Closed Requested 1: No Command 2: Open Commanded Default: No Command	In manual mode can be used to semi-manually control the generator set breaker	Breaker Control	
42353	Util CB Manual Control	Read/Write	0: Closed Requested 1: No Command 2: Open Commanded Default: No Command	In Manual Mode can be used to Semi-Manually Control the Utility Breaker	Breaker Control	
42354	Slip Frequency	Read/Write	Multiplier: .001000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: seconds Lower Limit: -3.000 Hz Upper Limit: 3.000 Hz Default:0.1	Sets the Synchronizer Slip Frequency (used when Sync Method is Slip)	Master Sync Control
42355	Start Time Delay (TDES)	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: .000 seconds Upper Limit: 3600.000 seconds Default: 0	Sets the generator set Start Time Delay	PTC Operating Mode
42356	Stop Time Delay (TDEC)	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: .000 seconds Upper Limit: 3600.000 seconds Default: 0	Sets the generator set Stop Time Delay	PTC Operating Mode
42357	Synchronizer Polarity	Read/Write	0: Normal 1: Invert Default: Normal	Use to Invert Synchronizer Polarity	Master Sync Control	

Addr.	System Name	Access	Specifications	Description	Function	
42358	Synchronize Method	Read/Write	0: Phase Match 1: Slip Frequency Default: Phase Match	Sets the synchronizing method	Master Sync Control	
42359	Port Protocol Selection	Read/Write	0: PCCNet 1: MON Default: PCCNet	Allows protocol of the PCCNet port to be changed to MON for troubleshooting	Communications	
42360	System Scheduler Enable	Read/Write	0: Disabled 1: Enabled Default: Disabled	Use to enable or disable the system scheduler	System Scheduler	
42361	Load Add Shed Enable	Read/Write	0: Disabled 1: Enabled Default: Disabled	Use the enable or disable the load add shed feature	Load Add Shed Control	
42362	Open Transition Retransfer Load Shed Enable	Read/Write	0: Disabled 1: Enabled Default: Disabled	Use to enable or disable the shedding of loads during open transition retransfer	Load Add Shed Control	
42363	Auto/Manual Load Add Restore Mode	Read/Write	0: Auto 1: Manual Default: Auto	Indicates automatic or manual load add restore operation	Load Add Shed Control	
42364	Genset Bus Load Add Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: second Lower Limit: .000 second Upper Limit: 60.000 second Default: 1	Indicates delay between add levels when all generator sets are online and no utility	Load Add Shed Control
42365	Utility Bus Load Add Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: second Lower Limit: .000 second Upper Limit: 60.000 second Default: 1	Indicates delay between add levels when on utility	Load Add Shed Control
42366	Load Shed Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 1.000 seconds Upper Limit: 10.000 seconds Default: 1	Indicates delay between shed levels when on generator sets	Load Add Shed Control
42367	Load 1 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 1 add shed control and status I/O	Load Add Shed Control	

Addr.	System Name	Access	Specifications	Description	Function	
42368	Load 2 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 2 add shed control and status I/O	Load Add Shed Control	
42369	Load 3 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 3 add shed control and status I/O	Load Add Shed Control	
42370	Load 4 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 4 add shed control and status I/O	Load Add Shed Control	
42371	Load 5 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 5 add shed control and status I/O	Load Add Shed Control	
42372	Load 6 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 6 add shed control and status I/O	Load Add Shed Control	
42373	Load 1 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 1	Indicates which add level load 1 is assigned to	Load Add Shed Control
42374	Load 2 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 2	Indicates which add level load 2 is assigned to	Load Add Shed Control
42375	Load 3 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 3	Indicates which add level load 3 is assigned to	Load Add Shed Control
42376	Load 4 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 4	Indicates which add level load 4 is assigned to	Load Add Shed Control
42377	Load 5 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 5	Indicates which add level load 5 is assigned to	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function	
42378	Load 6 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 6	Indicates which add level load 6 is assigned to	Load Add Shed Control
42379	Load 1 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 17.000 Default: 1	Indicates which shed level load 1 is assigned to	Load Add Shed Control
42380	Load 2 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 17.000 Default: 2	Indicates which shed level load 2 is assigned to	Load Add Shed Control
42381	Load 3 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 17.000 Default: 3	Indicates which shed level load 3 is assigned to	Load Add Shed Control
42382	Load 4 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 17.000 Default: 4	Indicates which shed level load 4 is assigned to	Load Add Shed Control
42383	Load 5 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 17.000 Default: 5	Indicates which shed level load 5 is assigned to	Load Add Shed Control
42384	Load 6 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 17.000 Default: 6	Indicates which shed level load 6 is assigned to	Load Add Shed Control
42385	Genset Bus Overload Method	Read/Write	0: Both kW and Frequency 1: kW Only 2: Frequency Only Default: Both kW and Frequency		Use to choose method for determining generator bus overload condition	System Information
42386	Genset Bus kW Overload Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: 80.000% Upper Limit: 140.000% Default: 105	Use to set the % kW threshold for generator bus overload condition	System Information

Addr.	System Name	Access	Specifications	Description	Function	
42387	Genset Bus kW Overload Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: second Lower Limit: .000 second Upper Limit: 120.000 second Default: 60	Sets the delay time for overload based on kW	System Information
42388	Genset Bus Underfrequency Overload Threshold	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: .1000 Hz Upper Limit: 10.000 Hz Default: 3	Use to set the underfrequency offset threshold for generator bus overload condition	System Information
42389	Genset Bus Underfrequency Overload Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: second Lower Limit: .000 second Upper Limit: 20.000 second Default: 3	Sets the delay time for overload based on frequency	System Information
42390	Load Demand Enable	Read/Write	0: Disable 1: Enable Default: Disable	Use enable or disable the load demand feature	Load Demand Control	
42391	Load Demand GenA	Read/Write	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default: Gen1	Sets GenA (never stop) for fixed sequence load demand	Load Demand Control	

Addr.	System Name	Access	Specifications	Description	Function
42392	Load Demand GenB	Read/Write	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default: Gen2	Sets GenB (never stop) for fixed sequence load demand	Load Demand Control
42393	Load Demand GenC	Read/Write	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default: Gen3	Sets GenC (never stop) for fixed sequence load demand	Load Demand Control
42394	Load Demand GenD	Read/Write	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default: Gen4	Sets GenD (never stop) for fixed sequence load demand	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function	
42395	Load Demand Initial Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: minute Lower Limit: 1.000 minute Upper Limit: 60.000 minute Default: 5	Sets the Initial delay time before load demand will operate	Load Demand Control
42396	Load Demand Restart Percent	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: 20.000% Upper Limit: 100.000% Default: 80	Sets load demand restart threshold when method is %kW	Load Demand Control
42397	Load Demand Run Hours Differential	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hours Lower Limit: 1.000 Hours Upper Limit: 500.000 Hours Default: 50	Sets run hours differential for restart a generator set stopped due to load demand	Load Demand Control
42398	Load Demand Shutdown Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: minute Lower Limit: 1.000 minute Upper Limit: 60.000 minute Default: 5	Sets the delay time between stopping generator sets due to load demand	Load Demand Control
42399	Load Demand Shutdown Percent	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: 20.000 % Upper Limit: 100.000 % Default: 60	Sets load demand shutdown threshold when method is %kW	Load Demand Control
42400	General Fail Time Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 10.000 seconds Upper Limit: 900.000 second Default: 59	Sets how long to wait for a generator set to come online before declaring it failed	Load Demand Control
42401	Util CB Fail to Close Delay	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: .100 seconds Upper Limit: 1.000 seconds Default: 0.26	Sets the utility breaker fail to close time delay	Breaker Control
42402	Util CB Fail to Open Delay	Read/Write	Multiplier: .200000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: .200 seconds Upper Limit: 5.000 seconds Default: 1	Sets the utility breaker fail to open time delay	Breaker Control

Addr.	System Name	Access	Specifications	Description	Function	
42403	Util CB Re-charge Delay	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: .000 seconds Upper Limit: 60.000 seconds Default: 10	Sets time to allow for utility breaker recharge	Breaker Control
42404	Gen CB Fail to Close Delay	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: seconds Lower Limit: .100 seconds Upper Limit: 1.000 seconds Default: 0.26	Sets the generator Set breaker fail to close time delay	Breaker Control
42405	Gen CB Fail to Open Delay	Read/Write	Multiplier: .200000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: .200 seconds Upper Limit: 5.000 seconds Default: 1	Sets generator set breaker fail to open time delay	Breaker Control
42406	Gen CB Re-charge Delay	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: .000 seconds Upper Limit: 60.000 second Default: 10	Sets the time to allow for generator set breaker recharge	Breaker Control
42407	Permissive Phase Window	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: degrees Lower Limit: .100 degrees Upper Limit: 20.000 degrees Default: 10	Sets the permissive +/- phase angle window for sync check function	Master Sync Control
42408	Permissive Voltage Window	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: .500 % Upper Limit: 10.000 % Default: 5	Sets the permissive +/- voltage acceptance window for sync check function	Master Sync Control
42409	Permissive Window Time	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: .500 seconds Upper Limit: 5.000 seconds Default: 0.5	Sets the permissive acceptance window dwell time for sync check function	Master Sync Control
42410	Permissive Frequency Window	Read/Write	Multiplier: .001000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: Hz Lower Limit: .001 Hz Upper Limit: 1.000 Hz Default: 1	Sets maximum frequency difference allowed for permissive close	Master Sync Control

Addr.	System Name	Access	Specifications	Description	Function	
42412	Sync Phase Offset	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: degrees Lower Limit: -50.000 degrees Upper Limit: 50.000 degrees Default: 0	Sets a sync phase offset to accommodate sync across transformer with phase shift	Master Sync Control
42413	System Phase Rotation	Read/Write	0: L1-L2-L3 1: L1-L3-L2 Default: L1-L2-L3	Defines what the system phase rotation sequence is	System Information	
42414	kW Kp	Read/Write	Multiplier: 1.0000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 1000.000 Default: 60	Proportional gain for kW closed loop control in extended paralleling	Master Load Control
42415	kW KI	Read/Write	Multiplier: 1.0000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 255.000 Default: 60	Integral gain for kW closed loop control in extended paralleling	Master Load Control
42416	kVAR Kp	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 1000.000 Default: 120	Proportional gain for kVAR closed loop control in extended paralleling	Master Load Control
42417	kVAR K1	Read/Write	Multiplier: 1.0000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 255.000 Default: 50	Integral gain for kVAR closed loop control in extended paralleling	Master Load Control
42418	Scheduler Program Select	Read/Write	Multiplier: 1.0000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 12.000 Default: 1	Selects which scheduler program to view or edit	System Scheduler
42419	Scheduler Program Enable	Read/Write	0: Disable 1: Enable Default: Disable	Use to enable or disable the selected program	System Scheduler	
42420	Scheduler Program x Repeats Interval	Read/Write	0: Once 1: Every Week 2: Every 2 Weeks 3: Every 3 Weeks 4: Every 4 Weeks 5: Every 5 Weeks 6: First Week of the Month 7: Second Week of the Month 8: Third Week of the Month 9: Forth Week of the Month 10: Last Week of the Month Default: Once	use to adjust repeat interval for the selected program	System Scheduler	

Addr.	System Name	Access	Specifications	Description	Function	
42421	Scheduler Program x Run Mode	Read/Write	0: No Load 1: With Load 2: Extended Parallel Default: No Load	Use to adjust run mode for the selected program	System Scheduler	
42422	Scheduler Program x Start Day	Read/Write	0: Sunday 1: Monday 2: Tuesday 3: Wednesday 4: Thursday 5: Friday 6: Saturday Default: Sunday	Use to adjust start day of week for the selected program	System Scheduler	
42423	Scheduler Program x Start Hour	Read/Write	Multiplier: 1.0000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: hour Lower Limit: .000 hour Upper Limit: 23.000 hour Default: 0	Use to adjust start hour for the selected program	System Scheduler
42424	Scheduler Program x Start Minute	Read/Write	Multiplier: 1.0000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: minute Lower Limit: .000 minute Upper Limit: 59.000 minute Default: 0	Use to adjust start minute for the selected program	System Scheduler
42425	Scheduler Program x Duration Hours	Read/Write	Multiplier: 1.0000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: hour Lower Limit: .000 hour Upper Limit: 23.000 hour Default: 0	Use to adjust duration hours for the selected program	System Scheduler
42426	Scheduler Program x Duration Minutes	Read/Write	Multiplier: 1.0000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: minute Lower Limit: .000 minute Upper Limit: 59.000 minute Default: 0	Use to adjust duration minute for the selected program	System Scheduler
42427	Scheduler Exception Select	Read/Write	Multiplier: 1.0000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 6.000 Default: 1	Selects which scheduler exception to view or edit	System Scheduler
42428	Scheduler Exception x Enable	Read/Write	0: Disable 1: Enable Default: Disable	Use to enable or disable the selected exception	System Scheduler	
42429	Scheduler Exception x Repeat	Read/Write	0: Once Only 1: Every Year Default: Only Once	Use to adjust the repeat setting of the selected exception	System Scheduler	

Addr.	System Name	Access	Specifications	Description	Function	
42430	Scheduler Exception x Month	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: month Lower Limit: 1.000 month Upper Limit: 12.000 month Default: 1	Use to adjust the month of the selected exception	System Scheduler
42431	Scheduler Exception x Date	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: date Lower Limit: 1.000 date Upper Limit: 31.000 date Default: 1	Use to adjust the start date of the selected exception	System Scheduler
42432	Scheduler Exception x Hour	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: hour Lower Limit: .000 hour Upper Limit: 23.000 hour Default: 0	Use to adjust the start hour of the selected exception	System Scheduler
42433	Scheduler Exception x Duration Minute	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: minute Lower Limit: .000 minute Upper Limit: 59.000 minute Default: 0	Use to adjust the start minute of the selected exception	System Scheduler
42434	Scheduler Exception x Duration Days	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: days Lower Limit: .000 days Upper Limit: 44.000 days Default: 0	Use to adjust the duration days of the selected exception	System Scheduler
42435	Scheduler Exception x Duration Hours	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: hour Lower Limit: .000 hour Upper Limit: 23.000 hour Default: 0	Use to adjust the duration hours of the selected exception	System Scheduler
42436	Scheduler Exception x Duration Minutes	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: minute Lower Limit: .000: minute Upper Limit: 59.000: minute Default: 0	Use to adjust the duration minutes of the selected exception	System Scheduler
42437	Daylight Saving Time Enable	Read/Write	0: Disable 1: Enable Default: Disable	Enables the daylight savings time feature	Real Time Clock	
42438	Load Demand Refresh Sequence Command	Read/Write	0: Do Nothing 1: Refresh Sequence Default: Do Nothing	Use to force a refresh of the active load demand sequence	Load Demand Control	

Addr.	System Name	Access	Specifications	Description	Function	
42439	Genset Connection Type	Read/Write	0: Wye 1: Delta Default: Wye	Delta or wye for generator set connection	AC Setup	
42440	Genset PT Primary Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: Volts Lower Limit: 100.000 Volts Upper Limit: 45000.000 Volts Default: 480	Generator set PT primary voltage	AC Setup
42441	Genset PT Secondary Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: Volts Lower Limit: 100.000 Volts Upper Limit: 500.000 Volts Default: 120	Generator set PT secondary voltage	AC Setup
42442	Genset CT Primary Current	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: Amps Lower Limit: 5.000 Amps Upper Limit: 25000.000 Volts Default: 100	Generator set CT primary current	AC Setup
42443	Genset CT Secondary Current	Read/Write	0: 1 Amp 1: 5 Amp Default: 5 Amp	Generator set CT secondary current	AC Setup	
42444	Utility Connection Type	Read/Write	0: Wye 1: Delta Default: Wye	Delta or wye for utility connection	AC Setup	
42445	Utility PT Primary Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: Volts Lower Limit: 100.000 Volts Upper Limit: 45000.000 Volts Default: 480	Utility PT primary voltage	AC Setup
42446	Utility PT Secondary Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: Volts Lower Limit: 100.000 Volts Upper Limit: 500.000 Volts Default: 120	Utility PT secondary voltage	AC Setup
42447	Utility CT Primary Current	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: Amps Lower Limit: 5.000 Amps Upper Limit: 25000.000 Amps Default: 100	Utility CT primary current	AC Setup
42448	Utility CT Secondary Current	Read/Write	0: 1 Amp 1: 5 Amp Default: 5 Amp	Utility CT secondary current	AC Setup	

Addr.	System Name	Access	Specifications	Description	Function	
42449	Load Add Shed Required Online Capacity	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32767.000 kW Default: 0	Generator set kW capacity that must be online to start timed load add : 0 disables this	Load Add Shed Control
42450	Load Demand Minimum On-line Capacity	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32767.000 kW Default: 0	Sets how much capacity must always be online regardless of what the load is	Load Demand Control
42451	Load Demand Restart Delay	Read/Write	Multiplier: .100000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: second Lower Limit: .000 second Upper Limit: 25.000 second Default: 1	Sets generator restart delay time to avoid nuisance restarts due to load transients	Load Demand Control
42452	Utility Available Current	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: Amps Lower Limit: 1.000 Amps Upper Limit: 32000.000 Amps Default: 1000	Use to set how many amps = 100% utility kW – used by bargraph	AC Setup
42453	Total Utility Capacity	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: S	Unit: kW Lower Limit: 1.000 kW Upper Limit: 32000.000 kW Default: 1000	Use to set hoe many kW = 100% utility kW – used by bargraph	AC Setup
42454	Nominal Battery Voltage	Read/Write	0: 12V 1: 24V Default: 24V	DC voltage provided to the control	Battery Voltage Protection	
42455	24V High Battery Voltage Threshold	Read/Write	Multiplier: .010000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: VDC Lower Limit: 28.000 VDC Upper Limit: 34.000 VDC Default: 32	Sets 24V high battery voltage fault threshold	Battery Voltage Protection
42456	24V Low Battery Voltage Threshold	Read/Write	Multiplier: .010000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: VDC Lower Limit: 22.000 VDC Upper Limit: 26.000 VDC Default: 24	Sets 24V low battery voltage fault threshold	Battery Voltage Protection
42457	12V High Battery Voltage Threshold	Read/Write	Multiplier: .0100000000 Offset: 0 Size(bits): 16 Sign: U	Unit: VDC Lower Limit: 14.000 VDC Upper Limit: 17.000 VDC Default: 16	Sets 12V high battery voltage fault threshold	Battery Voltage Protection

Addr.	System Name	Access	Specifications	Description	Function	
42458	12 V Low Battery Voltage Threshold	Read/Write	Multiplier: .010000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: VDC Lower Limit: 11.000 VDC Upper Limit: 13.000 VDC Default: 12	Sets 12V low battery voltage fault threshold	Battery Voltage Protection
42459	High Battery Voltage Set Time	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: second Lower Limit: 2.000 second Upper Limit: 60.000 second Default: 60	Sets high battery voltage set time	Battery Voltage Protection
42460	Low Battery Voltage Set Time	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: second Lower Limit: 2.000 second Upper Limit: 60.000 second Default: 60	Sets low battery voltage set time	Battery Voltage Protection
42461	Genset Online Capacity Sensor Enable	Read/Write	0: Disable 1: Enable Default: Disable		Used to enable or disable the generator set on-line capacity sensor	PTC Sensors
42462	Genset Online Capacity Sensor Threshold	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets the online kW threshold at which generator set bus is available for loading	PTC Sensors
42463	Nominal Battery Voltage Check Enable	Read/Write	0: Disable 1: Enable Default: Disable		Use to enable or disable the nominal battery voltage monitoring	Battery Voltage Protection
42464	Configurable Output1 Code	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 1483	Event or fault code tied to configurable output 1	Discrete Outputs
42465	Configurable Output2 Code	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 1457	Event or fault code tied to configurable output 2	Discrete Outputs
42466	Configurable Output3 Code	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 2965	Event or fault code tied to configurable output 3	Discrete Outputs

Addr.	System Name	Access	Specifications	Description	Function	
42467	Configurable Output4 Code	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 2328	Event or fault code tied to configurable output 4	Discrete Outputs
42468	Configurable Output5 Code	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 1121	Event or fault code tied to configurable output 5	Discrete Outputs
42469	Configurable Output6 Code	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 1916	Event or fault code tied to configurable output 6	Discrete Outputs
42470	Configurable Output7 Code	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 0	Event or fault code tied to configurable output 7	Discrete Outputs
42471	Configurable Output8 Code	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 343	Event or fault code tied to configurable output 8	Discrete Outputs
42472	Gen Bus Base Load Status	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates that the generator bus is on base load extended paralleling	System Information	
42473	Util Bus Peak Shave Status	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates that the utility bus is on peak shave extended paralleling	System Information	
42474	Load 7 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 7 add shed control and status I/O	Load Add Shed Control	
42475	Load 8 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 8 add shed control and status I/O	Load Add Shed Control	

Addr.	System Name	Access	Specifications	Description	Function	
42476	Load 9 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 9 add shed control and status I/O	Load Add Shed Control	
42477	Load 10 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 10 add shed control and status I/O	Load Add Shed Control	
42478	Load 7 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 7	Indicates which add level load 7 is assigned to	Load Add Shed Control
42479	Load 8 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 8	Indicates which add level load 8 is assigned to	Load Add Shed control
42480	Load 9 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 9	Indicates which add level load 9 is assigned to	Load Add Shed control
42481	Load 10 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 10	Indicates which add level load 10 is assigned to	Load Add Shed control
42482	Load 7 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 6	Indicates which shed level load 7 is assigned to	Load Add Shed control
42483	Load 8 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 7	Indicates which shed level load 8 is assigned to	Load Add Shed control
42484	Load 9 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 8	Indicates which shed level load 9 is assigned to	Load Add Shed control
42485	Load 10 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 9	Indicates which shed level load 10 is assigned to	Load Add Shed control

Addr.	System Name	Access	Specifications	Description	Function	
42486	Load Demand Threshold Method	Read/Write	0: %kW 1: kW Default: %kW	Selects whether to shutdown / restart generator sets based on %kW or absolute kW	Load Add Shed control	
42487	Load Demand Restart kW Threshold	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 500	Sets minimum kW reserve capacity when threshold method is absolute kW	Load Add Shed control
42488	Load Demand Shutdown kW Threshold	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 1000	Sets maximum kW reserve capacity when threshold method is absolute kW	Load Add Shed control
42489	Load Demand GenE	Read/Write	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default: Gen5	Sets GenE for fixed sequence load demand	Load Demand Control	
42490	Load Demand GenF	Read/Write	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default: Gen6	Sets GenF for fixed sequence load demand	Load Demand Control	

Addr.	System Name	Access	Specifications	Description	Function	
42491	Load Demand GenG	Read/Write	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default: Gen7	Sets GenG for fixed sequence load demand	Load Demand Control	
42492	Load Demand GenH	Read/Write	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default: Gen8	Sets GenH for fixed sequence load demand	Load Demand Control	
42494	Virtual Gen Main Fail to Open Delay	Read/Write	Multiplier: .200000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: second Lower Limit: 2.000 second Upper Limit: 30.000 second Default: 5	Sets how long to wait for generator set paralleling circuit breakers to open when no generator main	Breaker Control
42495	Genset 13 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 13 kW rating	System Information
42496	Genset 14kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 14 kW rating	System Information

Addr.	System Name	Access	Specifications	Description	Function	
42497	Genset 15kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 15 kW rating	System Information
42498	Genset 16kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 16 kW rating	System Information
42500	Fault Status BitMap 1	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: NA Lower Limit: Upper Limit: Default: 0	Bitmapped state of utility and other faults – 32 bits	Fault and Event Info
42502	Fault Status BitMap 2	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: NA Lower Limit: Upper Limit: Default: 0	Bitmapped state of generator set and other faults – 32 bits	Fault and Event Info
42504	Event Status BitMap 1	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: NA Lower Limit: Upper Limit: Default: 0	Bitmapped state of events – 32 bits	Fault and Event Info
42506	Genset Metering Fault Status	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default: 0	Bit mapped word with status of generator set AC metering out of range conditions	AC Interrupt Service
42507	Utility Metering Fault Status	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default: 0	Bit mapped word with status of utility AC metering out of range conditions	AC Interrupt Service
42600	Extended Parallel Start Vol	Read / Write	0: Stop 1: Start Default: Stop		State of extended parallel start volatile input	Discrete Inputs
42601	Synchronizer Enable Vol	Read / Write	0: Inactive 1: Active Default: Inactive		State of synchronizer enable volatile input	Discrete Inputs
42602	Utility Source Fail Vol	Read / Write	0: Inactive 1: Active Default: Inactive		State of utility source failure volatile input	Discrete Inputs
42603	Transfer Inhibit Vol	Read / Write	0: No Inhibit 1: Inhibit Default: No Inhibit		State of transfer inhibit volatile input	Discrete Inputs
42604	Retransfer Inhibit Vol	Read / Write	0: No Inhibit 1: Inhibit Default: No Inhibit		State of retransfer inhibit volatile input	Discrete Inputs

Addr.	System Name	Access	Specifications	Description	Function
42605	Gen CB Inhibit Vol	Read / Write	0: No Inhibit 1: Inhibit Default: No Inhibit	State of generator CB inhibit volatile input	Discrete Inputs
42606	Util CB Inhibit Vol	Read / Write	0: No Inhibit 1: Inhibit Default: No Inhibit	State of utility CB inhibit volatile input	Discrete Inputs
42607	Auto/Manual Vol	Read/ Write	0: Auto 1: Manual Default: Auto	State of auto/manual volatile input	Discrete Inputs
42608	Test Start Vol	Read/ Write	0: Stop 1: Start Default: Stop	state of test start volatile input	Discrete Inputs
42609	Fault Reset Vol	Read/ Write	0: No Reset 1: Reset Default: No Reset	state of fault reset volatile input	Discrete Inputs
42610	Override Vol	Read/ Write	0: No Override 1: Override Default: No Override	State of override volatile input	Discrete Inputs
42611	Extended Parallel Start Sw	Read Only	0: Stop 1: Start Default:	State of extended parallel start input	Discrete Inputs
42612	Synchronizer Enable Sw	Read Only	0: Inactive 1: Active Default:	State of synchronizer enable input	Discrete Inputs
42613	Utility Source Failure Sw	Read Only	0: Inactive 1: Active Default:	State of utility source failure input	Discrete Inputs
42614	Transfer Inhibit Sw	Read Only	0: No Inhibit 1: Inhibit Default:	Status of transfer inhibit input	Discrete Inputs
42615	Retransfer Inhibit Sw	Read Only	0: No Inhibit 1: Inhibit Default:	Status of retransfer inhibit input	Discrete Inputs
42616	Gen CB Inhibit Sw	Read Only	0: No Inhibit 1: Inhibit Default:	State of generator CB inhibit input	Discrete Inputs
42617	Unitl CB Inhibit Sw	Read Only	0: No Inhibit 1: Inhibit Default:	State of utility CB inhibit input	Discrete Inputs
42618	Auto/Manual Sw	Read Only	0: Auto 1: Manual Default:	State of auto / manual input	Discrete Inputs
42619	Test Start Sw	Read Only	0: Stop 1: Start Default:	State of test start input	Discrete Inputs
42620	Fault Reset Sw	Read Only	0: No Reset 1: Reset Default:	State of fault reset input	Discrete Inputs

Addr.	System Name	Access	Specifications	Description	Function
42621	Override Sw	Read Only	0: No Override 1: Override Default:	State of override input	Discrete Inputs
42622	Master Inhibit	Read Only	0: No Inhibit 1: Inhibit Default:	Indicates state of master priority inhibit	Priority Control
42623	Genset CB Tripped Sw	Read Only	0: Inactive 1: Active Default:	State of generator CB tripped input	Discrete Inputs
42624	Genset CB Tripped Vol	Read/Write	0: Inactive 1: Active Default: Inactive	State of generator CB tripped volatile input	Discrete Inputs
42625	Util CB Tripped Sw	Read Only	0: Inactive 1: Active Default:	State of Utility CB tripped input	Discrete Inputs
42626	Util CB Tripped Vol	Read/Write	0: Inactive 1: Active Default: Inactive	State of Utility CB tripped volatile input	Discrete Inputs
42627	Genset Phase Rotation	Read Only	0: L1-L2-L3 1: L1-L3-L2 Default:	Generator set phase rotation	Phase
42628	Utility Phase Rotation	Read Only	0: L1-L2-L3 1: L1-L3-L2 Default:	Utility phase rotation	Phase
42929	Gen1 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen1 CB position input	Discrete Inputs
42630	Gen1 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen1 CB volatile input	Discrete Inputs
42631	Gen2 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen2 CB position input	Discrete Inputs
42632	Gen2 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen2 CB volatile input	Discrete Inputs
42633	Gen3 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen3 CB position input	Discrete Inputs
42634	Gen3 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen3 CB volatile input	Discrete Inputs
42635	Gen4 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen4 CB position input	Discrete Inputs
42636	Gen4 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen4 CB volatile input	Discrete Inputs

Addr.	System Name	Access	Specifications	Description	Function
42637	Network Master Inhibit	Read/Write	0: No Inhibit 1: Inhibit Default: No Inhibit	Use to manually inhibit the module	Priority Control
42638	Gen5 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen5 CB position input	Discrete Inputs
42639	Gen5 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen5 CB position volatile input	Discrete Inputs
42640	Gen6 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen6 CB position input	Discrete Inputs
42641	Gen6 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen6 CB position volatile input	Discrete Inputs
42642	Gen7 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen7 CB position input	Discrete Inputs
42643	Gen7 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen7 CB position volatile input	Discrete Inputs
42644	Gen8 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen8 CB position input	Discrete Inputs
42645	Gen8 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen8 CB position volatile input	Discrete Inputs
42646	ATS 7 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 7	Load Add Shed Control
42647	ATS 8 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 8	Load Add Shed Control
42648	ATS 9 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 9	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42649	ATS 10 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 10	Load Add Shed Control
42650	Breaker 7 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 7	Load Add Shed Control
42651	Breaker 8 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 8	Load Add Shed Control
42652	Breaker 9 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 9	Load Add Shed Control
42653	Breaker 10 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 10	Load Add Shed Control
42654	Breaker 7 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 7	Load Add Shed Control
42655	Breaker 8 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 8	Load Add Shed Control
42656	Breaker 9 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 9	Load Add Shed Control
42657	Breaker 10 trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 10	Load Add Shed Control
42658	Gen9 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen9 CB position input	Discrete Inputs
42659	Gen9 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen9 CB position volatile input	Discrete Inputs
42660	Gen10 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen10 CB position input	Discrete Inputs

Addr.	System Name	Access	Specifications	Description	Function
42661	Gen10 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen10 CB position volatile input	Discrete Inputs
42662	Gen11 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen11 CB position input	Discrete Inputs
42663	Gen11 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen11 CB position volatile input	Discrete Inputs
42664	Gen12 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen12 CB position input	Discrete Inputs
42665	Gen12 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen12 CB position volatile input	Discrete Inputs
42666	Gen13 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen13 CB position input	Discrete Inputs
42667	Gen13 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen13 CB position volatile input	Discrete Inputs
42668	Gen14 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen 14 CB position input	Discrete Inputs
42669	Gen14 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen 14 CB position volatile input	Discrete Inputs
42670	Gen15 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen 15 CB position input	Discrete Inputs
42671	Gen15 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen 15 CB position volatile input	Discrete Inputs
42672	Gen16 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen 16 CB position input	Discrete Inputs
42673	Gen16 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen 16 CB position volatile input	Discrete Inputs
42674	ATS 11 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 11	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42675	ATS 12 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 12	Load Add Shed Control
42676	ATS 13 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 13	Load Add Shed Control
42677	ATS 14 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 14	Load Add Shed Control
42678	ATS 15 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 15	Load Add Shed Control
42679	ATS 16 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 16	Load Add Shed Control
42680	ATS 17 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 17	Load Add Shed Control
42681	ATS 18 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 18	Load Add Shed Control
42682	Breaker 11 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 11	Load Add Shed Control
42683	Breaker 12 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 12	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42684	Breaker 13 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 13	Load Add Shed Control
42685	Breaker 14 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 14	Load Add Shed Control
42686	Breaker 15 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 15	Load Add Shed Control
42687	Breaker 16 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 16	Load Add Shed Control
42688	Breaker 17 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 17	Load Add Shed Control
42689	Breaker 18 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 18	Load Add Shed Control
42690	Breaker 11 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip sta- tus of breaker 11	Load Add Shed Control
42691	Breaker 12 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip sta- tus of breaker 12	Load Add Shed Control
42692	Breaker 13 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip sta- tus of breaker 13	Load Add Shed Control
42693	Breaker 14 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip sta- tus of breaker 14	Load Add Shed Control
42694	Breaker 15 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip sta- tus of breaker 15	Load Add Shed Control
42695	Breaker 16 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip sta- tus of breaker 16	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42696	Breaker 17 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 17	Load Add Shed Control
42697	Breaker 18 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 18	Load Add Shed Control
42698	Load Add Shed Enable Status	Read Only	0: Disabled 1: Enabled 2: Paused Default:	Indicates the overall state of the load add shed function	Load Add Shed Control
42699	PCCNet Status	Read Only	0: No Connection 1: Connected 2: Connecting Default:	Indicates overall state of the PCCNet communications bus	Communications
42700	Gen1 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:	For load demand use – indicates status of Gen1	Load Demand Control
42701	Gen2 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:	For load demand use – indicates status of Gen2	Load Demand Control
42702	Gen3 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:	For load demand use – indicates status of Gen3	Load Demand Control
42703	Gen4 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:	For load demand use – indicates status of Gen4	Load Demand Control
42704	Gen1 Online Time	Read Only	Multiplier: .00027777780 Offset: 0 Size (bits): 32 Sign:U	Unit:Hours Lower Limit:.000 Hours Upper Limit: 1193046.000 Hours Default:0	Total online time for Gen1 System Information

Addr.	System Name	Access	Specifications	Description	Function	
42706	Gen2 Online Time	Read Only	Multiplier: .00027777780 Offset: 0 Size (bits): 32	Unit:Hours Lower Limit: .000 Hours Upper Limit: 1193046.000 Hours Default:0	Total online time for Gen2	System Information
42708	Gen3 Online Time	Read Only	Multiplier: .00027777780 Offset: 0 Size (bits): 32	Unit:Hours Lower Limit: .000 Hours Upper Limit: 1193046.000 Hours Default:0	Total online time for Gen3	System Information
42710	Gen4 Online Time	Read Only	Multiplier: .00027777780 Offset: 0 Size (bits): 32	Unit:Hours Lower Limit: .000 Hours Upper Limit: 1193046.000 Hours Default:0	Total online time for Gen4	System Information
42712	GenA	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenA (never stops) for load demand	Load Demand Control	

Addr.	System Name	Access	Specifications	Description	Function
42713	GenB	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenB for load demand	Load Demand Control
42714	GenC	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenC for load demand	Load Demand Control
42715	GenD	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator sets is currently GenD for load demand	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function	
42716	Load Demand State	Read Only	0: Off 1: Initial Delay Timing 2: Load Monitor Default	Indicates operating state of the load demand control	Load Demand Control	
42717	Total Number of Gensets Online	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Indicates how many of the generator sets are online which are sensed by CB position	System Information
42718	Total Spare Online Capacity	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Difference between sensed online capacity and generator set bus total kW	System Information
42719	Next Gen Shutdown Threshold	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Indicates kW threshold for generator bus at which next generator set will restart	Load Demand Control
42720	Next Gen Shutdown Threshold	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Indicates kW threshold for generator bus at which the next generator set will load demand stop	Load Demand Control
42721	Next Gen Restart	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is next to be restarted if load conditions are met	Load Demand Control	

Addr.	System Name	Access	Specifications	Description	Function	
42722	Next Gen Shutdown	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is next to be stopped if load conditions are met	Load Demand Control	
42723	Load Demand Gen1 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of the load demand Gen1 driver output	Discrete Outputs	
42724	Load Demand Gen2 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of the load demand Gen2 driver output	Discrete Outputs	
42725	Load Demand Gen3 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of the load demand Gen3 driver output	Discrete Outputs	
42726	Load Demand Gen4 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of the load demand Gen4 driver output	Discrete Outputs	
42727	Genset Bus kW Overload Status	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Calculated kW overload threshold based on on-line capacity and % setting	System Information
42728	Genset Bus kW Overload Status	Read Only	0: No Overload 1: Overload Default:	Indicates whether generator bus is overloaded based on kW	System Information	
42729	Genset Bus Underfrequency Overload Status	Read Only	0: No Overload 1: Overload Default:	Indicates whether generator bus is overloaded based on frequency	System Information	

Addr.	System Name	Access	Specifications	Description	Function	
42730	Active Schedule	Read Only	0: None 1: Program 1 2: Program 2 3: Program 3 4: Program 4 5: Program 5 6: Program 6 7: Program 7 8: Program 8 9: Program 9 10: Program 10 11: Program 11 12: Program 12 13: Exception 1 14: Exception 2 15: Exception 3 16: Exception 4 17: Exception 5 18: Exception 6 Default:	Indicates the currently active scheduler program or exception	System Scheduler	
42731	Scheduler Run Command	Read Only	0: Off 1: No Load 2: With Load 3: Extended Parallel Default:	Indicates current run command coming from scheduler function	System Scheduler	
42732	Modbus Bus Message Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Modbus message count	Communications
42733	Modbus CRC Error Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Modbus CRC error count	Communications
42734	Modbus Exception Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Modbus exception count	Communications
42735	Modbus No Response Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Modbus no response count	Communications
42736	Modbus Slave Message Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Modbus slave message count	Communications

Addr.	System Name	Access	Specifications	Description	Function	
42737	Modbus Clear Counters	Read/Write	0: Do Nothing 1: Clear Counters Default: Do Nothing	Clears all modbus counters	Communications	
42738	Clock Mode	Read/Write	0: Normal 1: Set Clock 2: Save Clock Default: Normal	Use to set clock and save setting	Real Time Clock	
42739	Clock Year	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: year Lower Limit: .000 year Upper Limit: 99.000 year Default: Read from RTC chip	Use to set or read current year	Real Time Clock
42740	Clock Month	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: month Lower Limit: 1.000 month Upper Limit: 12.000 month Default: Read from RTC chip	Use to set or read current month	Real Time Clock
42741	Clock Date	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: date Lower Limit: 1.000 date Upper Limit: 31.000 date Default: Read from RTC chip	Use to set or read current date	Real Time Clock
42742	Clock Hour	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: hour Lower Limit: 1.000 hour Upper Limit: 23.000 hour Default: Read from RTC chip	Use to set or read current hour	Real Time Clock
42743	Clock Minute	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: minute Lower Limit: 1.000 minute Upper Limit: 59.000 minute Default: Read from RTC chip	Use to set or read current minute	Real Time Clock
42744	Clock Second	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: second Lower Limit: .000 second Upper Limit: 59.000 second Default: Read from RTC chip	Use to set or read current second	Real Time Clock

Addr.	System Name	Access	Specifications	Description	Function	
42745	Clock Day	Read Only	0: Sunday 1: Monday 2: Tuesday 3: Wednesday 4: Thursday 5: Friday 6: Saturday Default:	Indicates day of the week for current date	Real Time Clock	
42746	Start Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: seconds Upper Limit: seconds Default:	Countdown timer value for generator set start timer	PTC Operating Mode
42747	Stop Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: seconds Upper Limit: seconds Default:	Countdown timer value for generator set stop timer	PTC Operating Mode
42748	Low Battery Voltage Threshold	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: VDC Upper Limit: VDC Default:	Battery voltage with respect to set low battery threshold	Battery Voltage Protection
42749	High Battery Voltage Threshold	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: VDC Upper Limit: VDC Default:	Battery voltage with respect to set high battery threshold	Battery Voltage Protection
42750	Gen5 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use – indicates status of Gen5	Load Demand Control	
42751	Gen6 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use – indicates status of Gen6	Load Demand Control	
42752	Gen7 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use – indicates status of Gen7	Load Demand Control	

Addr.	System Name	Access	Specifications	Description	Function
42753	Gen8 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use – indicates status of Gen8	Load Demand Control
42754	Load Demand Gen5 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of the load demand Gen5 driver output	Discrete Outputs
42755	Load Demand Gen6 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of the load demand Gen6 driver output	Discrete Outputs
42756	Load Demand Gen7 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of the load demand Gen7 driver output	Discrete Outputs
42757	Load Demand Gen8 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of the load demand Gen8 driver output	Discrete Outputs
42758	GenE	Read Only	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default:	Indicates which generator set is currently GenE for load demand	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function
42759	GenF	Read Only	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default:	Indicates which generator set is currently GenF for load demand	Load Demand Control
42760	GenG	Read Only	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default:	Indicates which generator set is currently GenG for load demand	Load Demand Control
42761	GenH	Read Only	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default:	Indicates which generator set is currently GenH for load demand	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function
42762	Add Level 7 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 7	Load Add Shed Control
42763	Add Level 8 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 8	Load Add Shed Control
42764	Add Level 9 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 9	Load Add Shed Control
42765	Add Level 10 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 10	Load Add Shed Control
42766	Add Load 7 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 7	Load Add Shed Control
42767	Add Load 8 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 8	Load Add Shed Control
42768	Add Load 9 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 9	Load Add Shed Control
42769	Add Load 10 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 10	Load Add Shed Control
42770	Shed Level 6 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 6	Load Add Shed Control
42771	Shed Level 7 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 7	Load Add Shed Control
42772	Shed Level 8 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 8	Load Add Shed Control
42773	Shed Level 9 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 9	Load Add Shed Control
42774	Shed Load 7 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 7	Load Add Shed Control
42775	Shed Load 8 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 8	Load Add Shed Control
42776	Shed Load 9 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 9	Load Add Shed Control
42777	Shed Load 10 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 10	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function	
42778	Restore Shed Level 6 Command	Read Only	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 6 has been restored	Load Add Shed Control	
42779	Restore Shed Level 7 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 7 has been restored	Load Add Shed Control	
42780	Restore Shed Level 8 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 8 has been restored	Load Add Shed Control	
42781	Restore Shed Level 9 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 9 has been restored	Load Add Shed Control	
42782	Gen5 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: hours Lower Limit: .000 hours Upper Limit: 1193046.000 hours Default: 0	Total online time for Gen5	System Information
42784	Gen6 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: hours Lower Limit: .000 hours Upper Limit: 1193046.000 hours Default: 0	Total online time for Gen6	System Information
42786	Gen7 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: hours Lower Limit: .000 hours Upper Limit: 1193046.000 hours Default: 0	Total online time for Gen7	System Information
42788	Gen8 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: hours Lower Limit: .000 hours Upper Limit: 1193046.000 hours Default: 0	Total online time for Gen8	System Information
42790	Manual Add Level 7 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 7	Load Add Shed Control	
42791	Manual Add Level 8 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 8	Load Add Shed Control	
42792	Manual Add Level 9 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 9	Load Add Shed Control	
42793	Manual Add Level 10 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 10	Load Add Shed Control	

Addr.	System Name	Access	Specifications	Description	Function
42794	Manual Shed Level 6 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 6	Load Add Shed Control
42795	Manual Shed Level 7 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 7	Load Add Shed Control
42796	Manual Shed Level 8 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 8	Load Add Shed Control
42797	Manual Shed Level 9 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 9	Load Add Shed Control
42798	Gen9 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:	For load demand use – indicates status of Gen9	Load Demand Control
42799	Gen10 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:	For load demand use – indicates status of Gen10	Load Demand Control
42800	Gen11 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:	For load demand use – indicates status of Gen11	Load Demand Control
42801	Gen12 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:	For load demand use – indicates status of Gen12	Load Demand Control
42802	Gen13 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:	For load demand use – indicates status of Gen13	Load Demand Control
42803	Gen14 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use – indicates status of Gen14	Load Demand Control
42804	Gen15 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use – indicates status of Gen15	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function
42805	Gen16 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use – indicates status of Gen16	Load Demand Control
42806	Load Demand Gen9 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of load demand Gen9 driver output	Discrete Outputs
42807	Load Demand Gen10 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of load demand Gen10 driver output	Discrete Outputs
42808	Load Demand Gen11 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of load demand Gen11 driver output	Discrete Outputs
42809	Load Demand Gen12 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of load demand Gen12 driver output	Discrete Outputs
42810	Load Demand Gen13 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of load demand Gen13 driver output	Discrete Outputs
42811	Load Demand Gen14 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of load demand Gen14 driver output	Discrete Outputs
42812	Load Demand Gen15 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of load demand Gen15 driver output	Discrete Outputs
42813	Load Demand Gen16 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of load demand Gen16 driver output	Discrete Outputs
42814	Gen1	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently Gen1 for load demand	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function
42815	GenJ	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenJ for load demand	Load Demand Control
42816	GenK	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenK for load demand	Load Demand Control
42817	GenL	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenL for load demand	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function
42818	GenM	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenM for load demand	Load Demand Control
42819	GenN	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenN for load demand	Load Demand Control
42820	GenO	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenO for load demand	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function
42821	GenP	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenP for load demand	Load Demand Control
42822	Add Level 11 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 11	Load Add Shed Control
42823	Add Level 12 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 12	Load Add Shed Control
42824	Add Level 13 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 13	Load Add Shed Control
42825	Add Level 14 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 14	Load Add Shed Control
42826	Add Level 15 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 15	Load Add Shed Control
42827	Add Level 16 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 16	Load Add Shed Control
42828	Add Level 17 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 17	Load Add Shed Control
42829	Add Level 18 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 18	Load Add Shed Control
42830	Add Load 11 Command	Read Only	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 11	Load Add Shed Control
42831	Add Load 12 Command	Read Only	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 12	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42832	Add Load 13 Command	Read Only	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 13	Load Add Shed Control
42833	Add Load 14 Command	Read Only	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 14	Load Add Shed Control
42834	Add Load 15 Command	Read Only	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 15	Load Add Shed Control
42835	Add Load 16 Command	Read Only	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 16	Load Add Shed Control
42836	Add Load 17 Command	Read Only	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 17	Load Add Shed Control
42837	Add Load 18 Command	Read Only	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 18	Load Add Shed Control
42838	Shed Level 10 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 10	Load Add Shed Control
42839	Shed Level 11 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 11	Load Add Shed Control
42840	Shed Level 12 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 12	Load Add Shed Control
42841	Shed Level 13 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 13	Load Add Shed Control
42842	Shed Level 14 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 14	Load Add Shed Control
42843	Shed Level 15 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 15	Load Add Shed Control
42844	Shed Level 16 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 16	Load Add Shed Control
42845	Shed Level 17 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 17	Load Add Shed Control
42846	Shed Load 11 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 11	Load Add Shed Control
42847	Shed Load 12 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 12	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42848	Shed Load 13 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 13	Load Add Shed Control
42849	Shed Load 14 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 14	Load Add Shed Control
42850	Shed Load 15 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 15	Load Add Shed Control
42851	Shed Load 16 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 16	Load Add Shed Control
42852	Shed Load 17 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 17	Load Add Shed Control
42853	Shed Load 18 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 18	Load Add Shed Control
42854	Restore Shed Level 10 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 10 has been restored	Load Add Shed Control
42855	Restore Shed Level 11 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 11 has been restored	Load Add Shed Control
42856	Restore Shed Level 12 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 12 has been restored	Load Add Shed Control
42857	Restore Shed Level 13 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 13 has been restored	Load Add Shed Control
42858	Restore Shed Level 14 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 14 has been restored	Load Add Shed Control
42859	Restore Shed Level 15 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 15 has been restored	Load Add Shed Control
42860	Restore Shed Level 16 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 16 has been restored	Load Add Shed Control
42861	Restore Shed Level 17 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 17 has been restored	Load Add Shed Control
42862	Gen9 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.00 Hours Default: 0	Total online time for Gen9 System Information

Addr.	System Name	Access	Specifications	Description	Function	
42864	Gen10 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.00 Hours Default: 0	Total online time for Gen10	System Information
42866	Gen11 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.00 Hours Default: 0	Total online time for Gen11	System Information
42868	Gen12 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.00 Hours Default: 0	Total online time for Gen12	System Information
42870	Gen13 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.00 Hours Default: 0	Total online time for Gen13	System Information
42872	Gen14 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.00 Hours Default: 0	Total online time for Gen14	System Information
42874	Gen15 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.00 Hours Default: 0	Total online time for Gen15	System Information
42876	Gen16 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.00 Hours Default: 0	Total online time for Gen16	System Information
42878	Manual Add Level 11 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 11	Load Add Shed Control	
42879	Manual Add Level 12 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 12	Load Add Shed Control	

Addr.	System Name	Access	Specifications	Description	Function
42880	Manual Add Level 13 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 13	Load Add Shed Control
42881	Manual Add Level 14 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 14	Load Add Shed Control
42882	Manual Add Level 15 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 15	Load Add Shed Control
42883	Manual Add Level 16 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 16	Load Add Shed Control
42884	Manual Add Level 17 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 17	Load Add Shed Control
42885	Manual Add Level 18 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 18	Load Add Shed Control
42886	Manual Shed Level 10 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 10	Load Add Shed Control
42887	Manual Shed Level 11 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 11	Load Add Shed Control
42888	Manual Shed Level 12 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 12	Load Add Shed Control
42889	Manual Shed Level 13 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 13	Load Add Shed Control
42890	Manual Shed Level 14 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 14	Load Add Shed Control
42891	Manual Shed Level 15 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 15	Load Add Shed Control
42892	Manual Shed Level 16 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 16	Load Add Shed Control
42893	Manual Shed Level 17 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 17	Load Add Shed Control
42894	Load 11 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 11 add shed control and status I/O	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function	
42895	Load 12 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 12 add shed control and status I/O	Load Add Shed Control	
42896	Load 13 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 13 add shed control and status I/O	Load Add Shed Control	
42897	Load 14 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 14 add shed control and status I/O	Load Add Shed Control	
42898	Load 15 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 15 add shed control and status I/O	Load Add Shed Control	
42899	Load 16 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 16 add shed control and status I/O	Load Add Shed Control	
42900	Load 17 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 17 add shed control and status I/O	Load Add Shed Control	
42901	Load 18 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 18 add shed control and status I/O	Load Add Shed Control	
42902	Load 11 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 11	Indicates which add level load 11 is assigned to	Load Add Shed Control
42903	Load 12 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 12	Indicates which add level load 12 is assigned to	Load Add Shed Control
42904	Load 13 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 13	Indicates which add level load 13 is assigned to	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function	
42905	Load 14 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 14	Indicates which add level load 14 is assigned to	Load Add Shed Control
42906	Load 15 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 15	Indicates which add level load 15 is assigned to	Load Add Shed Control
42907	Load 16 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 16	Indicates which add level load 16 is assigned to	Load Add Shed Control
42908	Load 17 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 17	Indicates which add level load 17 is assigned to	Load Add Shed Control
42909	Load 18 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 18	Indicates which add level load 18 is assigned to	Load Add Shed Control
42910	Load 11 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 10	Indicates which shed level load 11 is assigned to	Load Add Shed Control
42911	Load 12 Shed Level	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 11	Indicates which shed level load 12 is assigned to	Load Add Shed Control
42912	Load 13 Shed Level	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 12	Indicates which shed level load 13 is assigned to	Load Add Shed Control
42913	Load 14 Shed Level	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 13	Indicates which shed level load 14 is assigned to	Load Add Shed Control
42914	Load 15 Shed Level	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 14	Indicates which shed level load 15 is assigned to	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function	
42915	Load 16 Shed Level	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 15	Indicates which shed level load 16 is assigned to	Load Add Shed Control
42916	Load 17 Shed Level	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 16	Indicates which shed level load 17 is assigned to	Load Add Shed Control
42917	Load 18 Shed Level	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 17	Indicates which shed level load 18 is assigned to	Load Add Shed Control
42918	Load Demand GenI	Read /Write	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default: Gen9	Sets GenI for fixed sequence load demand	Load Demand Shed Control	
42919	Load Demand GenJ	Read /Write	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default: Gen10	Sets GenJ for fixed sequence load demand	Load Demand Shed Control	

Addr.	System Name	Access	Specifications	Description	Function
42920	Load Demand GenK	Read /Write	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default: Gen11	Sets GenK for fixed sequence load demand	Load Demand Shed Control
42921	Load Demand GenL	Read /Write	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default: Gen12	Sets GenL for fixed sequence load demand	Load Demand Shed Control
42922	Load Demand GenM	Read /Write	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default: Gen13	Sets GenM for fixed sequence load demand	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function
42923	Load Demand GenN	Read /Write	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default: Gen14	Sets GenN for fixed sequence load demand	Load Demand Control
42924	Load Demand GenO	Read /Write	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default: Gen15	Sets GenO for fixed sequence load demand	Load Demand Control
42925	Load Demand GenP	Read /Write	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default: Gen16	Sets GenP for fixed sequence load demand	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function	
42926	SID2 Status	Read Only	0: Missing 1: Good 2: Connecting 3: No Exp Board 4: Not Applicable Default:	Indicates status of SID2 (aux101/102 module 2)	Communications	
42927	SID3 Status	Read Only	0: Missing 1: Good 2: Connecting 3: No Exp Board 4: Not Applicable Default:	Indicates status of SID3 (aux101/102 module 3)	Communications	
42928	Expansion Board Communications 2	Read Only	0: Disabled 1: Enabled 2: Connecting Default: Disabled	Indicates the status of the SID2 to expansion board connection	Communications	
42929	Expansion Board Communications 3	Read Only	0: Disabled 1: Enabled 2: Connecting Default: Disabled	Indicates the status of the SID3 to expansion board connection	Communications	
42930	Utility Breaker Opening Point	Read /Write	0: After Transfer Delay 1: Upon Utility Failure Default: After Transfer Delay	PTC – point in time at which system opens utility breaker	PTC Connected	
42931	Commit To Transfer Method	Read /Write	0: Utility Disconnect 1: Genset Start 2: No Commit Default: Utility Disconnect	PTC – sets point at which system commits to transfer to generator set	PTC Operating Mode	
42932	Commit To Transfer State	Read Only	0: Not Committed 1: Committed Default:	PTC – indicates if system is committed to transferring to generator set	PTC Operating Mode	
42933	Total System Capacity 32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Sum of the generator set kW ratings in 32bit	System Information
42935	Total Online Capacity 32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Sum of the generator set kW ratings in 32bit for generator sets which are online	System Information
42937	kW Load Reference 32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	kW control reference value in 32bit for extended paralleling	Master Load Control

Addr.	System Name	Access	Specifications	Description	Function	
42939	kVAR Load Reference 32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	kVAR control reference value in 32bit for extended paralleling	Master Load Control
42943	Genset Bus kW Setpoint 32bit	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 2147483647.000 kW Default:0	Sets the base load kW setpoint in 32bit in closed loop extended paralleling	Master Load Control
42945	Genset Bus kVAR Setpoint 32bit	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVAR Lower Limit: .000 kVAR Upper Limit: 2147483647.000 kVAR Default:0	Sets the base load kVAR setpoint in 32bit in closed loop extended paralleling	Master Load Control
42947	Genset Un-loaded Level 32bit	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: -2147483648.000 kW Upper Limit: 2147483647.000 kW Default:50	Setpoint for generator set unloaded level in 32bit	Master Load Control
42949	Utility Bus kW Setpoint 32bit	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: -2147483648.000 kW Upper Limit: 2147483647.000 kW Default: 100	Sets the peak shave kW setpoint in 32bit in closed loop extended paralleling	Master Load Control
42951	Utility Bus kW Constraint Level 32bit	Read / write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: -2147483648.000 kW Upper Limit: 2147483647.000 kW Default: 100	sets the utility kW constraint level in 32bit for base load extended paralleling	Master Load Control
42953	Utility Bus kVAR Setpoint 32bit	Read / write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVAR Lower Limit: -2147483648.000 kVAR Upper Limit: 2147483647.000 kVAR Default: 100	Sets the peak shave kVAR setpoint in 32bit in closed loop extended paralleling	Master Load Control

Addr.	System Name	Access	Specifications	Description	Function	
42955	Utility Un-loaded Level 32bit	Read / write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: -2147483648.000 kW Upper Limit: 2147483647.000 kWDefault: 50	Setpoint for utility unload level in 32bit	Master Load Control
42957	Load Add Shed Required Online Capacity 32bit	Read / write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 2147483647.000 kWDefault: 0	generator set kW capacity that must be online to start timed load add; 0 disables this	Load Demand Control
42959	Load Demand Minimum Online Capacity 32bit	Read / write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 2147483647.000 kWDefault: 0	Sets how much capacity must always be online regardless of what the load is	Load Demand Control
42961	Total Utility Capacity 32bit	Read / write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: 1.000 kW Upper Limit: 2147483647.000 kWDefault: 1000	Use to set how many kW (32bit) =100% utility kW -- used by bargraph	AC Setup
42963	Genset Online Capacity Sensor Threshold 32bit	Read / write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 2147483647.000 kWDefault: 0	Set the online kW threshold 32bit at which generator set but is available for loading	PTC Sensors
42965	Load Demand Restart kW Threshold 32bit	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 2147483647.000 kWDefault: 500	Set minimum kW reserve capacity when kW in 32bit	Load Demand Control
42967	Load Demand Shutdown kW Threshold 32bit	Read / write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 2147483647.000 kw Default: 1000	Sets maximum kW reserve capacity when threshold method is absolute kW in 32bit	Load Demand Control
42971	Total Spare Online Capacity 32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Difference between sensed online capacity and generator Set bus total kW in 32bit	System Information

Addr.	System Name	Access	Specifications	Description	Function	
42973	Next Gen Restart Threshold 32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Shows 32 bit kW threshold for generator bus at which next generator set will restart	Load Demand Control
42975	Next Gen Shutdown Threshold 32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Shows 32 bit kW threshold for generator bus at which next generator set load demand stops in	Load Demand Control
42977	Genset Bus kW Overload Threshold 32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size(bits): 32 Sign:S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Calculated kW overload threshold in 32bit based on online capacity and % setting	System Information

11. MCM3320 Modbus Fault Status Bitmaps

Note: Earlier versions of software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

Note: If an address or bit is not listed in this table it is not used.

Addr.	Bit#	System Name	Fault Code	Event Name	Response
42500	0	Fault Status Bit-map 1	1455	Utility Main Breaker Position Contact Warning	Warning
42500	1	Fault Status Bit-map 1	2396	Utility Main Breaker Fail To Close Warning	Warning
42500	2	Fault Status Bit-map 1	2397	Utility Main Breaker Fail To Open Warning	Warning
42500	3	Fault Status Bit-map 1	1219	Utility Main Breaker Tripped Warning	Warning
42500	4	Fault Status Bit-map 1	1914	Utility Bus Phase Rotation Warning	Warning
42500	5	Fault Status Bit-map 1	1912	Utility Bus Loss Of Phase Warning	Warning
42500	6	Fault Status Bit-map 1	2331	Utility Bus Undervoltage Warning	Warning
42500	7	Fault Status Bit-map 1	2358	Utility Bus Overvoltage Warning	Warning
42500	8	Fault Status Bit-map 1	1223	Utility Bus Frequency Warning	Warning
42500	21	Fault Status Bit-map 1	4137	Advanced Grid Protection Warning	Warning
42500	22	Fault Status Bit-map 1	3924	Utility Reverse kW Warning	Warning
42500	23	Fault Status Bit-map 1	2939	Modbus Communication Failure Warning	Warning
42500	24	Fault Status Bit-map 1	2648	Remote IO Communication Failure Warning	Warning
42500	25	Fault Status Bit-map 1	1689	Real Time Clock Power Interrupt Warning	Warning
42500	26	Fault Status Bit-map 1	1335	AC Metering Out Of Range Warning	Warning
42500	27	Fault Status Bit-map 1	1999	Maximum Parallel Time Warning	Warning
42500	28	Fault Status Bit-map 1	343	Hardware Failure Warning	Warning

Addr.	Bit#	System Name	Fault Code	Event Name	Response
42500	29	Fault Status Bit-map 1	1456	Synchronizer Output Limit Warning	Warning
42500	30	Fault Status Bit-map 1	2416	Calibration Checksum Warning	Warning
42500	31	Fault Status Bit-map 1	353	EEPROM Write Error Warning	Warning
42502	0	Fault Status Bit-map 2	1454	Genset Main Breaker Position Contact Warning	Warning
42502	1	Fault Status Bit-map 2	1452	Genset Main Breaker Fail To Close Warning	Warning
42502	2	Fault Status Bit-map 2	1453	Genset Main Breaker Fail To Open	Warning
42502	3	Fault Status Bit-map 2	1328	Genset Main Breaker Tripped Warning	Warning
42502	4	Fault Status Bit-map 2	1915	Genset Bus Phase Rotation Warning	Warning
42502	5	Fault Status Bit-map 2	1913	Genset Bus Loss Of Phase Warning	Warning
42502	6	Fault Status Bit-map 2	1225	Genset Bus Undervoltage Warning	Warning
42502	7	Fault Status Bit-map 2	1224	Genset Bus Overvoltage Warning	Warning
42502	8	Fault Status Bit-map 2	1226	Genset Bus Frequency Warning	Warning
42502	22	Fault Status Bit-map 2	441	Low Battery Voltage Warning	Warning
42502	23	Fault Status Bit-map 2	442	High Battery Voltage Warning	Warning
42502	24	Fault Status Bit-map 2	1541	Genset Failed To Come Online Warning	Warning
42502	25	Fault Status Bit-map 2	2647	Load Demand Setup Warning	Warning
42502	26	Fault Status Bit-map 2	1444	Genset Bus Overload Warning	Warning
42502	27	Fault Status Bit-map 2	1989	kW Load Control Output Limit Warning	Warning
42502	28	Fault Status Bit-map 2	1991	kVAR Load Control Output Limit Warning	Warning
42502	29	Fault Status Bit-map 2	1121	Failure To Disconnect Warning	Warning
42502	30	Fault Status Bit-map 2	1458	Synchronizer Phase Rotation Mismatch Warning	Warning

Addr.	Bit#	System Name	Fault Code	Event Name	Response
42502	31	Fault Status Bit-map 2	1457	Fail To Synchronize Warning	Warning
42504	0	Fault Status Bit-map 1	1222	Not In Automatic Event	Event
42504	1	Fault Status Bit-map 1	1483	Common Warning Event	Event
42504	2	Fault Status Bit-map 1	2965	Genset Bus Available Event	Event
42504	3	Fault Status Bit-map 1	2328	Utility Bus Available Event	Event
42504	4	Fault Status Bit-map 1	2333	Genset Bus Connected Event	Event
42504	5	Fault Status Bit-map 1	2332	Utility Bus Connected Event	Event
42504	6	Fault Status Bit-map 1	2971	Test / Extended Parallel Event	Event
42504	7	Fault Status Bit-map 1	1916	Synchronized Event	Event
42504	8	Fault Status Bit-map 1	1534	Load Control Output Event	Event
42504	9	Fault Status Bit-map 1	2781	Genset Source Unloaded Event	Event
42504	10	Event Status Bit-map 1	2779	Utility Source Unloaded Event	Event
42504	11	Event Status Bit-map 1	3226	Genset Bus Base Load Event	Event
42504	12	Event Status Bit-map 1	3227	Utility Bus Peak Shave Event	Event



THIS PAGE LEFT INTENTIONALLY BLANK



12. MCM3320 Modbus Address 42506, 42507

Metering Fault Status Bitmaps		
Bit (LSB = 0)	Parameter	Description
0	ZXA Timeout	Zero Crossing cannot be detected on L1 voltage signal
1	ZXB Timeout	Zero Crossing cannot be detected on L2 voltage signal
2	ZXC Timeout	Zero Crossing cannot be detected on L3 voltage signal
3 (See Note 1)	Voltage Out of Range	Voltage scaling error due to incompatible combination of settings for Nominal Voltage, PT Primary Voltage, and PT Secondary Voltage
4 (See Note 1)	Current Out of Range	Current Input is saturated; actual current cannot be determined
5	Frequency Out of Range	Frequency input is out of range; valid range 24–80 Hz
6	Loss Phase Out of Range	One or more zero crossings of voltage cannot be detected; loss phase cannot be determined
7	Sync Phase Out of Range	Synchronizer phase difference cannot be measured due to any of the following: genset frequency out of range, utility frequency out of range, genset L1 voltage zero crossing not detected, or utility L1 voltage zero crossing not detected
8 (See Note 1)	kW Out of Range	kW is out of range; valid range is – 2147483648 to +2147483647 kW
9 (See Note 1)	kVAR Out of Range	kVAR is out of range; valid range is – 2147483648 to +2147483647 kVAR
10 (See Note 1)	kVA Out of Range	kVA is out of range; valid range is 0 to 4294867295 kVA
11 (See Note 1)	Power Factor Out of Range	Power factor is out of range due to either kW > kVA or kVA = 0; should not normally occur
12	AC Metering Failure	Main processor is unable to communicate with metering processor
13	Not Used	
14	Not Used	
15	Not Used	

Note:

1. If any of bits are active (1), the “AC Metering Out of Range Warning” fault will be active.
2. If Bit 12 is active (1), the “Hardware Failure Warning” fault will be active.
3. Some bits do not generate warning faults because they are a normal occurrence (e.g. if a source is dead).

Cummins Power Generation

1400 73rd Ave. NE
Minneapolis, MN 55432 USA

Phone 1 763 574 5000

Toll-free 1 800 888 6626

Fax 1 763 574 5298

Email ask.powergen@cummins.com

www.cumminspower.com

Cummins®, the "C" logo, and "Our energy working for you." are trademarks of Cummins Inc.

©2012 Cummins Power Generation, Inc. All rights reserved.

